
**A Curve-Based Mixed System Rating Method for
Unitary Air Conditioners**

W. Vance Payne
Piotr A. Domanski

U.S. DEPARTMENT OF COMMERCE
National Institute of Standards and Technology
Building Environment Division
Building and Fire Research Laboratory
Gaithersburg, Maryland 20899-8631



**National Institute of Standards and Technology
Technology Administration
United States Department of Commerce**

**A Curve-Based Mixed System Rating Method for
Unitary Air Conditioners**

W. Vance Payne
Piotr A. Domanski

U.S. DEPARTMENT OF COMMERCE
National Institute of Standards and Technology
Building Environment Division
Building and Fire Research Laboratory
Gaithersburg, Maryland 20899-8631

May 2005



U.S. DEPARTMENT OF COMMERCE
Carlos M. Gutierrez, Secretary
TECHNOLOGY ADMINISTRATION
Phillip J. Bond, Under Secretary of Commerce for Technology
National Institute of Standards and Technology
Hratch Semerjian, Acting Director

TABLE OF CONTENTS

List of Tables.....	iv
List of Figures	v
Nomenclature.....	vii
Abstract.....	1
Acknowledgement.....	2
1: Introduction	3
2: Tested Mixed Evaporators	4
3: Mixed Evaporator Capacity Determination	5
3.1: Experimental setup.....	5
3.2: Data acquisition and measurement uncertainty	6
3.3: Test conditions and procedure	7
3.4: Evaporator capacity curve fits and characterization.....	8
4: Mixed System Performance Prediction	16
4.1: Calculation of Q(95), Q(82) and EER(82)	16
4.2: Calculation of SEER.....	18
5: NIST Predictions and ARI Database Comparison	20
5.1: A-Test capacity comparison	20
5.2: B-Test EER comparison.....	24
5.3: SEER comparison	27
6: Generating an Evaporator Capacity Line Using EVAP-COND	28
7: Uncertainty of the C-B Method.....	30
7.1: Uncertainty of the evaporator capacity linear fit	30
7.2: Uncertainty of C-B Method Q(95) and EER	33
8: Concluding Remarks.....	34
References.....	37
Appendix A: Evaporator Coil Descriptions	39
Appendix B: Uncertainty Analysis	48
Appendix C: Cooling Measurement Summary Sheets.....	57

List of Tables

2.1: Tested mixed evaporators	5
3.2.1: Measurement uncertainty	7
3.3.1: Refrigerant conditions during evaporator tests	7
3.4.1: Mixed evaporator capacity linear fit coefficients and fan powers from NIST coil tests	13
4.1.1: CD Unit linear coefficients for power and capacity at A-Test and B-Test conditions from ARI	16
4.1.2: Mixed system A-Test capacity from the C-B Method	17
4.1.3: Mixed system B-Test capacity, power, and EER from the C-B Method	18
4.2.1: System classifications for cyclic degradation coefficient analysis	19
4.2.2: Cyclic degradation coefficient values for different system categories	19
4.2.3: Mixed system SEER calculated using statistically determined C_D for 95 th and 99 th percentiles	20
5.1.1: Mixed system A-Test capacities from ARI Tests and C-B Method	20
5.1.2: Mixed system A-Test capacities from the ARI tests, condensing unit capacities from CD Unit curves, and evaporator capacities from NIST-developed evaporator capacity curves at the ARI-test evaporating temperature	23
5.1.3: Mixed system A-test capacities from ARI values and evaporator capacities from NIST-developed evaporator capacity curves at the ARI-test evaporating temperature	23
5.2.1: Mixed system B-Test comparison of ARI tested and C-B Method results	26
5.3.1: SEERs from ARI database and C-B Method	27
6.1: EVAP-COND correction parameters for Coil 9	28
7.1.1: Coil 9 evaporator linear fit equation statistics	30
7.1.2: Evaporator $Q(95)$ linear fit uncertainty	32
7.2.1: C-B Method $Q(95)$, $Q(82)$, $P(82)$, and EER uncertainty at the 95 % confidence level on the mean value	34

List of Figures

1.1: Graphical illustration of the curve-based rating procedure	4
3.1.1: Evaporator test arrangement	6
3.4.1: Coil 1 cooling capacity as a function of outlet saturation temperature	8
3.4.2: Coil 2 cooling capacity as a function of outlet saturation temperature	9
3.4.3: Coil 3 cooling capacity as a function of outlet saturation temperature	9
3.4.4: Coil 4 cooling capacity as a function of outlet saturation temperature	10
3.4.5: Coil 5 cooling capacity as a function of outlet saturation temperature	10
3.4.6: Coil 6 cooling capacity as a function of outlet saturation temperature	11
3.4.7: Coil 7 cooling capacity as a function of outlet saturation temperature	11
3.4.8: Coil 8 cooling capacity as a function of outlet saturation temperature	12
3.4.9: Coil 9 cooling capacity as a function of outlet saturation temperature	12
3.4.10: Cooling capacity, $q(95)$, for all evaporators based on NIST linear-fit.....	14
3.4.11: Airflow rate relative to cooling capacity from the NIST linear fit for all coils at an evaporation temperature of 7.2 °C (45 °F)	15
3.4.12: NIST measured SHR as a function of airflow rate per unit of cooling capacity at an evaporator exit saturation temperature of 16.2 °C (50.0 °F)	15
5.1.1: Comparison of mixed system A-test capacities from the ARI tests and the C-B method	21
5.2.1: Percent differences between ARI Values and the C-B Method for the EER(82) calculation	24
5.3.1: ARI Values and C-B Method SEER/EER Multiplier, EER, and SEER	27
6.1: Coil 9 simulated and measured cooling capacity	29
6.2: C-B Method $Q(95)$, EER(82) and SEER ratio with respect to the ARI database using the measured and simulated Coil 9 capacity	29

7.1.1: Coil 9 evaporator cooling capacity, confidence and error bands on the mean predicted value of the cooling capacity sampled at a particular evaporator saturation temperature	32
---	----

Nomenclature

A	EVAP-COND air-side heat transfer coefficient correction factor
A-Test	refers to ARI Standard 210/240 steady-state test conditions of 35 °C (95 °F) outdoor air and 16.7 °C (80 °F) dry-bulb/ 19.4 °C (67 °F) wet-bulb indoor air conditions
B-Test	refers to ARI Standard 210/240 steady-state test conditions of 27.8 °C (82 °F) outdoor air and 16.7 °C (80 °F) dry-bulb/ 19.4 °C (67 °F) wet-bulb indoor air conditions
C_D	cyclic degradation coefficient as defined in ARI Standard 210/240-2003
C-B Method	curve-based method as presented in this report
CD Unit	condensing unit, the outdoor section of the split air-conditioner
CLF	Cooling Load Factor as defined in ARI Standard 210/240-2003
Diff	abbreviation for difference
DOF	degrees of freedom
EVAP-COND	refers to evaporator and condenser simulation software available from NIST
EER	Energy Efficiency Ratio as calculated in ARI Standard 210/240-2003, W/W (Btu/W·h)
\dot{m}	mass flow rate, kg/h (lb/h)
matched	refers to a split air-conditioning system, an indoor section/condensing unit combination, which rated performance is determined by laboratory testing; also may refer to the evaporator which is used in the matched system.
mixed	refers to a split air-conditioning system, an indoor section/condensing unit combination, which rated performance is not determined by laboratory testing; also may refer to the evaporator which is used in the mixed system.
n	number of tests or number of data points
P	electrical power, W
$p(82)$	condensing unit power at B-Test condition (indoor fan power not included), W
$P(82)$	total power of air conditioner at B-Test condition (condensing unit power plus indoor fan power), W
ΔP	EVAP-COND refrigerant-side pressure drop correction factor

Q	Cooling capacity, W (Btu/h)
$q(82)$	cooling capacity at B-Test condition without accounting for indoor fan heat input, W (Btu/h)
$Q(82)$	cooling capacity at B-Test conditions with the indoor fan heat input accounted for, W (Btu/h)
$q(95)$	cooling capacity at A-Test conditions without accounting for indoor fan heat input, W (Btu/h)
$Q(95)$	cooling capacity at A-Test conditions with the indoor fan heat input accounted for, W (Btu/h)
ρ	correlation coefficient
R	EVAP-COND refrigerant-side heat transfer coefficient correction factor
scfm	standard cubic feet per minute, which is equal to the equivalent volumetric flowrate of air with a density of 0.075 lbm/ft ³
SEER	Seasonal Energy Efficiency Ratio as defined in ARI Standard 210/240-2003, Btu/(W·h)
SHR	sensible heat ratio; the ratio of sensible capacity to total capacity
$\hat{\sigma}$	data standard deviation or fit standard error
SSE	sum of squares of the error
t or t-value	percentage points of the t-distribution (Ott 1984)
ton	cooling or heating capacity equal to 12 000 Btu/h or 3.517 kW
U	absolute value of a quantity's uncertainty

Subscripts

CD	condensing unit of the split system air conditioner
cyc	cyclic testing
diff	difference
dry	dry-coil testing
evap	refers to the indoor coil or evaporator at saturated refrigerant conditions
fan	refers to the indoor coil fan
mixed	refers to the evaporator coil alone with respect to a system
ref	refrigerant
ss	steady-state

A Curve-Based Mixed System Rating Method for Unitary Air Conditioners

W. Vance Payne and Piotr A. Domanski
National Institute of Standards and Technology

Abstract

The curve-based method was evaluated based on performance predictions and independent laboratory testing for nine mixed systems. Capacity predictions were within $\pm 5\%$ of the tested values for six of the mixed systems, and four of the SEER predictions were within $\pm 5\%$ of the tested SEERs. Predictions for SEER showed an under prediction bias due to the wide variation of possible values for the cyclic degradation coefficient (C_D) and the necessity of assuming a conservative value of C_D in mixed system rating calculations. This report includes detailed measurement data for the tested evaporators and an uncertainty analysis of the rating methodology.

Keywords: air conditioner, cooling capacity, cyclic degradation coefficient, mixed system, rating procedure, SEER

ACKNOWLEDGEMENT*

This study was sponsored by the United States Department of Energy, Office of Building Technology, State and Community Programs under contract DE-AI01-99EE27572 under project manager Michael Raymond. Mr. John Wamsley and Mr. Glen Glaeser provided assistance with testing of the evaporator coils, operating the chambers, and analyzing data. Mr. Brian Dougherty provided critical information on values of the degradation coefficient for cyclic operation for different equipment options. Mr. Stefan Leigh, of the NIST Statistical Engineering Division, assisted in the uncertainty analysis. Mr. Tim Corcoran and his staff at Intertek Testing Services (ITS) provided results from system tests. Mr. Michael Woodford and Ms. Sarah Medepalli of ARI provided technical and logistical support. Mr. Chad Kirkwood of United Technologies, Carrier Corporation aided in formulating the scope of this project. The reviewers of the draft of this report were Mr. David Yashar of NIST, Mr. Carl Bergt of Rheem Manufacturing Company, Mr. Chad Kirkwood of United Technologies Carrier Corporation, and Mr. Michael Woodford of the Air-Conditioning and Refrigeration Institute.

* *Use of Non-SI Units in a NIST Publication:* The policy of the National Institute of Standards and Technology is to use the International System of Units (metric units) in all of its publications. However, in North America in the heating, ventilation and air-conditioning industry, certain non-SI units are so widely used instead of SI units that it is more practical and less confusing to include some measurement values in customary units only.

1: INTRODUCTION

A given condensing unit (outdoor section consisting of a condenser, compressor, and associated tubing) is typically offered on the market in several air-conditioner models, which differ by the indoor sections they employ. For all models, the manufacturers must provide performance information, which consists of the Seasonal Energy Efficiency Ratio (SEER) and capacity at the 35 °C (95 °F) rating point, Q(95). Federal regulations require that only the highest sales volume indoor-section/outdoor-section combination, referred to as the matched system, be tested in a laboratory to obtain the ratings (CFR 2004a). For other combinations of indoor and outdoor sections, so called mixed systems, the federal regulations allow the use of simplified analytical methodologies upon approval by the U.S. Department of Energy (CFR 2004b).

The most commonly used simplified methodologies for rating mixed systems are those based upon publicly available Q(95) and SEER of the matched systems (e.g., Domanski 1989). The application of these methods requires the rater to predict the capacity of the matched evaporator, which is a major shortcoming because the rater is not often familiar with the matched system product line. Since an inaccurate prediction of the matched evaporator leads directly to inaccurate mixed system ratings, a different rating method that would not include this step, e.g. the performance curve-based method (C-B Method), has the inherent potential to be a better rating approach than the one currently used. Recently, both coil and condensing unit manufacturers expressed interest in using the C-B Method to predict mixed system performance.

Figure 1.1 shows the application of the C-B Method in a graphical form. This method uses linear fits to the cooling capacity for the mixed coil, and cooling capacities, $q(82)$ and $q(95)$, and power, $p(82)$, for the condensing unit (CD Unit). The lines are presented as a function of the compressor suction saturation temperature. Overlapping of the evaporator and CD Unit capacities provides mixed system capacities at 27.8 °C (82 °F) and 35.0 °C (95 °F) ambient temperatures. Projecting the saturation temperature corresponding with operation at the 27.8 °C (82 °F) ambient temperature on the CD Unit power chart provides the power requirement for the CD Unit at the 27.8 °C (82 °F) rating point. Figure 1.1 is convenient for explaining the C-B method. In real applications, this method is best implemented numerically using a computer.

It should be noted that the rating process explained above is exclusive of the indoor fan power. Before the rating of the mixed system is finalized, the indoor fan power must be added to the CD Unit power to produce the power for the system at the 27.8 °C (82 °F) rating point $P(82)$. The indoor fan heat must also be included as heat reducing the cooling capacities $q(95)$ and $q(82)$ obtained from overlapping the capacity lines of the CD Unit and mixed evaporator to produce actual mixed system capacities, Q(82) and Q(95). The energy efficiency ratio at the 27.8 °C (82 °F) rating point (EER(82)) can then be calculated using the corrected values of capacity, Q(82), and power, P(82).

$$\text{EER}(82) = \frac{Q(82)}{P(82)} \quad 1.1$$

To conclude with the SEER calculation, the value of the cyclic degradation coefficient, C_D , is required.

$$SEER = (1 - 0.5 \cdot C_D) EER(82)$$

1.2

The cyclic degradation coefficient, C_D , has to be obtained from a separate analysis or the default value of 0.25 may be assumed.

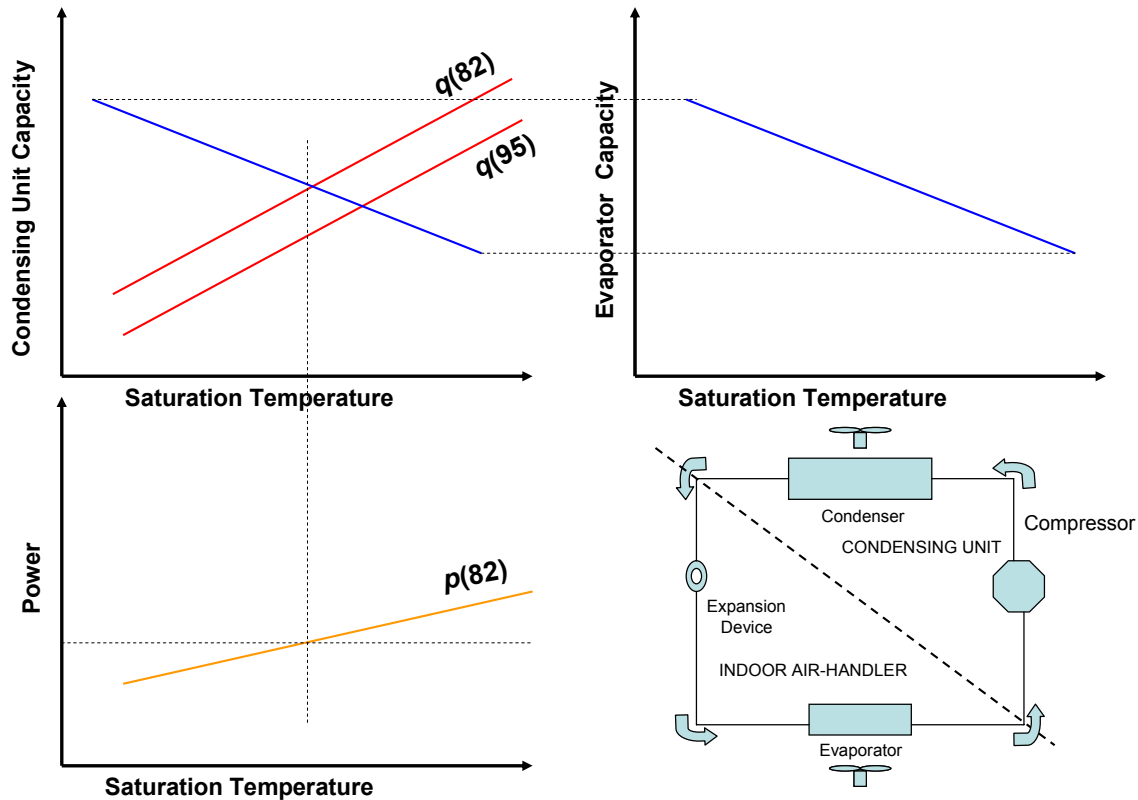


Figure 1.1: Graphical illustration of the curve-based rating procedure

The goal of this study was to evaluate the practicality and accuracy of the curve-based method through its application to nine mixed systems. In this effort, NIST assumed the role of an evaporator manufacturer and developed cooling capacity lines for nine mixed evaporator coils. After obtaining the needed condensing unit performance curves from the Air-Conditioning and Refrigeration Institute (ARI) database, NIST developed mixed system ratings, and then compared them to laboratory derived ratings obtained at an independent testing laboratory for the ARI Unitary Equipment Certification Program.

2: TESTED MIXED EVAPORATORS

Table 2.1 shows basic information on the tested mixed evaporators. They were manufactured by several different companies and had different capacities. All evaporators were of the finned-tube design. Three evaporators were inclined slabs, four coils were constructed in an A-shape configuration, and one in a semi-A-shape configuration. Three of the coils tested were equipped with a fan and required indoor fan power measurement. The remaining six coils were intended to have field-installed fans. Appendix A presents detailed design data, circuitry configuration, and pictures of the coils.

Table 2.1: Tested mixed evaporators

Coil Number	Coil Designation	Coil Configuration	Airflow Direction	Tube Outside Diameter	Expansion Device	Refrigerant
1	A01102	A	Horizontal	9.5 mm (0.375 in)	TXV	R22
2	A01070	Semi A	Horizontal	9.5 mm (0.375 in)	Piston	R22
3	A01148	A	Upflow	9.5 mm (0.375 in)	TXV	R22
4	A01138	A	Upflow	9.5 mm (0.375 in)	Piston	R22
5	A01060*	Inclined Slab	Upflow/ Horizontal	9.5 mm (0.375 in)	Piston	R22
6	A01125*	Inclined Slab	Horizontal	9.5 mm (0.375 in)	TXV	R22
7	H5326	A	Horizontal	9.5 mm (0.375 in)	Piston	R22
8	H5321	A	Upflow	9.5 mm (0.375 in)	Piston	R22
9	A01154*	Inclined Slab	Horizontal	9.5 mm (0.375 in)	TXV	R410A

*indoor fan included

3: MIXED EVAPORATOR CAPACITY DETERMINATION

3.1: Experimental setup

Figure 3.1.1 shows the experimental setup. The evaporator was installed in the indoor environmental chamber, where air conditions were controlled by a chiller/air handler system. Air was pulled through the evaporator by a centrifugal fan located at the outlet of the nozzle chamber ductwork. The adjacent outdoor chamber housed the water-cooled condensing unit and the laboratory water-chiller. Two different condensing units were used for R22 and R410A evaporators due to lubricant-related considerations. Each condensing unit was equipped with a variable-speed compressor, condenser, and subcooler. The water chiller control system manipulated the temperature and mass flow rate of the water delivered to the condensing unit. The chiller rejected heat to the in-house chilled water loop. Heat rejection was to water and did not require maintaining the outdoor chamber conditions.

The installation of the evaporator and test instrumentation conformed to ASHRAE Standard 37-1989. We used the air enthalpy method for the primary measurement of the evaporator capacity with the refrigerant enthalpy method providing the secondary measurement. Air dew-point temperature was measured at the inlet of the evaporator ductwork and in the ductwork after the evaporator and several mixers. Twenty-five node thermocouple grids, located on each side of the evaporator, were used to verify that the air was well mixed at each point. A 25-junction thermopile measured the air temperature change across the evaporator. Barometric pressure, evaporator air pressure drop, air temperature and pressure drop in the nozzle, and nozzle temperature were used along with the dew-point measurements to establish the thermodynamic state of the air. The refrigerant enthalpy method required measurement of the evaporator inlet and exit refrigerant temperatures and pressures in addition to mass flowrate. The agreement between the air-side and refrigerant-side methods was always within 4 %.

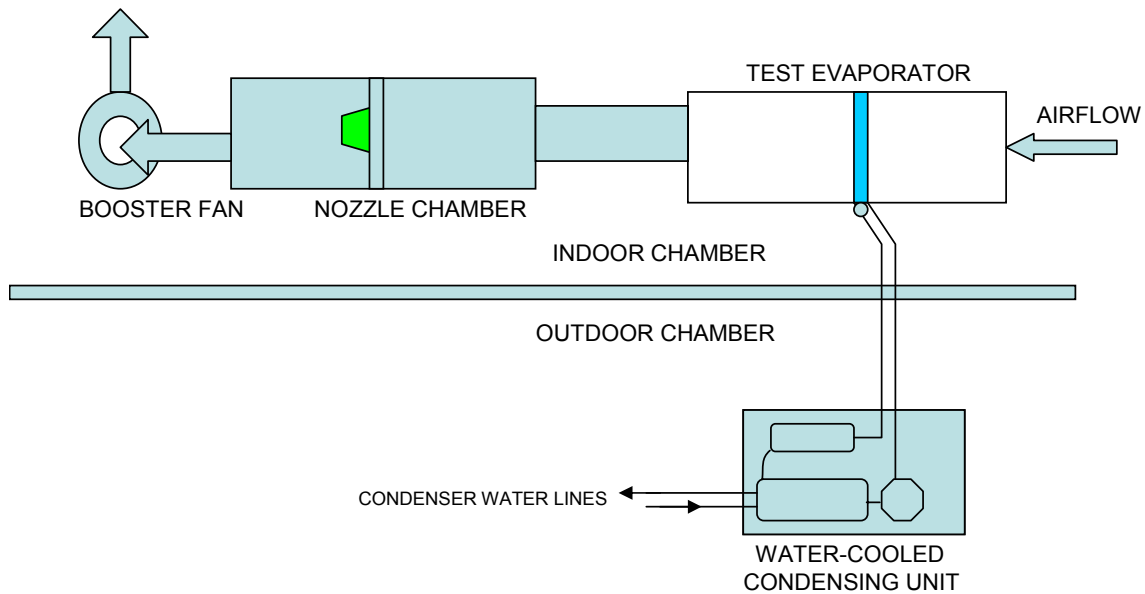


Figure 3.1.1: Evaporator test arrangement

3.2: Data acquisition and measurement uncertainty

The measurement points consisted of temperature, pressure, pressure difference, temperature difference, dew-point temperature, fan amps, fan volts, and fan power. Table 3.2.1 lists the measured quantities and their uncertainties for a 95 % confidence limit (two sigma on the mean value) (Taylor and Kuyatt 1994). The uncertainty for the evaporator capacity was calculated using a propagation of uncertainty technique, considering the uncertainty in each of the parameters associated with the capacity measurement. Appendix B explains the application of this technique in more detail.

Table 3.2.1: Measurement uncertainty

Quantity	Range	Uncertainty
Pressure	0 kPa to 3447 kPa (0 psia to 500 psia)	± 3.4 kPa (± 0.5 psi)
Temperature	-26.1 °C to 93.3 °C (-15 °F to 200 °F)	± 0.3 °C (± 0.5 °F)
Temperature Difference	0 °C to 27.8 °C (0 °F to 50 °F)	± 0.3 °C (± 0.5 °F)
Barometric Pressure	0 mm Hg to 1270 mm Hg (0 in Hg to 50 in Hg)	± 0.34 mm Hg (± 0.0135 in Hg)
Dew-point Temperature	0 °C to 50 °C (32 °F to 122 °F)	± 0.2 °C (± 0.4 °F)
Pressure Difference	0 Pa to 1244 Pa (0 in H ₂ O to 5 in H ₂ O)	± 24.4 Pa (± 0.098 in H ₂ O)
Mass Flow	0 kg/h to 544.3 kg/h (0 lb/h to 1200.0 lb/h)	± 1 %
Evaporator Capacity	5.56 kW to 14.4 kW (19 kBtu/h to 49 kBtu/h)	± 3 % to ± 7 %

3.3: Tests conditions and procedure

Each evaporator coil was tested at the air volumetric flow rate that was used during mixed system tests carried out at an independent testing laboratory for the ARI certification program. For all tests, constant indoor conditions of 16.7 °C (80.0 °F) dry-bulb and 15.8 °C (60.4 °F) dew-point temperatures were applied according to ARI Standard 210/240 (2003).

On the refrigerant side, the tests were constrained by the refrigerant inlet condition, defined by the liquid line temperature and subcooling, and the outlet condition, defined by the vapor line saturation temperature and superheat. The tests of each evaporator involved three vapor suction line saturation temperatures. The evaporator capacity line was generated as a function of the evaporator exit saturation temperature from these points. Table 3.3.1 lists the refrigerant conditions imposed during the evaporator tests for all coils.

Table 3.3.1: Refrigerant conditions during evaporator tests

Liquid line		Vapor line	
Temperature °C (°F)	Subcooling °C (°F)	Sat. temperature* °C (°F)	Superheat °C (°F)
40.6 \pm 0.8 (105.0 \pm 1.5)	5.6 to 8.3 (10.0 to 15.0)	4.4, 7.2, 10.0 (40.0, 45.0, 50.0)	5.6 to 8.3 (10.0 to 15.0)

*Three nominal conditions

The expansion devices supplied with the various evaporators were removed and replaced by precision needle valves. The liquid line temperature and subcooling, and evaporator superheat were controlled by adjusting the refrigerant charge and by changing the needle valve settings to produce the required superheat at the exit of the evaporator. In addition to compressor speed

control, an evaporator pressure regulating valve was used to produce the desired exit pressure. Liquid line temperature at the inlet to the expansion valves was also controlled by varying the water flow rates through the liquid cooled subcooler and condensing unit heat exchangers. At least five tests were performed for each evaporator. If the evaporator was equipped with a fan, its power was also measured and recorded for each test.

3.4: Evaporator capacity curve fits and characterization

Figures 3.4.1 through 3.4.9 present measured coil capacities, excluding fan heat when a fan was used, as a function of the coil outlet saturation temperature. The figures also include a linear fit to capacity data obtained for each evaporator and the fit coefficients. Examination of the figures indicates that a linear capacity fit is an adequate representation of the measured data. Table 3.4.1 summarizes the cooling capacity linear slopes and intercepts. Appendix C gives detailed data summaries of the tests performed for each coil.

We may note that the presented evaporator test data – including the performance lines – refers to the evaporator exit saturation temperature. The CD Unit curves also use the evaporator exit saturation temperature to calculate cooling capacity; i.e., they include the effect of refrigerant pressure drop and heat transfer in the suction line.

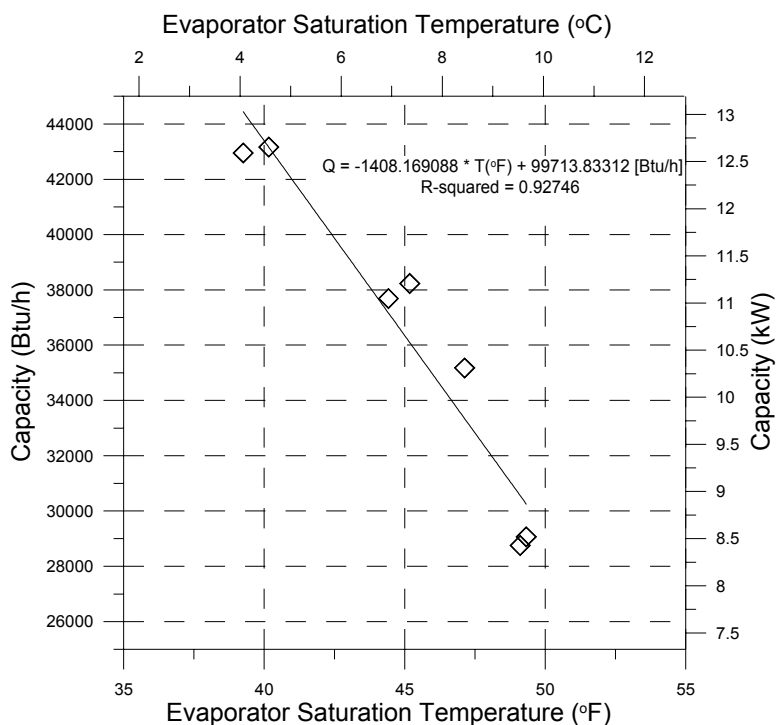


Figure 3.4.1: Coil 1 cooling capacity as a function of outlet saturation temperature

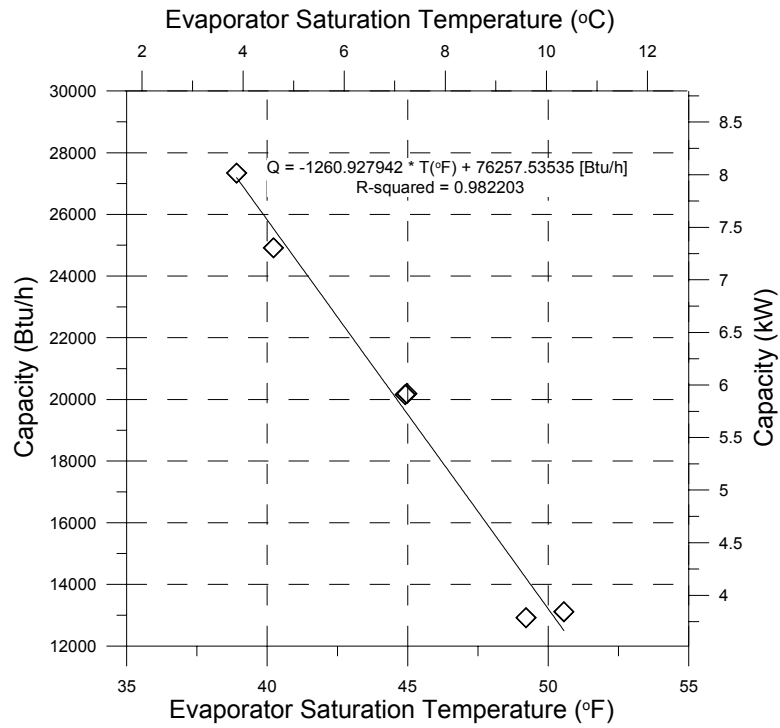


Figure 3.4.2: Coil 2 cooling capacity as a function of outlet saturation temperature

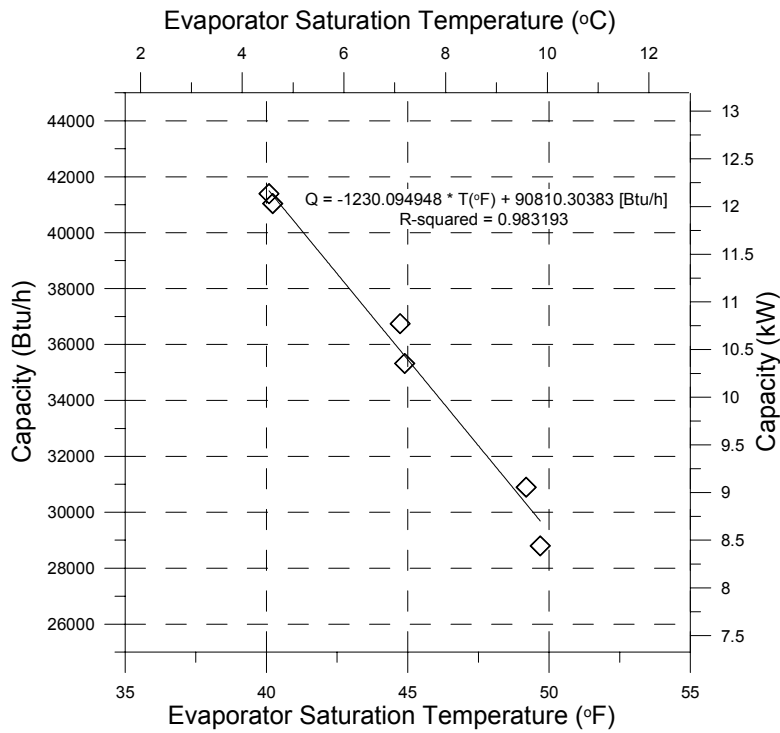


Figure 3.4.3: Coil 3 cooling capacity as a function of outlet saturation temperature

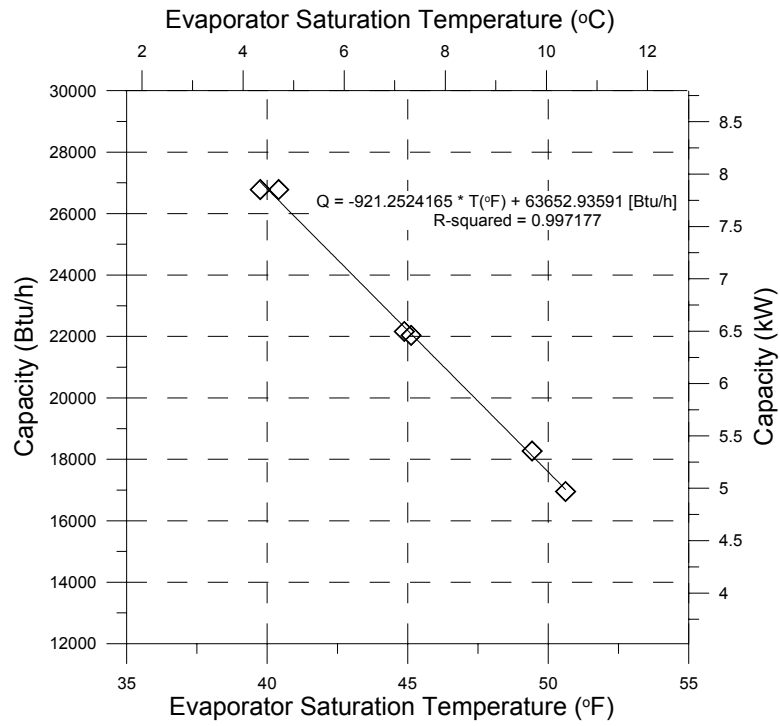


Figure 3.4.4: Coil 4 cooling capacity as a function of outlet saturation temperature

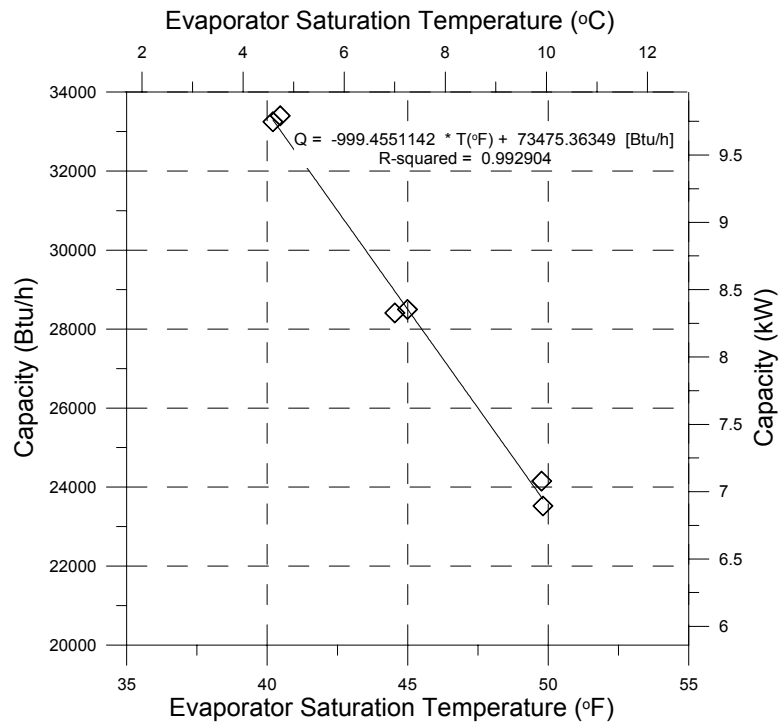


Figure 3.4.5: Coil 5 cooling capacity as a function of outlet saturation temperature

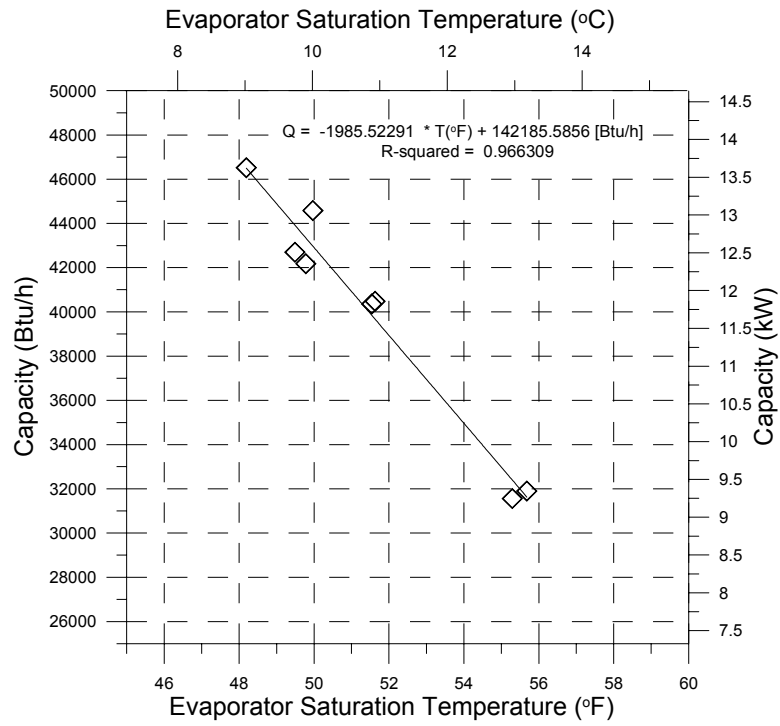


Figure 3.4.6: Coil 6 cooling capacity as a function of outlet saturation temperature

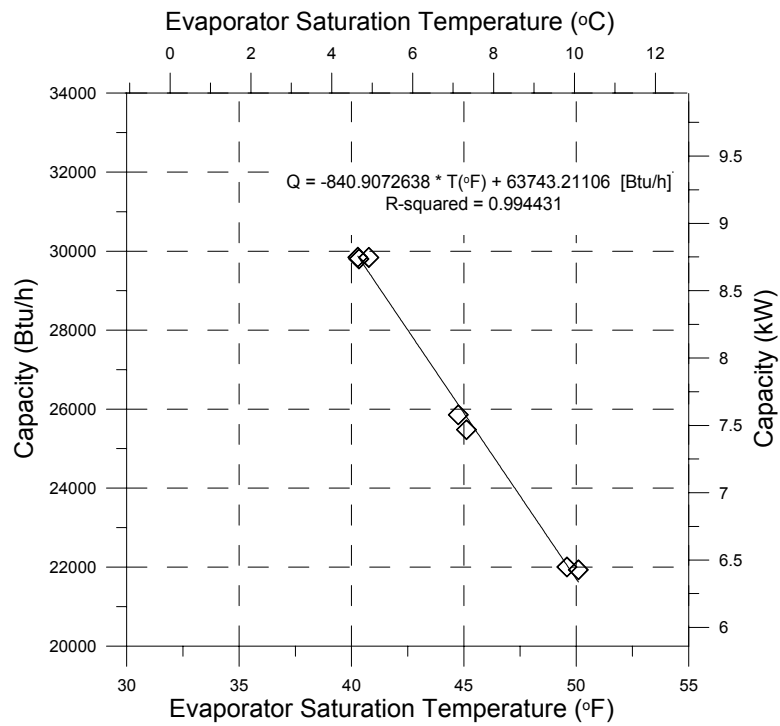


Figure 3.4.7: Coil 7 cooling capacity as a function of outlet saturation temperature

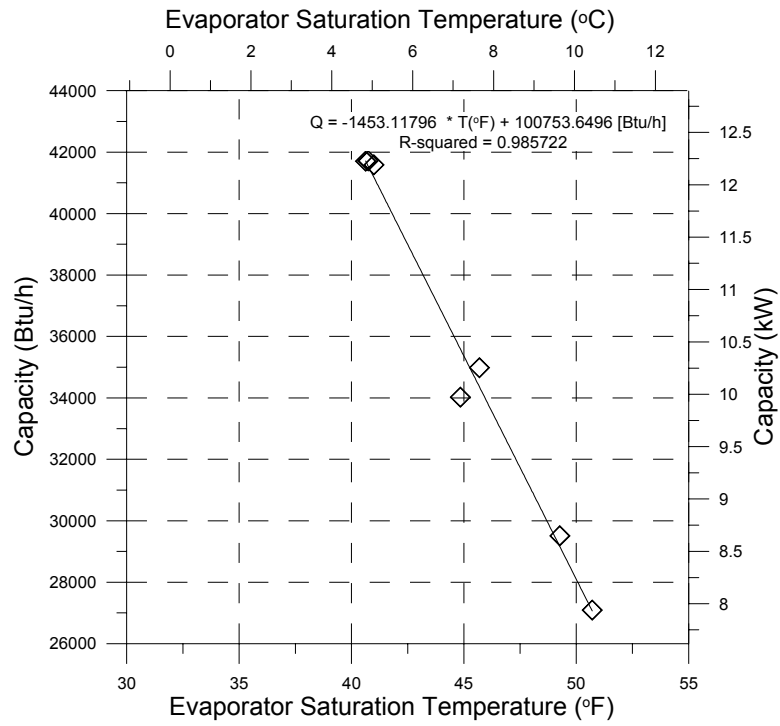


Figure 3.4.8: Coil 8 cooling capacity as a function of outlet saturation temperature

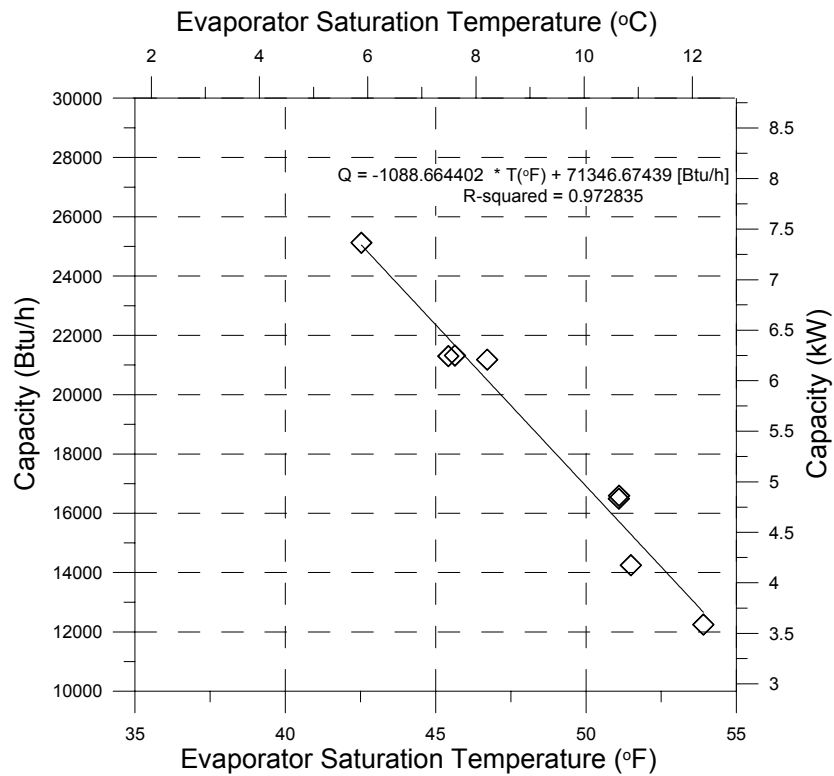


Figure 3.4.9: Coil 9 cooling capacity as a function of outlet saturation temperature

Table 3.4.1: Mixed evaporator capacity linear fit coefficients and fan powers from NIST coil tests

Coil Number	Evaporator Airflow m ³ /h (scfm)	Fan Power W	Cooling Capacity Linear Coefficients	
			Slope W/°C (Btu/h·°F)	Intercept W (Btu/h)
1	1699 (1000)	0	-742.8 (-1408.17)	29223.85 (99713.83)
2	1368 (805)	0	-665.1(-1260.93)	22348.89 (76257.54)
3	1621 (954)	0	-648.9 (-1230.09)	26613.89 (90810.3)
4*	1342 (790)	0	-486.0 (-921.25)	18654.84 (63652.94)
5	1279 (753)	271	-527.2 (-999.46)	21533.51 (73475.36)
6	1954 (1150)	784	-1047.4 (-1985.52)	41670.51 (142185.6)
7	2047 (1205)	0	-443.6 (-840.91)	18681.3 (63743.21)
8	2360 (1389)	0	-766.6 (-1453.12)	29527.99 (100753.65)
9	849 (500)	364	-574.3 (-1088.66)	20909.65 (71346.67)

* Coil 4 airflow was too high and results cannot be compared directly to ARI tests

Figures 3.4.10 thru 3.4.12 help to characterize and contrast the performance of the nine evaporators with respect to one another. Figure 3.4.10 shows the cooling capacity of each coil as a function of the evaporator saturation temperature generated from the capacity linear fits at an evaporator temperature of 7.2 °C (45 °F). The plot indicates the relative values of a change in capacity with respect to a change in evaporation temperature (slope) for each coil.

Figure 3.4.11 presents the airflow rate per unit of capacity for all coils, which is an indication of air temperature change across the coil. These values are from NIST tests at an evaporator saturation temperature of 10 °C (50 °F). All NIST tests were intended to be performed at the ARI Test airflow rates. Inadvertently, Coil 4 airflow was 262 m³/h (154 scfm) higher than the ARI Tests. Consequently, NIST capacity measurements and predictions for Coil 4 were significantly higher (approximately 24 %) than would have been the case with correct lower airflow rate. The results for Coil 4 have been included in this report, but they cannot be directly compared with the ARI Tests. The airflow rates at the other tests differed from the ARI Test values on average by 0.14 % with a standard deviation of 1.8 %. The average airflow rate per unit cooling capacity was 0.1852 m³/W h (383.5 scfm/ton) with a standard deviation of 0.0518 m³/W h (107.1 scfm/ton). Coil 6 had the smallest airflow rate per unit capacity [0.1261 m³/W h (262 scfm/ton)] as well as the largest change in cooling capacity with respect to a change in evaporator saturation temperature (see Figure 3.4.10). Coil 6 also had the lowest sensible heat ratio (SHR) of 0.710 (Fig. 3.4.12). Fig. 3.4.12 shows a linear trend of SHR with respect to airflow rate per unit capacity, which is consistent with general experience. The high sensible heat ratios were due to the high evaporating temperature of 10 °C (50 °F). At the lowest evaporating temperatures tested at NIST, the highest SHR's occurred for Coils 2, 7, and 8 with values of 0.77, 0.81, and 0.78, respectively. All other coils had SHR's less than 75 % at the lowest tested evaporating temperature.

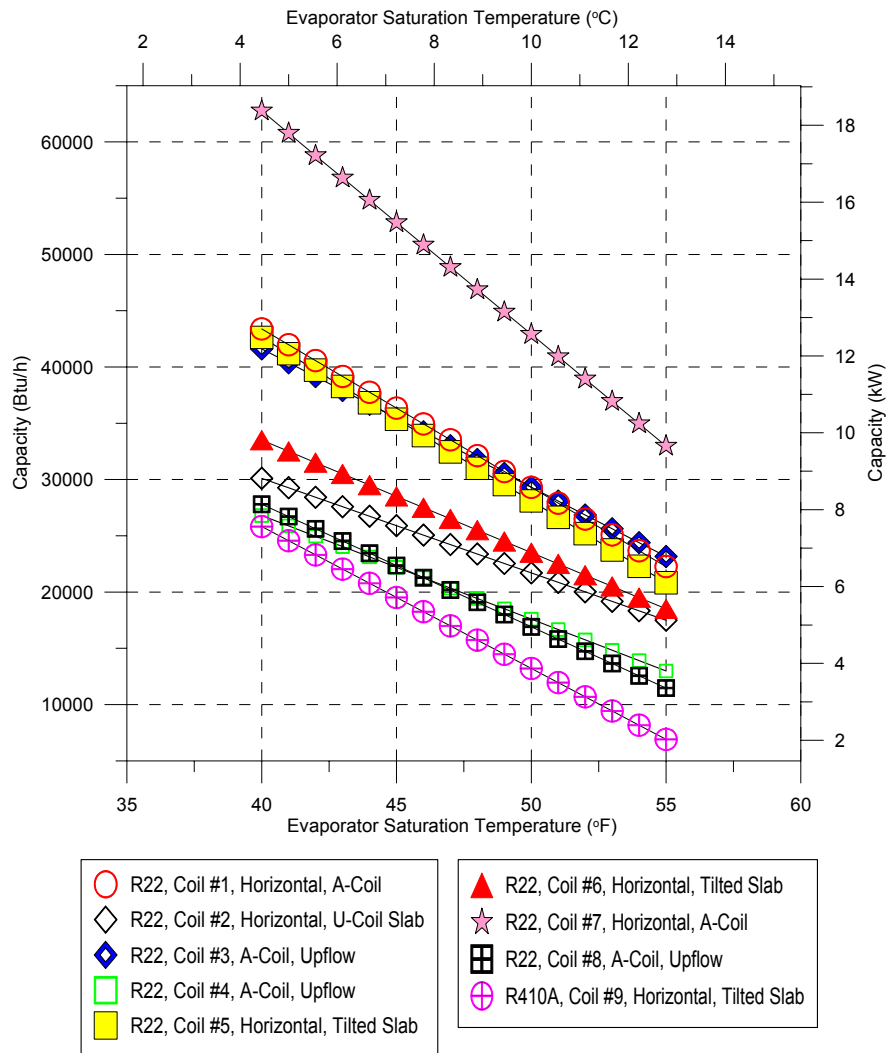


Figure 3.4.10: Cooling capacity, $q(95)$, for all evaporators based on the NIST linear fit

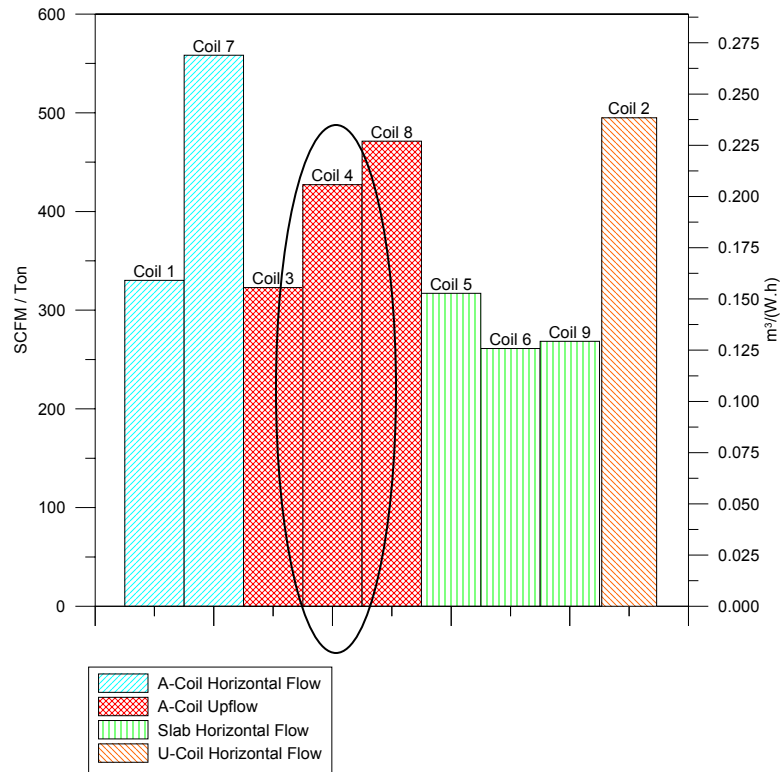


Figure 3.4.11: Airflow rate relative to cooling capacity from the NIST linear fit for all coils at an evaporation temperature of 7.2 °C (45 °F)

(Note: Coil 4 airflow was too high and results cannot be compared directly to ARI tests)

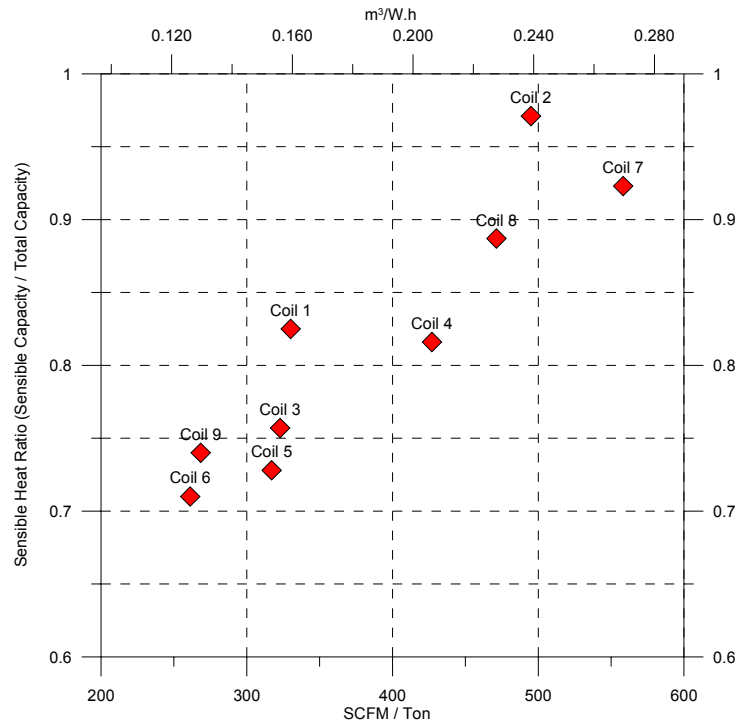


Figure 3.4.12: NIST measured SHR as a function of airflow rate per unit of cooling capacity at an evaporator exit saturation temperature of 16.2 °C (50.0 °F)

4: MIXED SYSTEM PERFORMANCE PREDICTION

4.1: Calculation of Q(95), Q(82) and EER(82)

With the coil capacity coefficients from Table 3.4.1 and CD Unit capacity coefficients from Table 4.1.1, the C-B Method was used to calculate cooling capacity and EER at 27.8 °C (82.0 °F), and cooling capacity at 35.0 °C (95.0 °F) for all coils.

Table 4.1.1: CD Unit linear coefficients for power and capacity at A-Test and B-Test conditions from ARI

Coil	q(82)		p(82)		q(95)		p(95)	
	Slope W/°C (Btu/h °F)	Intercept W (Btu/h)	Slope W/°C (W/°F)	Intercept W	Slope W/°C (Btu/h °F)	Intercept W (Btu/h)	Slope W/°C (W/°F)	Intercept W
1	312.7 (592.7)	2092.9 (7141.5)	7.38 (4.1)	2340.0	300.2 (569.1)	2217.7 (7567.0)	5.76 (3.2)	2717.1
2	184.7 (350.2)	2979.2 (10165.6)	31.14 (17.3)	1242.9	163.2 (309.3)	2785.3 (9503.9)	35.64 (19.8)	1289.6
3	312.7 (592.7)	2092.9 (7141.5)	7.38 (4.1)	2340.0	300.2 (569.1)	2217.7 (7567.0)	5.76 (3.2)	2717.1
4*	237.1 (449.5)	-622.6 (-2124.6)	22.14 (12.3)	880.9	232.2 (440.2)	-1253.0 (-4275.5)	26.1 (14.5)	877.7
5	266.2 (504.7)	674.2 (2300.5)	32.22 (17.9)	1177.1	263.3 (499.2)	22.7 (77.3)	38.7 (21.5)	1069.6
6	581.6 (1102.5)	3886.6 (13261.7)	28.98 (16.1)	3584.9	564.6 (1070.2)	2995.4 (10220.7)	32.94 (18.3)	4123.4
7	484.1 (917.6)	-148.4 (-506.2)	31.68 (17.6)	2253.8	508.6 (964.1)	-2569.6 (-8767.8)	38.34 (21.3)	2278.8
8	96.8 (735.5)	3140.6 (10716.2)	138.24 (76.8)	36.4	336.6 (638)	3420.9 (11672.7)	172.8 (96)	-697.3
9	286.6 (543.2)	984.7 (3359.9)	10.8 (6.0)	1692.8	278.5 (528.0)	423.0 (1443.2)	11.52 (6.4)	1990.9

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests

The calculation procedure, which we illustrated graphically in Figure 1.1, was implemented computationally by solving the set of two linear equations for the evaporation temperature at which the cooling capacity of the mixed coil equals the cooling capacity of the CD Unit:

$$q_{CD} = B_{CD} + A_{CD} T_{\text{evap}} = q_{\text{mixed}} = B_{\text{mixed}} + T_{\text{evap}} A_{\text{mixed}} \quad 4.1.1$$

$$T_{\text{evap}} = \frac{(B_{\text{mixed}} - B_{CD})}{(A_{CD} - A_{\text{mixed}})} \quad 4.1.2$$

In the equations above, B represents the intercept and A represents the slope for the CD Unit (CD subscript) and mixed evaporator (mixed subscript), respectively. Applying the obtained value of the saturation temperature into either capacity equation yields the capacity of the evaporator of the mixed system. The rated cooling capacity of the mixed system was obtained by reducing the evaporator capacity by the fan heat. For coils equipped with a fan, the fan heat was measured; for other coils it was calculated according to ARI Standard 210/240 (ARI 2003).

$$Q = q + Q_{\text{fan}} \quad 4.1.3$$

Similarly, the power of the mixed system was obtained by applying the value of the evaporator saturation temperature from equation 4.1.2 into the condensing unit power equation 4.1.4 and making adjustment for the indoor fan power as shown in equation 4.1.5.

$$p_{CD} = b_{CD} + a_{CD}T_{evap} \quad 4.1.4$$

$$P_{CD} = p_{CD} + P_{fan} \quad 4.1.5$$

Table 4.1.2 shows the results for A-Test mixed system capacities. Table 4.1.3 presents the results for B-Test capacity, power, and EER.

Table 4.1.2: Mixed system A-Test capacity from the C-B Method

Coil	T_{evap} °C (°F)	$q(95)$ W (Btu/h)	Indoor Airflow m^3/h (scfm)	$Q_{fan}^{(1)}$ W (Btu/h)	$Q(95)$ W (Btu/h)
1	8.1 (46.6)	9990 (34089)	1699 (1000)	366.3 (1250.0)	9624 (32839)
2	5.8 (42.5)	6639 (22653)	1368 (805)	294.9 (1006.3)	6344 (21647)
3	7.9 (46.3)	9935 (33898)	1621 (954)	349.5 (1192.5)	9585 (32705)
4*	9.9 (49.9)	5184 (17688)	1342 (790)	289.4 (987.5)	4894 (16700)
5	9.4 (49.0)	7188 (24526)	1279 (753)	271.0 (925.5)	6917 (23601)
6	6.2 (43.2)	16541 (56439)	1954 (1150)	784.0 (2677.5)	15756 (53761)
7	4.5 (40.2)	8781 (29962)	2047 (1205)	441.5 (1506.3)	8340 (28456)
8	5.9 (42.6)	11386 (38851)	2360 (1389)	507.0 (1736.3)	10877 (37115)
9	6.2 (43.2)	7114 (24274)	849 (500)	364.0 (1243.1)	6749 (23030)

(1) For units with no fan Q_{fan} was calculated to be 1250 Btu/h per 1000 scfm of airflow (ARI 210/240-2003).

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests

Table 4.1.3: Mixed system B-Test capacity, power, and EER from the C-B Method

Coil	T_{evap} °C (°F)	$q(82)$ W (Btu/h)	$p_{CD}(82)$ W	Indoor Airflow, m ³ /h (scfm)	$Q_{fan}^{(1)}$ W (Btu/h)	$P_{fan}^{(2)}$ W	$Q(82)$ W, (Btu/h)	EER(82) W/W (Btu/W h)
1	7.93 (46.3)	10192 (34563)	2530	1699 (1000)	365.0 (1250.0)	365.0	9763 (33313)	3.37 (11.51)
2	5.01 (41.0)	7190 (24532)	1953	1368 (805)	293.8 (1006.3)	293.8	6895 (23525)	3.07 (10.47)
3	7.72 (45.9)	10066 (34347)	2528	1621 (954)	348.2 (1192.5)	348.2	9717 (33155)	3.38 (11.53)
4*	8.88 (48.0)	5699 (19445)	1471	1342 (790)	288.4 (987.5)	288.4	5410 (18458)	3.07 (10.49)
5	8.51 (47.3)	7666 (26182)	2024	1279 (753)	271 (924.7)	271.0	7402 (25258)	3.27 (11.01)
6	5.42 (41.7)	17361 (59291)	4257	1954 (1150)	784 (2675.0)	784.0	16593 (56616)	3.29 (11.23)
7	2.52 (36.5)	9677 (33019)	2897	2047 (1205)	439.8 (1506.3)	439.8	9236 (31513)	2.77 (9.44)
8	5.11 (41.1)	12009 (40974)	3196	2360 (1389)	507.0 (1736.3)	507.0	11500 (39238)	3.11 (10.6)
9	5.37 (41.7)	7610 (25991)	1943	849 (500)	364 (1241.9)	364.0	7253 (24749)	3.14 (10.73)

(1) For units with no fan Q_{fan} is calculated to be 1250 Btu/h per 1000 scfm of airflow (ARI 210/240-2003).

(2) For units with no fan P_{fan} is calculated to be 365 W per 1000 scfm of airflow (ARI 210/240-2003).

Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

4.2: Calculation of SEER

The calculation of SEER involves the value of EER(82) and the cyclic degradation coefficient C_D .

$$SEER = (1 - 0.5 \cdot C_D) EER(82) \quad 1.2$$

For the tested systems, C_D was typically obtained by conducting dry-coil steady-state and cyclic tests (C and D tests of ARI Standard 210/240, (ARI 2003)). Alternatively, the rater may use the 0.25 default value instead of performing the tests. In practice, C_D values fall between 0.0 and 0.25. Since, by definition, the mixed system is not tested, the C_D value must be obtained from some engineering analysis or the default value of 0.25 must be taken.

Dougherty (2004), working with DOE and ARI, performed a statistical analysis of experimentally determined C_D values for a large sample of systems. He grouped the studied systems into four basic categories shown in Table 4.2.1. The analysis of C_D values for these four system categories produced the C_D percentiles shown in Table 4.2.2.

Table 4.2.1: System classifications for cyclic degradation coefficient analysis

System Category	Equalize During Off Cycle	Indoor Fan Off Delay	System Components
A	Yes	No	Cap Tube Orifice Bleed TXV
B1	No	No	Non-Bleed TXV Electronic Expansion Device Liquid Line Solenoid
B2	Yes	Yes	Cap Tube Orifice Bleed TXV
C	No	Yes	Non-Bleed TXV Electronic Expansion Device Liquid Line Solenoid

The range of C_D values is rather significant in each equipment category. In category A, for example, the classification for all nine mixed systems tested for this project, the difference between the 50th and 99th percentiles is $0.24-0.09=0.15$. This means that assuming the 50th percentile value for the mixed system with an actual C_D of 0.24 will result in a SEER prediction error of 7.5 %. For illustration in Table 4.2.3, we generated two SEER numbers for mixed systems using C_D values of 0.22 and 0.24, which correspond to the 95th and 99th percentiles, respectively. While both choices are conservative statistically, they still represent a risk of SEER overprediction by 1.5 % and 0.5 %, respectively, should the actual C_D value be the maximum of 0.25. We believe that the most accurate assignment of C_D for the mixed system would be that of the matched system if the changes implemented in the mixed system do not move it to a different equipment category, as defined in Table 4.2.1.

Table 4.2.2: Cyclic degradation coefficient values for different system categories

Percentile	A	B1	B2	C
99 th	0.24	0.16	0.22	0.15
95 th	0.22	0.14	0.14	0.12
90 th	0.16	0.14	0.12	0.10
85 th	0.14	0.12	0.11	0.09
80 th	0.12	0.12	0.10	0.08
75 th	0.12	0.11	0.10	0.07
70 th	0.11	0.11	0.09	0.06
60 th	0.10	0.9	0.08	0.05
50 th	0.09	0.07	0.07	0.04
Sample Size	77	58	109	78

Table 4.2.3: Mixed system SEERs calculated using statistically determined C_D for 95th and 99th percentiles

Coil	Cyclic Degradation Coefficient, C_d		SEER (Btu/W·h)	
	95 th	99 th	95 th	99 th
1	0.22	0.24	10.24	10.13
2	0.22	0.24	9.32	9.22
3	0.22	0.24	10.26	10.14
4*	0.22	0.24	9.34	9.23
5	0.22	0.24	10.08	9.97
6	0.22	0.24	10.33	10.21
7	0.22	0.24	8.41	8.31
8	0.22	0.24	9.43	9.32
9	0.22	0.24	9.89	9.78

Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

5: NIST PREDICTIONS AND ARI DATABASE COMPARISON

5.1: A-Test capacity comparison

Table 5.1.1 and Figure 5.1.1 present mixed system capacities, $Q(95)$, from the C-B Method and the ARI database for the A-Test conditions. Capacity predictions from the C-B Method were within $\pm 5\%$ of the ARI tests for five of eight coils. Among the three cases with poor predictions, the disagreement was as high as 17.6 %.

Table 5.1.1: Mixed system A-Test capacities from ARI Tests and C-B Method

Coil	C-B Method T_{evap} °C (°F)	ARI Test T_{evap} °C (°F)	C-B Method $q(95)$ W (Btu/h)	Indoor Airflow m^3/h (scfm)	Q_{fan} W (Btu/h)	ARI Test $Q(95)$ W (Btu/h)	C-B Method $Q(95)$ W (Btu/h)	Q_{diff} 100%(NIST – ARI)/ARI
1	8.1 (46.6)	7.2 (45.0)	9991 (34089)	1699 (1000)	366.3 ⁽¹⁾ (1250.0)	10034 (34238)	9624 (32839)	-4.1
2	5.8 (42.5)	6.1 (43.0)	6639 (22653)	1368 (805)	294.9 ⁽¹⁾ (1006.3)	6529 (22278)	6344 (21647)	-2.8
3	7.9 (46.3)	7.6 (45.6)	9935 (33898)	1621 (954)	349.5 ⁽¹⁾ (1192.5)	9609 (32786)	9585 (32705)	-0.2
4*	9.9 (49.9)	8.4 (47.2)	5184 (17688)	1342 (790)	289.4 ⁽¹⁾ (987.5)	5073 (17311)	4894 (16700)	-3.5
5	9.4 (49.0)	10.5 (50.9)	7188 (24526)	1279 (753)	271.0 ⁽¹⁾ (925.5)	6787 (23157)	6917 (23601)	1.9
6	6.2 (43.2)	7.2 (44.9)	16541 (56439)	1954 (1150)	784.0 ⁽²⁾ (2677.5)	14407 (49159)	15756 (53761)	9.4
7	4.5 (40.2)	6.8 (44.3)	8781 (29962)	2047 (1205)	441.5 ⁽²⁾ (1506.3)	10122 (34537)	8340 (28456)	-17.6
8	5.9 (42.6)	5.7 (42.2)	11387 (38851)	2360 (1389)	507.0 ⁽¹⁾ (1736.3)	12591 (42963)	10878 (37115)	-13.6
9	6.2 (43.2)	4.1 (44.2)	7114 (24274)	849 (500)	364 ⁽²⁾ (1243.1)	6480 (22112)	6749 (23030)	4.2

⁽¹⁾ Coil without a fan; Q_{fan} was calculated to be 1250 Btu/h per 1000 scfm of airflow (ARI 210/240-2003)

⁽²⁾ Coil equipped with a fan; fan power measured by NIST

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

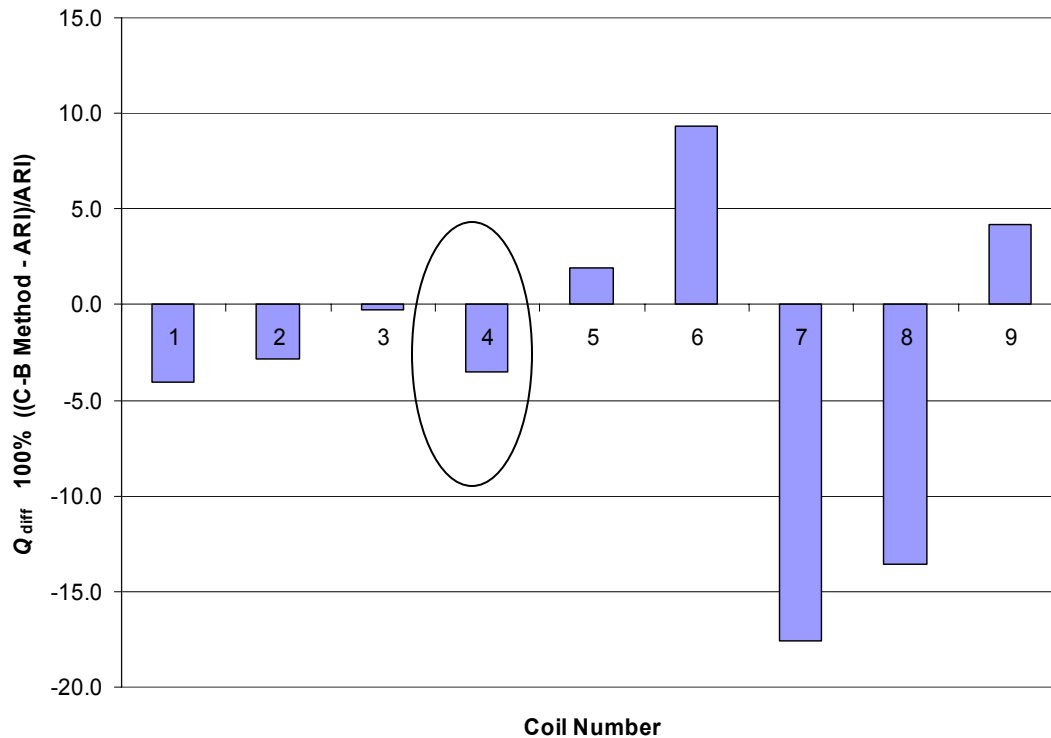


Figure 5.1.1: Comparison of mixed system A-test capacities from the ARI tests and the C-B Method

(Note: Coil 4 airflow was too high and results cannot be compared directly to ARI tests)

Table 5.1.1 also shows evaporator saturation temperatures obtained from the C-B Method and measured during mixed system certification tests. Ideally, these temperatures should be the same or very close for good capacity predictions. One can rationalize that a saturation temperature from the C-B Method that is lower than that from the certification tests should result in an overprediction of capacity while a higher C-B Method saturation temperature should drive toward the opposite effect. This physical rationale holds somewhat for Coils 1, 5, and 6, while other coils do not conform. In particular, Coil 7, associated with the largest underprediction of $Q(95)$ of 17.6 % has a 4.5 °C (40.2 °F) C-B Method saturation temperature versus a 6.8 °C (44.3 °F) saturation temperature measured during certification tests.

To further explore the reasons for inconsistent $Q(95)$ predictions, we compared test-obtained mixed system $Q(95)$ capacities with those calculated for mixed evaporators from NIST-developed capacity lines and those calculated for condensing units from condensing performance curves using the same evaporator saturation temperature as measured during the mixed system certification tests. Table 5.1.2 presents the data. It is desirable for these three capacities to be close, ideally equal, to each other. The table shows that NIST-calculated capacities agreed with the certification test capacities for Coils 1, 3, 6, and 9 within ± 2.5 %, which is a remarkable agreement. The capacities for coils 2 and 5 are underpredicted within 6.5 %. The largest disagreement of -27.6 % is for Coil 7. For condensing unit capacities, the

agreement with mixed system data was within ± 6.5 % for six cases. In the remaining cases, the deviations from mixed system capacities were as much as -14.2 %.

Looking back at the predicted $Q(95)$ presented in Table 5.1.1, we can see that we obtained good predictions of $Q(95)$ in every case where the capacities from three sources shown in Table 5.1.2 are in good agreement (Coils 1, 2, 3, and 9). Also good $Q(95)$ predictions are for Coil 5 in Table 5.1.1; in this case the capacity calculated from evaporator and condensing unit correlations in Table 5.1.2 underpredicted and overpredicted the mixed system capacity by a similar percentage. The result is a good prediction of $Q(95)$ at a somewhat different evaporator saturation temperature than that measured during a system test.

In the cases with the largest $Q(95)$ prediction errors, Coils 6, 7 and 8, no offsetting of errors took place; even for Coil 8 where the C-B Method predicted the evaporator saturation temperature within 0.2 °C (0.4 °F). Since evaporator capacity and mixed system capacity for Coil 6 in Table 5.1.2 agree within 2.5 % while the condensing unit capacity deviates by 13.1 %, a suggestion can be made that the condensing unit correlation could be faulted for the $Q(95)$ underprediction. Using the same rationale, a case against the evaporator capacity correlation could be made for Coil 7. For Coil 8, the evaporator and condensing unit correlations yield similar capacities and disagree with the system test data by a similar capacity percentage, -12.2 % and -14.2 %, respectively, suggesting some testing irregularity or an error in data handling.

Table 5.1.3 allows additional analysis of capacity predictions from the NIST-developed capacity lines. The table shows the tested mixed system capacities and those calculated using capacity lines (adjusted for the indoor fan heat) as presented in Table 5.1.2, but it includes temperature and subcooling of the refrigerant entering the expansion valve and the refrigerant superheat at the evaporator exit. Since values of these parameters are different for most cases, it was of interest to assess the extent to which these differences could affect the evaporator capacity predictions. For this purpose, we used the EVAP-COND simulation package (NIST 2003) to simulate coil performance at different inlet refrigerant temperatures and outlet superheats.

For example, for Coil 7, the ARI superheat was 2.4 °C (4.3 °F) and the NIST superheat was 7.3 °C (13.2 °F); a difference of 4.9 °C (8.9 °F). Keeping the same evaporator saturation temperature and liquid temperature (inlet quality), and changing the superheat to the ARI value increased the predicted Coil 7 capacity by 494 W (1686 Btu/h) to 7818 W ($26\,675$ Btu/h), thus reducing the percent difference from -27.6 % to -22.8 %. Changing the liquid temperature from 40.6 °C (105.1 °F) to the ARI value of 49.4 °C (120.9 °F) and keeping the same subcooling of 7.7 °C (13.8 °F), increased the capacity by an additional 222 W (758 Btu/h) to 8038 W ($27\,433$ Btu/h), thus reducing the ARI-NIST percent difference to -20.5 %. It appears that some installation and test condition related factors are responsible for the remaining -20.5 % deviation in the Coil 7 results.

Table 5.1.2: Mixed system A-Test capacities from the ARI tests, condensing unit capacities from CD Unit curves, and evaporator capacities from NIST-developed evaporator capacity curves at the ARI-test evaporating temperature^(1,2)

	Coil 1		Coil 2		Coil 3		Coil 4*		Coil 5		Coil 6		Coil 7		Coil 8		Coil 9	
	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h	W	Btu/h
ARI Value Q(95)	10034	34238	6529	22278	9609	32786	5073	17311	6787	23157	14407	49159	10122	34537	12591	42963	6480	22112
NIST Q(95)	10282	35083	6163	21029	9829	33536	5622	19183	6353	21679	14760	50363	7324	24989	11049	37702	6443	21984
CD Unit Q(95)	10338	35273	6388	21796	9475	32330	4548	15518	7198	24562	16294	55598	9508	32441	10804	36866	6899	23539
NIST/ARI %	2.5		-5.6		2.3		10.8		-6.4		2.5		-27.6		-12.2		-0.6	
CD Unit/ARI %	3.0		-2.2		-1.4		-10.4		6.1		13.1		-6.1		-14.2		6.5	

⁽¹⁾ Mixed system evaporating temperature, T_{evap} , is listed in Tables 5.1.1.

⁽²⁾ Indoor fan heat from the mixed system accounted for in all capacity calculations

⁽³⁾ $Q_{diff} = 100\% (NIST - ARI)/ARI$

⁽⁴⁾ $Q_{diff} = 100\% (CD Unit - ARI)/ARI$

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests

Table 5.1.3: Mixed system A-test capacities from ARI values and evaporator capacities from NIST-developed evaporator capacity curves at the ARI-test evaporating temperature⁽¹⁾

	Coil 1		Coil 2		Coil 3		Coil 4*		Coil 5		Coil 6		Coil 7		Coil 8		Coil 9	
	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST	ARI	NIST
$T_{liq}^{\circ}C$ ($^{\circ}F$)	37.2 (99.0)	40.7 (105.3)	41.1 (106.0)	40.5 (104.9)	35.2 (95.4)	40.5 (104.9)	42.2 (108.0)	40.7 (105.3)	40.3 (104.6)	40.4 (104.8)	40.3 (104.6)	40.4 (104.8)	49.4 (120.9)	40.6 (105.1)	39.1 (102.4)	40.9 (105.7)	40.8 (105.4)	40.6 (105.0)
$T_{sub}^{\circ}C$ ($^{\circ}F$)	6.9 (12.5)	6.2 (11.1)	11.8 (21.2)	6.6 (11.9)	7.7 (13.8)	7.7 (13.9)	13.8 (24.9)	7.6 (13.6)	7.7 (13.9)	7.7 (13.9)	6.4 (11.6)	7.7 (13.9)	6.7 (12.0)	7.7 (13.8)	11.1 (19.94)	7.1 (12.8)	5.9 (10.6)	7.6 (13.6)
$T_{evap}^{\circ}C$ ($^{\circ}F$)	7.2 (45.0)	7.2 (45.0)	6.1 (43.0)	6.1 (43.0)	7.6 (45.6)	7.6 (45.6)	8.4 (47.2)	8.4 (47.2)	10.5 (50.9)	10.5 (50.9)	7.2 (44.9)	7.2 (44.9)	6.8 (44.3)	6.8 (44.3)	5.7 (42.2)	5.7 (42.2)	6.8 (44.2)	6.8 (44.2)
$T_{suph}^{\circ}C$ ($^{\circ}F$)	6.2 (11.2)	7.1 (12.8)	4.7 (8.5)	8.1 (14.6)	11.6 (20.9)	7.4 (13.4)	2.1 (3.8)	7.4 (13.3)	0.8 (1.5)	7.8 (14.0)	7.1 (12.7)	7.6 (13.6)	2.4 (4.3)	7.3 (13.2)	3.9 (7.1)	7.4 (13.4)	6.2 (11.2)	7.8 (14.0)
Q, W (Btu/h)	10034 (34238)	10282 (35083)	6529 (22278)	6163 (21029)	9609 (32786)	9829 (33536)	5073 (17311)	5622 (19183)	6787 (23157)	6353 (21679)	14407 (49159)	14760 (50363)	10122 (34537)	7324 (24989)	12591 (42963)	11049 (37702)	6480 (22112)	6443 (21984)
$Q_{diff}(\%)$ ⁽²⁾	2.5		-5.6		2.3		10.8		-6.4		2.5		-27.6		-12.2		-0.6	

⁽¹⁾ Indoor fan heat from the mixed system accounted for in all capacity calculations

⁽²⁾ $Q_{diff} = 100\% (NIST - ARI)/ARI$

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests

5.2: B-Test EER comparison

Table 5.2.1 shows EER values from the ARI tests and the C-B Method. Coils 5 and 7 show an agreement within $\pm 5\%$. The C-B Method overpredicted the ARI values by more than 5% in four cases. System power, fan power, Q(82), and EER(82) were compared in Figure 5.2.1 to illustrate the sources of disagreement between the C-B Method and the ARI tests.

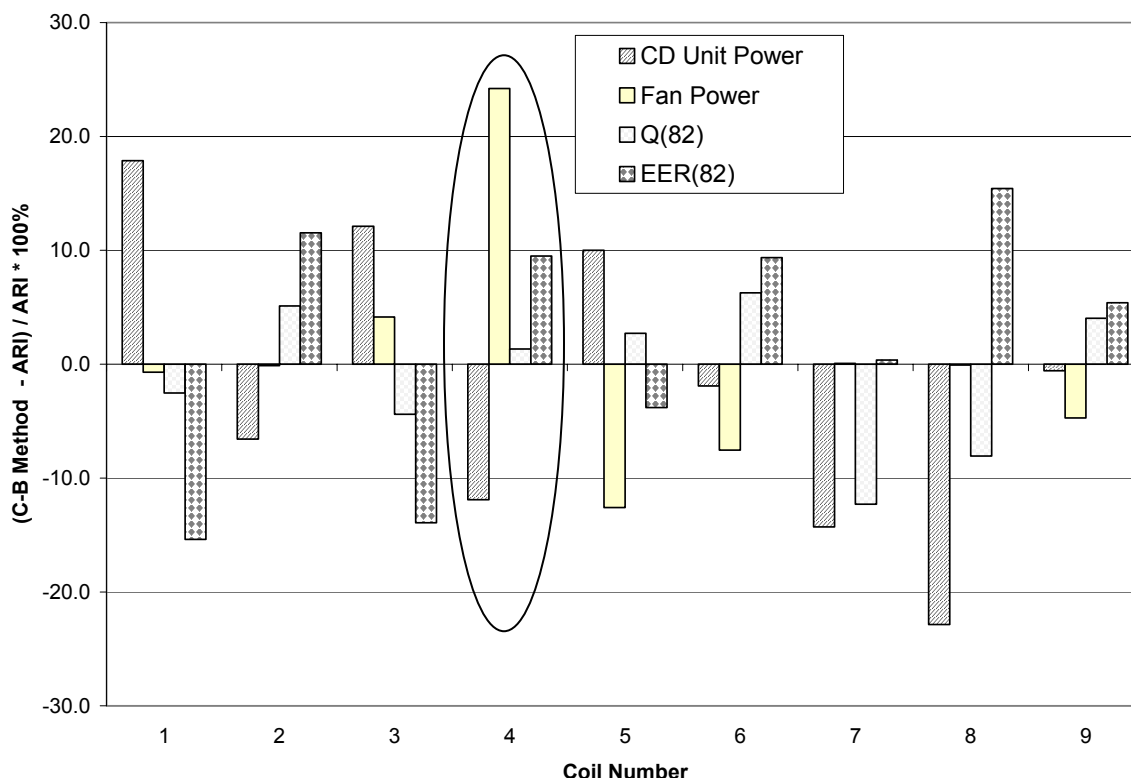


Figure 5.2.1: Percent differences between ARI Values and the C-B Method for the EER(82) calculation (Note: Coil 4 airflow was too high and results cannot be compared directly to ARI tests)

We may note that the largest EER disagreement was a 15.4% underprediction and a 15.4% over prediction for Coil 1 and Coil 8, respectively. For Coil 1 the 17.9% higher power and the 2.5% lower capacity caused the C-B Method EER(82) to be 15.4% lower than the ARI Test EER(82). Since the evaporator saturation temperatures were equal for this coil, the 400 W difference in ARI Test and CD Unit linear fit power is the main contributor to the EER(82) difference. If the ARI Test CD Unit power were used in the C-B Method calculation of EER(82), the percent difference in EER(82) would only be -2.4%.

Coil 8 had a 22.9% under prediction in CD Unit power compared to the ARI Test results. The C-B Method's lower power was not completely mitigated by a lower capacity, resulting in the EER(82) being 15.4% higher than the ARI Test EER(82). The lower evaporating temperature for the C-B Method would tend to produce a higher capacity than the ARI Test capacity, but this was not the case. According to the CD Unit capacity linear fit, a 1.3 °C (2.4 °F) lower evaporating temperature should increase capacity by 517 W (1765 Btu/h).

This does not equal the 1518 W (5179 Btu/h) difference between the C-B Method and ARI Test capacities. If the ARI Test value of power were used with the C-B Method capacity, the resulting EER(82) percent difference would be -8.1 %.

The C-B Method produced a 13.9 % underprediction of EER(82) for Coil 3. The ARI Test and C-B Method evaporating temperature were within 3.6 %. The CD Unit power and the ARI Test power differed by 12.1 %. The higher C-B Method power and the lower C-B Method capacity produced the 13.9 % lower EER(82). If the ARI Test power were used with the C-B Method capacity, the EER(82) difference would be -4.9 %.

From examining Table 5.2.1, the clear factor in EER(82) disagreement is the system power difference between actual tests and the power fits. This is true for all cases except Coil 7. For Coil 7, the evaporating temperatures differed by almost 19 %. The C-B Method's lower evaporating temperature should produce a higher capacity than the ARI Test evaporating temperature, but this was not the case. The lower evaporating temperature produced a 12.3 % lower capacity which was combined with a 14.3 % lower CD Unit power to produce an almost equivalent EER(82).

Table 5.2.1: Mixed system B-Test comparison of ARI tested and C-B Method results

Coil	T_{evap} °C (°F)			CD Unit Power W			Fan Power W			$Q(82)^c$ W (Btu/h)			EER(82) W/W (Btu/W h)		
	C-B Method	ARI Test	Difference (C-B Method - ARI)	C-B Method	ARI Test	Percent Diff %	C-B Method	ARI Test	Percent Diff %	C-B Method	ARI Test	Percent Diff %	C-B Method	ARI Test	Percent Diff %
1	7.94 (46.3)	7.94 (46.3)	0.0 (0.0)	2530	2146	17.9	365	368	-0.7	9763 (33313)	10017 (34178)	-2.5	3.37 (11.51)	3.99 (13.60)	-15.4
2	5.0 (41.0)	6.50 (43.7)	-1.5 (-2.7)	1953	2090	-6.6	294	294	-0.1	6895 (23525)	6559 (22381)	5.1	3.07 (10.47)	2.75 (9.39)	11.5
3	7.72 (45.9)	6.83 (44.3)	0.9 (1.6)	2528	2255	12.1	348	334	4.1	9717 (33155)	10164 (34680)	-4.4	3.38 (11.53)	3.92 (13.39)	-13.9
4 ^d	8.89 (48.0)	9.72 (49.5)	-0.8 (-1.5)	1471	1670	-11.9	288	232	24.2	5410 (18458)	5338 (18215)	1.3	3.07 (10.49)	2.81 (9.58)	9.5
5	8.50 (47.3)	9.67 (49.4)	-1.2 (-2.1)	2024	1840	10.0	271	310	-12.6	7402 (25258)	7207 (24591)	2.7	3.23 (11.01)	3.35 (11.44)	-3.8
6	5.39 (41.7)	6.50 (43.7)	-1.1 (-2.0)	4257	4340	-1.9	784 ^a	848 ^b	-7.5	16593 (56616)	15613 (53274)	6.3	3.29 (11.23)	3.01 (10.27)	9.4
7	2.50 (36.5)	7.22 (45.0)	-4.7 (-8.5)	2897	3380	-14.3	440 ^a	439 ^b	0.1	9236 (31513)	10529 (35926)	-12.3	2.77 (9.44)	2.76 (9.41)	0.4
8	5.06 (41.1)	6.39 (43.5)	-1.3 (-2.4)	3196	4143	-22.9	507	507	-0.1	11500 (39238)	12508 (42680)	-8.1	3.11 (10.60)	2.69 (9.18)	15.4
9	5.39 (41.7)	5.89 (42.6)	-0.5 (-0.9)	1943	1954	-0.6	364 ^a	382 ^b	-4.7	7253 (24749)	6972 (23790)	4.0	3.14 (10.73)	2.98 (10.18)	5.4

a) Fan power measured by NIST. b) Fan power measured by ARI contracted testing facility. c) $Q(82)$ included the fan heat correction for coils with no fan.

d) NIST airflow was 262 m³/h (154 scfm) higher than the ARI tested airflow for Coil 4.

5.3: SEER comparison

Table 5.3.1 presents SEER values from the ARI database and the C-B Method for the 99th percentile cyclic degradation coefficients. With the exception of Coil 6, where the predicted SEER exceeds the measured SEER by 0.6 %, the SEER values obtained from the C-B Method are lower than the measured values by as much as 27 %. Four C-B Method SEERs agreed to within ± 5 % of the measured SEERs. Figure 5.3.1 shows that this level of agreement can be attributed to offsetting errors between EERs and SEER/EER Multipliers, $(1-0.5 C_D)$, especially considering the large differences in cyclic degradation coefficient between the NIST 99th percentile and ARI database. These large differences in degradation coefficient indicate that more information is needed to accurately determine a representative C_D value. Clearly, the use of a fixed value for the degradation coefficient cannot reliably reproduce ARI database values.

Table 5.3.1: SEERs from ARI value and C-B Method

Coil	SEER from ARI values Btu/(W·h)	SEER from C-B Method using 99 th percentile C_D	SEER ⁽¹⁾ Diff %	ARI SEER/EER Multiplier ⁽²⁾ $(1-0.5 C_D)$	NIST 99 th Percentile SEER/EER Multiplier $(1-0.5 C_D)$	(ARI - NIST 99 th) SEER/EER Multiplier
1	13.87	10.13	-27.0	0.931	0.880	0.051
2	9.63	9.22	-4.3	0.983	0.880	0.103
3	13.33	10.14	-23.9	0.964	0.880	0.084
4*	9.79	9.23	-5.7	0.980	0.880	0.100
5	10.01	9.68	-3.3	0.876	0.880	-0.004
6	9.82	9.88	0.6	0.976	0.880	0.096
7	9.56	8.31	-13.1	0.977	0.880	0.097
8	10.17	9.32	-8.4	0.949	0.880	0.069
9	9.78	9.44	-3.5	0.961	0.880	0.081

⁽¹⁾ SEER Diff = $100\% (NIST - ARI)/ARI$

⁽²⁾ ARI SEER/EER multiplier was calculated from $SEER = (1-0.5 C_D)EER(82)$

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

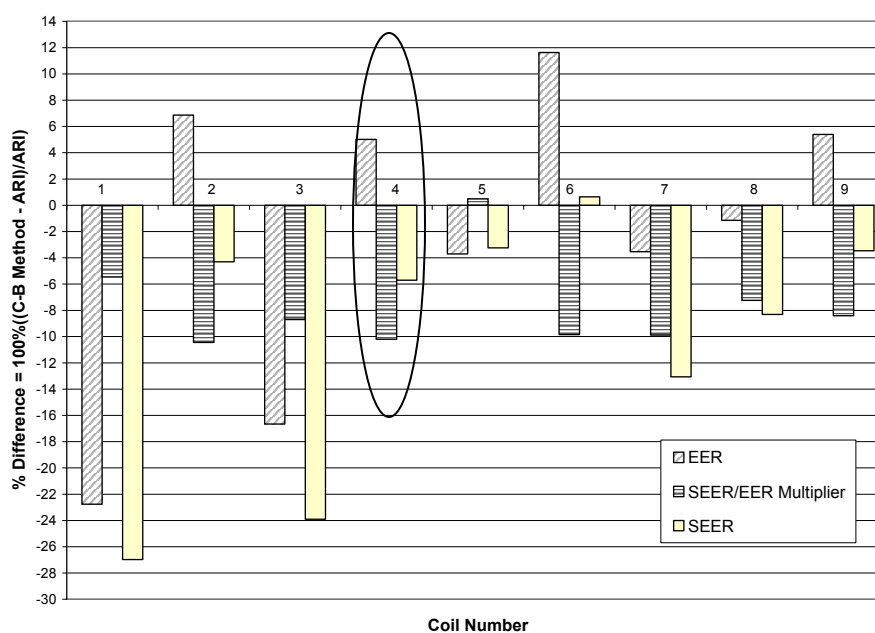


Figure 5.3.1: ARI Values and C-B Method SEER/EER Multiplier, EER, and SEER

6: GENERATING AN EVAPORATOR CAPACITY LINE USING EVAP-COND

In this study, we developed evaporator capacity lines based on measured capacities at several different evaporator exit saturation temperatures with constant superheat and inlet quality. Controlling these three parameters makes coil tests more time consuming than complete system tests. For this reason, we explored the possibility to minimize the laboratory effort by using an evaporator simulation model. A simulation model can be tuned to predict the measured capacity, which can then be used to provide capacities at other saturation temperatures needed to generate the evaporator capacity line. To demonstrate this approach, we used the EVAP-COND finned-tube heat exchanger simulation package (NIST 2003).

EVAP-COND uses coil design parameters (including refrigerant circuitry) and refrigerant and air parameters as input to calculate the capacity of the heat exchanger. The model allows the user to tune its prediction to experimental data by adjusting the correction factors for the air-side heat transfer coefficient, refrigerant-side heat transfer coefficient, and refrigerant-side pressure drop. In our case, we considered Coil 9 and selected appropriate values for these factors, shown in Table 6.1, so the model predictions agreed with the test results at the 7.4 °C (45.4 °F) saturation temperature. Simulations at additional saturation temperatures allowed generation of a linear capacity fit for the coil.

Table 6.1: EVAP-COND correction parameters for Coil 9

T_{evap} °C (°F)	R	ΔP	A	q Predicted W (Btu/h)	q Measured W (Btu/h)	q_{diff} %
7.4 (45.4)	1.15	2.00	1.30	6249 (21323)	6242 (21300)	0.1

R - refrigerant-side heat transfer coefficient correction factor

ΔP - refrigerant pressure drop correction factor

A - air-side heat transfer coefficient correction factor

$q_{diff} = 100\%(\text{Predicted}-\text{Measured})/\text{Measured}$

Figure 6.1 shows cooling capacities for Coil 9 from the laboratory measurements, the EVAP-COND simulations, and the corresponding capacity lines as a function of evaporating temperature. The capacity lines almost overlap. Consequently, the C-B Method performance predictions for mixed system using Coil 9 were within 0.5 % for the two capacity lines, as shown in Figure 6.2.

It is possible that the approach presented here could be extended to other evaporators that use the same air-side and refrigerant-side heat transfer surfaces; i.e., once EVAP-COND adjustable factors for air-side heat transfer, refrigerant-side heat transfer, and refrigerant pressure drop are determined for one coil, they could be applied to other coils using the same surfaces.

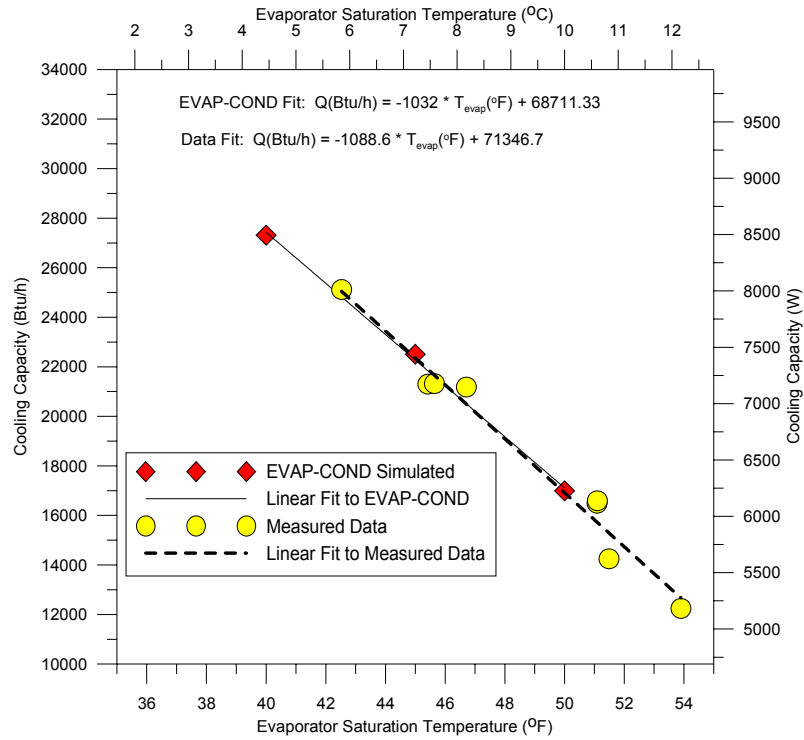


Figure 6.1: Coil 9 simulated and measured cooling capacity

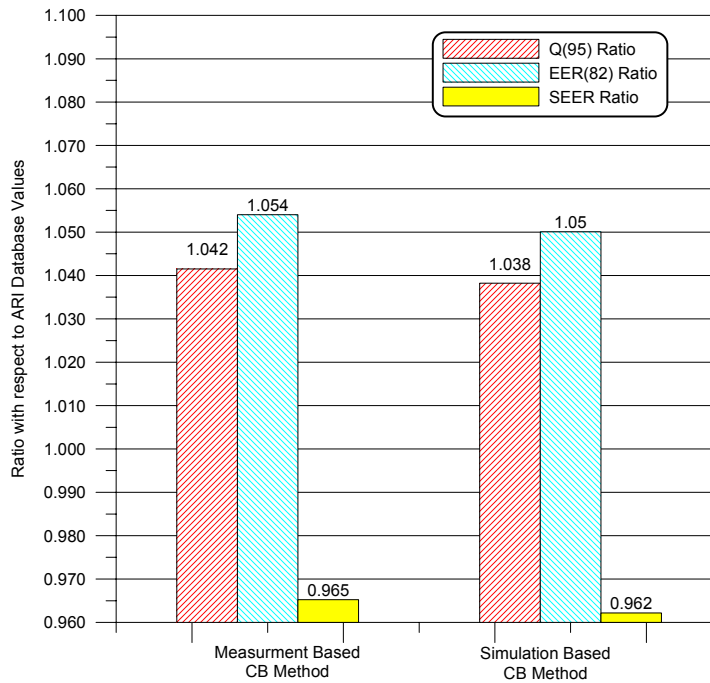


Figure 6.2: C-B Method Q(95), EER(82) and SEER ratio with respect to the ARI database using the measured and simulated Coil 9 capacity

7: UNCERTAINTY OF THE C-B METHOD

7.1: Uncertainty of the evaporator capacity linear fit

We used Coil 9 data as an example to evaluate the uncertainty of the evaporator capacity linear fit. This is the uncertainty that would result if someone used this linear fit to calculate capacity at a known evaporator temperature. The data set used to generate the linear fit consisted of 8 tests. A linear equation has two adjustable parameters; therefore, the fit had 6 degrees of freedom (DOF= $n-2$). Table 7.1.1 summarizes the linear fit parameters (slope and intercept) and related fit statistics.

Table 7.1.1: Coil 9 evaporator linear fit equation statistics

Correlation Coefficient R^2	DOF Adjusted R^2	Fit Standard Error, W (Btu/h)	F-Value	n = 8 data points DOF = $n-2$ = 6	
0.972835	0.961969	226.28 (772.093)	214.872		
Parameter	Value	Standard Error	t-value	95 % Confidence Limits on the Mean Value	
				Minimum	Maximum
B (intercept), W (Btu/h)	20909.6 (71346.5)	1058.35 (3611.22)	19.757	18309.1 (62473.4)	23510.1 (80219.6)
A (slope), W/°C (Btu/h °F)	-574.32 (-1088.7)	39.18 (74.27)	-14.659	-670.56 (-1271.2)	-478.0 (-906.2)
S_{xx}	108.0774				
Mean T_{evap}	9.2 (48.5)	Mean q	5440 (18562.8)		

At a 95 % confidence level, the linear intercept is equal to 20909.6 ± 2600.45 W (71346.5 \pm 8873.1 Btu/h), and the linear slope is equal to -574.32 ± 39.18 W/°C (-1088.7 \pm 182.5 Btu/h °F). The confidence bands are determined by subtracting the minimum 95 % limit from the maximum 95 % limit and dividing by two (or taking the fit standard error and multiplying by the appropriate t-value). With confidence limits as a percentage value, the linear intercept is 20909.6 W (71346.5 Btu/h) \pm 12.4 %, and the linear slope is -574.32 W/°C (-1088.7 Btu/h °F) \pm 16.8 %.

For capacity predictions using the linear correlation, the confidence interval for the mean value at a particular point is given by (Ott 1984):

$$\pm t \cdot \hat{\sigma} \sqrt{\frac{1}{n} + \frac{(x - \bar{x})^2}{S_{xx}}} \quad 7.1.1$$

where $\hat{\sigma} = \sqrt{\frac{SSE}{n-2}}$ = fit standard error

$$S_{xx} = \sum (x^2) - \frac{(\sum x)^2}{n}$$

t - two tailed t-value for the appropriate confidence level with DOF = $n - 2$

$\hat{\sigma}$ - estimated standard deviation equal to the fit standard error

\bar{x} - mean value of the x-variables or, in this case, the mean value of the evaporating temperatures used to generate the linear fit

x - independent variable or, in this case, the evaporator temperature

At a 95 % confidence level, the t-value for six DOF is 2.447 from a table of the percentage points of the t-distribution (Ott 1984). From Table 7.1.1, the fit standard error was 226.28 W (772.093 Btu/h), and S_{xx} was 33.36 °C² (108.08 °F²). Substituting these values into Equation 7.1.1 yields:

$$\pm 2.447 \cdot 772.093 \sqrt{0.125 + \frac{(x - 48.485)^2}{108.08}} \quad 7.1.2$$

Knowing the confidence interval for a given confidence level and the predicted value, we can calculate the upper and lower confidence bands for the mean value of the cooling capacity sampled multiple times at a particular value of the evaporator saturation temperature within the range of the evaporator saturation temperature data. Figure 7.1.1 plots the evaporator capacity line, 90 % and 95 % confidence bands, and 5 % offset lines for Coil 9. The figure shows that the 90% and 95% confidence lines are very close to each other; they are within the ± 5 % offset lines for the majority of the saturation temperature range except the lowest and highest saturation temperatures due to the smaller number of data points associated with the end points of the temperature range.

Once the rater has used the C-B Method (Equation 4.1.2) to determine the evaporating temperature for the condensing unit and the mixed evaporator, the analysis of section 7.1 provides the uncertainty in the mean value of the cooling capacity sampled at that particular evaporator temperature. For Coil 9 and its CD Unit, the evaporating temperature was 6.2 °C (43.2 °F) which produced a cooling capacity, $q(95)$, of 7114 W (24 273 Btu/h) with an uncertainty of ± 341 W (1164 Btu/h) or ± 4.8 % on the mean value at a 95 % confidence level. Subtracting the fan heat, which has a ± 3 % uncertainty, yields the numbers seen in Table 5.1.1 or a rated $Q(95)$ of 6749 W (23 030 Btu/h) ± 341 W (1165 Btu/h) (± 5.1 %) at a 95 % confidence level. Table 7.1.2 summarizes the uncertainty results for the remaining evaporators.

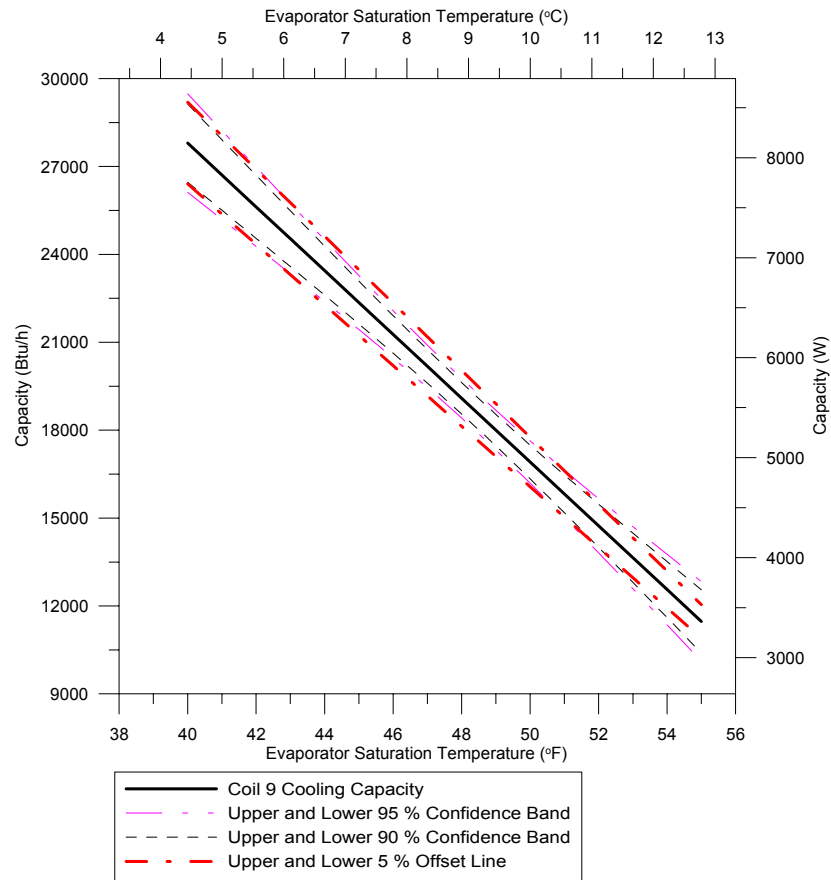


Figure 7.1.1: Coil 9 evaporator cooling capacity, confidence and error bands on the mean predicted value of the cooling capacity sampled at a particular evaporator saturation temperature

Table 7.1.2: Evaporator Q(95) linear fit uncertainty

Coil	T_{evap} °C (°F)	Q(95) W (Btu/h)	95 % Confidence Level on the Mean, Uncertainty Q(95)	% Uncertainty
1	8.11 (46.60)	9624 (32839)	541 (1847)	5.6
2	5.84 (42.51)	6344 (21647)	334 (1138)	5.3
3	7.93 (46.27)	9585 (32705)	267 (910)	2.8
4*	9.94 (49.89)	4894 (16700)	127 (434)	2.6
5	9.43 (48.98)	6917 (23601)	192 (655)	2.8
6	6.2 (43.19)	15756 (53761)	939 (3205)	6.0
7	4.5 (40.17)	8340 (28456)	124 (424)	1.5
8	5.9 (42.6)	10878 (37115)	260 (886)	2.4
9	6.2 (43.24)	6749 (23030)	342 (1166)	5.1

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

7.2: Uncertainty of C-B Method Q(95) and EER

The ARI database, $q(95)$, $q(82)$ and $p(82)$ linear fits of Table 4.1.1, NIST capacity linear fits of Table 3.4.1, Equation 4.1.2, and fan heat were used to calculate the uncertainty in the C-B Method Q(95) and EER.

$$q_{CD} = A_{CD}T_{evap} + B_{CD} = q_{mixed} = A_{mixed}T_{evap} + B_{mixed} \quad 4.1.1$$

$$T_{evap} = \frac{B_{mixed} - B_{CD}}{A_{CD} - A_{mixed}} \quad 4.1.2$$

$$p_{CD} = b_{CD} + a_{CD}T_{evap} \quad 4.1.4$$

Substituting Equation 4.1.2 into Equation 4.1.1 and 4.1.4 yields an expression for the cooling capacity and CD Unit power of the mixed system.

$$q_{CD} = q_{mixed} = A_{CD} \left(\frac{B_{mixed} - B_{CD}}{A_{CD} - A_{mixed}} \right) + B_{CD} \quad 7.2.1$$

$$p_{CD} = b_{CD} + a_{CD} \left(\frac{B_{mixed} - B_{CD}}{A_{CD} - A_{mixed}} \right) \quad 7.2.2$$

The fit standard errors for the CD Unit capacity and power linear coefficients are unknown. If we assume the fit standard error for the CD Unit capacity is similar (the same percentage) to that obtained for the evaporator tests, power coefficient uncertainties are 3 %, power and capacity fits have no covariance, and the covariance of the slope and intercept are equal for the CD Unit and evaporator tests, then we may calculate an uncertainty for the mixed system capacity and power.

In general the capacity is a function of the four linear fit coefficients and the power is a function of six linear fit coefficients:

$$q_{CD} = q_{mixed} = f(A_{CD}, B_{CD}, A_{mixed}, B_{mixed}) \quad 7.2.3$$

$$p_{CD} = p_{mixed} = f(a_{CD}, b_{CD}, A_{CD}, B_{CD}, A_{mixed}, B_{mixed}) \quad 7.2.4$$

Since the slope and intercept are not independent in Equations 7.2.1 and 7.2.2, we must include covariance in the form of a correlation coefficient (Coleman and Steele 1989). In general terms this becomes:

$$U_q^2 = \left(\frac{\partial q}{\partial A_{CD}} U_{A_{CD}} \right)^2 + \left(\frac{\partial q}{\partial B_{CD}} U_{B_{CD}} \right)^2 + \left(\frac{\partial q}{\partial A_{mixed}} U_{A_{mixed}} \right)^2 + \left(\frac{\partial q}{\partial B_{mixed}} U_{B_{mixed}} \right)^2 \\ + 2 \left(\frac{\partial q}{\partial A_{CD}} \right) \left(\frac{\partial q}{\partial B_{CD}} \right) \rho_{A_{CD}B_{CD}} U_{A_{CD}} U_{B_{CD}} + 2 \left(\frac{\partial q}{\partial A_{mixed}} \right) \left(\frac{\partial q}{\partial B_{mixed}} \right) \rho_{A_{mixed}B_{mixed}} U_{A_{mixed}} U_{B_{mixed}} \quad 7.2.5$$

Here the partial derivatives are taken from Equation 7.2.1 with respect to the various coefficients. A similar procedure is necessary for the CD Unit power equation with the addition of the two extra terms for the power equation linear fit coefficients. The fan power and resulting heat were assumed to have an uncertainty of $\pm 3\%$. The fan heat must be

subtracted from the cooling capacity, and the fan power must be added to the CD Unit power with their variances added to produce the cooling capacity and total power final values and associated uncertainties.

EER is the ratio of $Q(82)$ and $P(82)$.

$$EER = \frac{Q(82)}{P(82)} \quad 1.1$$

The propagation of the capacity uncertainty and the power uncertainty through Equation 1.1 produces a resulting uncertainty in the EER. We assumed no covariance between capacity and power. The resulting uncertainty in EER is shown below in Table 7.2.1.

Table 7.2.1: C-B Method $Q(95)$, $Q(82)$, $P(82)$, and EER uncertainty at the 95 % confidence level on the mean value

Coil	$T_{evap}(82)$	$T_{evap}(95)$	$Q(95)$ W (Btu/h)	*% $U_{Q(95)}$	$Q(82)$ W (Btu/h)	^a % $U_{Q(82)}$	$P(82)$ W	% $U_{P(82)}$	EER W/W (Btu/W h)	% U_{EER}
1	7.9 (46.3)	8.1 (46.6)	9624 (32839)	15.3	9763 (33313)	15.7	2895	3.7	3.37 (11.51)	16.1
2	5.0 (41.0)	5.8 (42.5)	6344 (21647)	4.4	6895 (23525)	4.5	2246	9.7	3.07 (10.47)	10.7
3	7.7 (45.9)	7.9 (46.3)	9585 (32705)	8.3	9717 (33155)	8.5	2876	2.8	3.38 (11.53)	9.0
4*	8.9 (48.0)	9.9 (49.9)	4894 (16700)	7.5	5410 (18458)	6.2	1760	3.4	3.07 (10.49)	7.1
5	8.5 (47.3)	9.4 (49.0)	6917 (23601)	8.2	7402 (25258)	7.0	2295	5.8	3.23 (11.01)	9.1
6	5.4 (41.7)	6.2 (43.2)	15756 (53761)	9.0	16593 (56616)	8.1	5041	4.1	3.29 (11.23)	9.1
7	2.5 (36.5)	4.5 (40.2)	8340 (28456)	6.3	9236 (31513)	4.6	3337	2.5	2.77 (9.44)	5.2
8	5.1 (41.1)	5.9 (42.6)	10877 (37115)	5.2	11500 (39238)	5.6	3703	16.9	3.11 (10.60)	17.8
9	5.4 (41.7)	6.2 (43.2)	6749 (23030)	10.8	7253 (24749)	9.3	2307	3.3	3.14 (10.73)	9.9

^a U: uncertainty

*Coil 4 airflow was too high and results cannot be compared directly to ARI tests.

The uncertainty values may be skewed higher by the assumption of equal percentage uncertainties for the evaporator and CD Unit linear fit capacity coefficients. It is likely that the manufacturers of the CD Units have much larger data sets than those collected in this work; therefore, the uncertainty percentages may be lower than those presented in Table 7.2.1.

8: CONCLUDING REMARKS

This report examines the application of the C-B Method to determine $Q(95)$ and SEER of mixed air conditioners was studied on a sample of eight mixed systems. An independent certification laboratory performed mixed system tests and shipped the mixed evaporators to NIST for testing in NIST's environmental chambers. We implemented the C-B Method for

Q(95) and SEER ratings using condensing unit performance correlations obtained from ARI, the evaporator capacity correlations developed at NIST, and the 99th percentile value of cyclic degradation coefficients identified for the equipment studied. We compared the obtained Q(95) and SEER ratings to the test-obtained values from the certification laboratory (referred to as ARI values).

The C-B Method produced Q(95) results that were within $\pm 5\%$ of the ARI tested values for five of eight coils. Among the remaining cases, one Q(95) was overpredicted by 9.4 % and two Q(95) were underpredicted by 13.6 % and 17.6 %. In two of the five cases with $\pm 5\%$ agreement, the good Q(95) predictions were obtained as a result of error offsetting between evaporator and condensing unit performance correlations with respect to the system tested capacities, as evidenced by the misprediction of the evaporator saturation temperature by the C-B Method in these two cases.

The Q(82) values from the C-B method were within $\pm 5\%$ of the ARI tested values for four of eight coils with six of eight coils being within $\pm 7\%$. Of all the factors contributing to the differences in EER(82), the CD Unit power had the largest effect. Using the CD Unit linear fits for power, the C-B Method predicted EER(82) to within $\pm 5\%$ for only two coils. Using the ARI Test values for CD Unit power, the C-B Method predicted EER(82) to within $\pm 5\%$ for four of eight coils and within $\pm 8\%$ for six of eight coils. Clearly good representations of CD Unit power must be attained to produce consistently correct values of EER(82).

Regarding SEER values, four of eight predictions were within $\pm 5\%$ of the ARI tested values, but offsetting of errors played a role in this agreement due to conservative (99th percentile) selection of the cyclic degradation coefficient used by the C-B Method. For the same reason seven of eight SEER predictions were below the test-derived SEERs.

The uncertainty analysis of the C-B Method showed that the 95 % confidence level on the mean predictions averaged 3.8 % for A-Test capacity and 10.4 % for EER. The analysis also showed the importance of careful collection of data; when the evaporator capacity linear fits had a lower standard error, the uncertainty in capacity and EER for a given evaporator temperature was also low.

We demonstrated that EVAP-COND can be used effectively in developing evaporator capacity correlations, which will facilitate the use of the C-B Method.

The C-B Method does not have any inherent features that would produce a bias in predicting Q(95) and EER(82) values. The values obtained in this study for Q(95) and EER(82), under predictions or over predictions, are caused by random deviations between the obtained system test results and evaporator and condensing unit performance correlations.

Predicted values of SEER have strong under predicting tendencies due to the conservative 99th percentile selection of the cyclic degradation coefficient. The category of equipment involved in this study can have a C_D in the range from 0.09 to 0.25, with 0.24 being the 99th percentile value that was used in our SEER calculations. It appears that there is no other way to improve SEER predictions other than providing the matched system C_D value along with condensing unit performance correlations for the application of the C-B Method. It is reasonable to assume that a mixed system would have a C_D very similar to that of the matched system if only the evaporator and indoor fan are the replaced system components.

As compared to the traditional approach for rating mixed systems that is based on the matched system $Q(95)$ and SEER values and adjusting them using coil capacity ratios (or similar scaling parameters), the C-B Method is an inherently more accurate methodology; the selected prediction problems encountered in this study should be studied further to tighten this procedure.

Some of the procedural issues that must be stipulated before a working standard is produced include the following:

- 1) Standard superheats for evaporator curve development with a method to accommodate different superheat for evaporator capacity determination
- 2) Liquid line temperatures for evaporator curve development
- 3) Cyclic degradation coefficients for comparable systems with different expansion devices
- 4) Cyclic degradation coefficient for matched system provided to coil manufacturers, or a method developed to determine a default value
- 5) Procedure for developing CD Unit curves; it should include a method for accommodating different superheats at the evaporator exit

As an alternative to the C-B Method, the traditional method for testing mixed systems could be revisited if the evaporator saturation temperature from the $Q(95)$ matched system test was made available for the mixed system rater. This would facilitate an accurate estimation of the capacity ratio of the mixed and matched coils, which is used as the most influential scaling factor in the traditional rating method. This methodology does not require the matched system C_D since it is included in the matched system SEER, which is available for rating.

REFERENCES

- ASHRAE 1988. ANSI/ASHRAE Standard 37. *Methods of testing for rating unitary air conditioning and heat pump equipment*. American Society of Heating, Refrigerating and Air-Conditioning Engineers. 1791 Tullie Circle NE, Atlanta, GA, USA.
- ARI 2003. Standard 210/240, *Standard for unitary air-conditioning and air-source heat pump equipment*, Air-Conditioning and Refrigeration Institute, 4100 North Fairfax Drive, Suite 200, Arlington, VA 22203.
- CFR, 2004a. *Code of Federal Regulations*, Part 430, Appendix M to Subpart B, Uniform test method for measuring the energy consumption of central air conditioners, Office of the Federal Register, National Archives and Records Administration, Washington, DC.
- CFR, 2004b. *Code of Federal Regulations*, Part 430.24, Subsection m1, Units to be tested, Federal Register, National Archives and Records Administration, Washington, DC.
- Coleman, H.W. and Steele, W.G., 1989. *Experimentation and uncertainty analysis for engineers*, John Wiley and Sons, New York, NY USA.
- Domanski, P.A., 1989. *Rating procedure for mixed air-source unitary air conditioners and heat pumps operating in the cooling mode – revision 1*, NISTIR 89-4071, U. S. Dept of Commerce, Natn'l Institute of Standards and Technology, Gaithersburg, Maryland USA 20899.
- Domanski, P.A., 1999. "Finned-Tube Evaporator Model With a Visual Interface", 20th Int. Congress of Refrigeration, Sydney, Australia, September 19-24, 1999, International Institute of Refrigeration, Paris.
- Dougherty, B., 2004. Personal communications, National Institute of Standards and Technology, Gaithersburg, Maryland, USA, 20899.
- Graybill, F. A. and Iyer, H. K., 1994. *Regression Analysis: Concepts and Applications*, Duxbury Press, Wadsworth Publishing Company, Belmont, California USA 94002, pp. 194-209.
- Lemmon, E. W., McLinden, M. O., and Huber, M. L., 2002. *NIST Standard Reference Database 23: NIST Reference Fluid Thermodynamic and Transport Properties – REFPROP*, Version 7, U. S. Dept of Commerce, Natn'l Institute of Standards and Technology, Gaithersburg, Maryland USA 20899.
- Ott, Lyman. 1984. *An introduction to statistical methods and data analysis*, 2nd edition, Duxbury Press, Boston, Massachusetts USA, pp. 280-324.
- Moffat, R. 1988. Describing the uncertainties in experimental results. *Experimental Thermal and Fluid Science*. Vol. 1. pp. 3-17.


- Neter J., Wasserman W., and Kutner M.H., 1990. *Applied linear statistical models, regression, analysis of variance and experimental design*, 3rd edition, Irwin publishing, Burr Ridge, Illinois, USA, pp.10.
- Taylor, B. N., and Kuyatt, C. E., 1994. "Guidelines for evaluating and expressing the uncertainty of NIST measurement results", *NIST Technical Note 1297*, 1994 edition, U.S. Department of Commerce.

APPENDIX A: EVAPORATOR COIL DESCRIPTIONS

Appendix A presents design information for the nine mixed evaporators tested at NIST. It includes a picture, design data, and refrigerant circuitry representation in the input format of the EVAP-COND simulation package. General information and name designation for the mixed evaporators is given in Table 2.1.

Coil 1

Coil Design Data	
Data for a section	
No. of tubes in depth row #1:	24
No. of tubes in depth row #2:	24
No. of tubes in depth row #3:	24
No. of tubes in depth row #4:	0
No. of tubes in depth row #5:	0
A01102, Right Side	
Units <input type="checkbox"/> SI Units <input checked="" type="checkbox"/> British Units	
Tube data	
Tube length	in 17
Inner diameter	in 0.3125
Outer diameter	in 0.375
Tube pitch	in 1
Depth row pitch	in 0.875
Inner surface	Smooth
Thermal conductivity	Btu/(ft.h.F) 216.671
Fin data	
Thickness	in 0.004
Pitch	in 0.0712484
Type	Louver
Thermal conductivity	Btu/(ft.h.F) 132.891
Volumetric flow rate	ft ³ /min 506.001
Cancel OK	

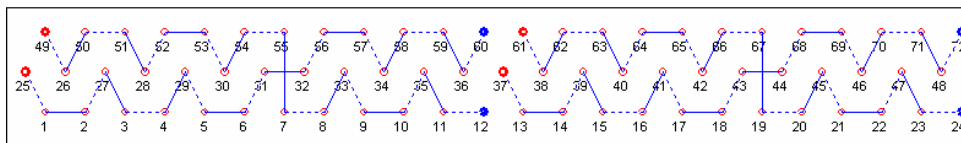

Coil 2

Coil Design Data

Data for a section

No. of tubes in depth row #1:	16
No. of tubes in depth row #2:	0
No. of tubes in depth row #3:	0
No. of tubes in depth row #4:	0
No. of tubes in depth row #5:	0

Refrigerant: A01070 R22

Units: ☐ SI Units ☒ British Units

Tube data

Tube length	in	40
Inner diameter	in	0.3125
Outer diameter	in	0.375
Tube pitch	in	1
Depth row pitch	in	0
Inner surface		Smooth
Thermal conductivity	Btu/(ft.h.F)	216.671


Fin data

Thickness	in	0.004
Pitch	in	0.0416665
Type		Louver
Thermal conductivity	Btu/(ft.h.F)	132.891

Volumetric flow rate: ft³/min 810.001

Cancel OK


Coil circuitry



Coil 3

Coil Design Data	
Data for a section	
No. of tubes in depth row #1:	18
No. of tubes in depth row #2:	18
No. of tubes in depth row #3:	18
No. of tubes in depth row #4:	18
No. of tubes in depth row #5:	0
A01148 R22 Right Side	
Units <input type="checkbox"/> SI Units <input checked="" type="checkbox"/> British Units	
Tube data	
Tube length	in 17
Inner diameter	in 0.3125
Outer diameter	in 0.375
Tube pitch	in 1
Depth row pitch	in 0.875
Inner surface	Smooth
Thermal conductivity	Btu/(ft.h.F) 216.671
Fin data	
Thickness	in 0.004
Pitch	in 0.0625
Type	Louver
Thermal conductivity	Btu/(ft.h.F) 132.891
Volumetric flow rate	ft³/min 480.001
<input type="button" value="Cancel"/> <input type="button" value="OK"/>	


Coil Circuitry (left slab)

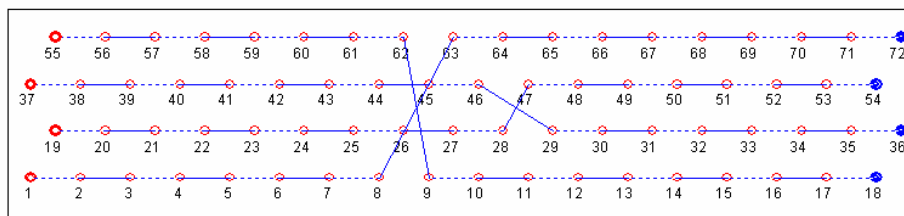

Coil 4

Coil Design Data	
Data for a section	
No. of tubes in depth row #1:	14
No. of tubes in depth row #2:	14
No. of tubes in depth row #3:	0
No. of tubes in depth row #4:	0
No. of tubes in depth row #5:	0
R22 A01138	
Units <input type="checkbox"/> SI Units <input checked="" type="checkbox"/> British Units	
Tube data	
Tube length	in 16
Inner diameter	in 0.3125
Outer diameter	in 0.375
Tube pitch	in 1
Depth row pitch	in 0.75
Inner surface	Smooth
Thermal conductivity	Btu/(ft.h.F) 216.671
Fin data	
Thickness	in .004
Pitch	in 0.0625
Type	Louver
Thermal conductivity	Btu/(ft.h.F) 132.891
Volumetric flow rate	ft³/min 395.0
<input type="button" value="Cancel"/> <input type="button" value="OK"/>	

Coil Circuitry (right slab as seen below)

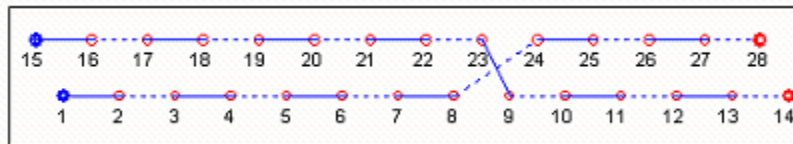

Coil 5

Coil Design Data

Data for a section

No. of tubes in depth row #1: 18
 No. of tubes in depth row #2: 18
 No. of tubes in depth row #3: 18
 No. of tubes in depth row #4: 18
 No. of tubes in depth row #5: 0

A01060

Units
☐ SI Units ☒ British Units

Tube data

Tube length in 17
 Inner diameter in 0.3125
 Outer diameter in 0.375
 Tube pitch in 1
 Depth row pitch in 0.625
 Inner surface Smooth
 Thermal conductivity Btu/(ft.h.F) 216.671



Fin data

Thickness in 0.004
 Pitch in 0.0588228
 Type Louver
 Thermal conductivity Btu/(ft.h.F) 132.891

Volumetric flow rate ft³/min 753.0

Cancel OK

Coil circuitry

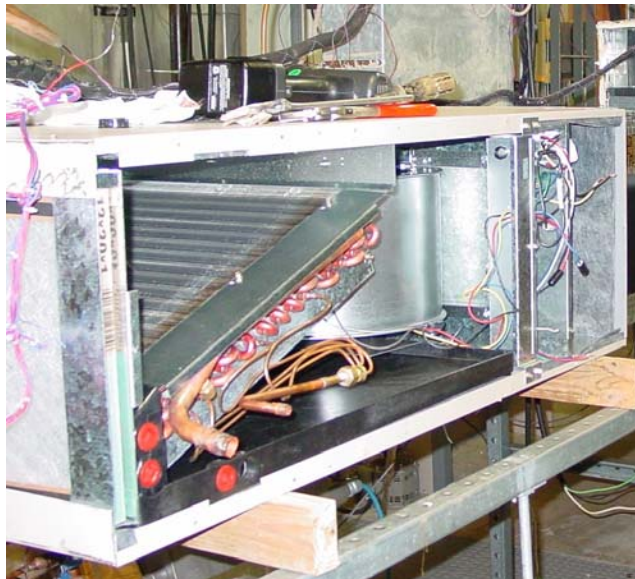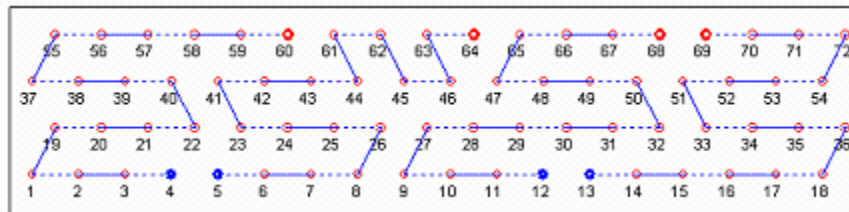

Coil 6

Coil Design Data

Data for a section

No. of tubes in depth row #1:	16
No. of tubes in depth row #2:	16
No. of tubes in depth row #3:	16
No. of tubes in depth row #4:	16
No. of tubes in depth row #5:	16
No. of tubes in depth row #6:	16

Tube data

Tube length	in	29
Inner diameter	in	0.3125
Outer diameter	in	0.375
Tube pitch	in	1
Depth row pitch	in	0.625
Inner surface		Smooth
Thermal conductivity	Btu/(ft.h.F)	216.671

R22 A01125

Units

☐ SI Units ☒ British Units


Fin data

Thickness	in	0.004
Pitch	in	0.0666665
Type		Louver
Thermal conductivity	Btu/(ft.h.F)	132.891

Volumetric flow rate ft³/min 575.001

Cancel OK



Coil circuitry

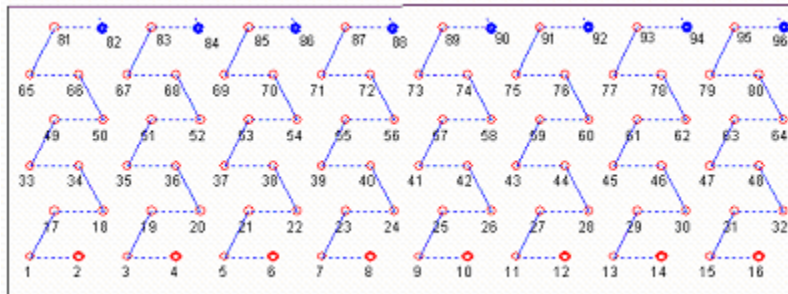

Coil 7

Coil Design Data	
Data for a section	
No. of tubes in depth row #1:	20
No. of tubes in depth row #2:	20
No. of tubes in depth row #3:	0
No. of tubes in depth row #4:	0
No. of tubes in depth row #5:	0
R22 H5326	
Units <input type="checkbox"/> SI Units <input checked="" type="checkbox"/> British Units	
Tube data	
Tube length	in 16.125
Inner diameter	in 0.3125
Outer diameter	in 0.375
Tube pitch	in 1
Depth row pitch	in 0.625
Inner surface	Smooth
Thermal conductivity	Btu/(ft.h.F) 216.671
Fin data	
Thickness	in 0.004
Pitch	in 0.0769228
Type	Louver
Thermal conductivity	Btu/(ft.h.F) 132.891
Volumetric flow rate	ft ³ /min 602
<input type="button" value="Cancel"/> <input type="button" value="OK"/>	



Coil circuitry (left or right slab)

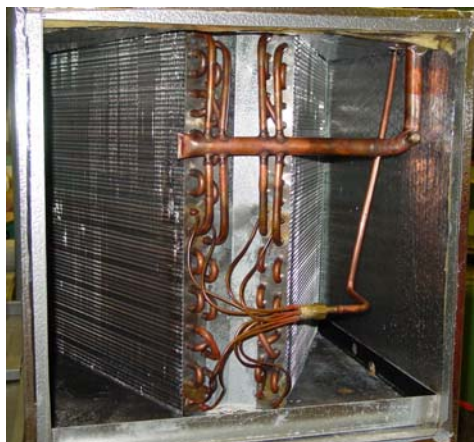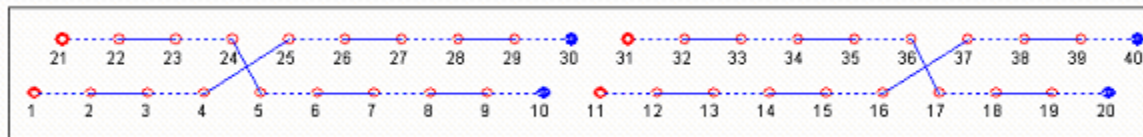

Coil 8

Coil Design Data		
Data for a section		
No. of tubes in depth row #1:	20	
No. of tubes in depth row #2:	20	
No. of tubes in depth row #3:	20	
No. of tubes in depth row #4:	0	
No. of tubes in depth row #5:	0	
Tube data		
Tube length	in	16
Inner diameter	in	0.3125
Outer diameter	in	0.375
Tube pitch	in	1
Depth row pitch	in	0.875
Inner surface	Smooth	
Thermal conductivity	Btu/(ft.h.F)	216.671
Fin data		
Thickness	in	0.004
Pitch	in	0.1
Type	Louver	
Thermal conductivity	Btu/(ft.h.F)	132.891
Volumetric flow rate	ft ³ /min	690.001
Cancel		OK

Coil circuitry (left slab)

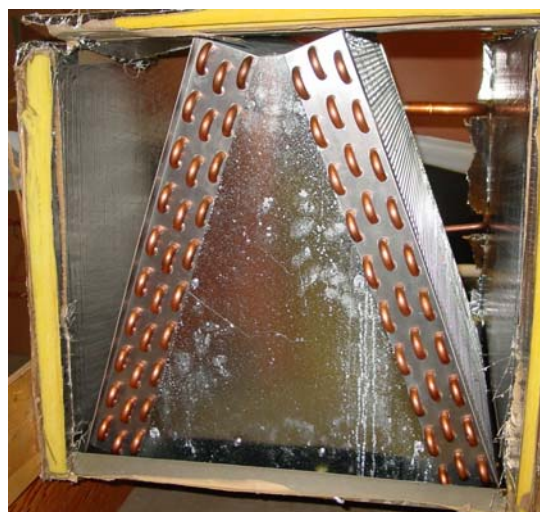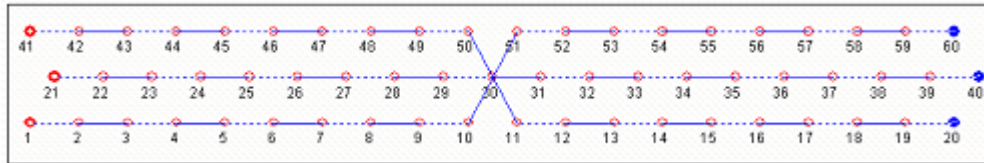

Coil 9

Coil Design Data

Data for a section

No. of tubes in depth row #1: 15
 No. of tubes in depth row #2: 15
 No. of tubes in depth row #3: 15
 No. of tubes in depth row #4: 15
 No. of tubes in depth row #5: 0

R410A, A01154

Units
☐ SI Units ☒ British Units

Tube data

Tube length: in 20.5
 Inner diameter: in 0.3125
 Outer diameter: in 0.375
 Tube pitch: in 1
 Depth row pitch: in 0.875
 Inner surface: Smooth
 Thermal conductivity: Btu/(ft.h.F) 216.671


Fin data

Thickness: in 0.004
 Pitch: in 0.071428
 Type: Louver
 Thermal conductivity: Btu/(ft.h.F) 132.891

Volumetric flow rate: ft³/min 500

Cancel OK

Coil circuitry

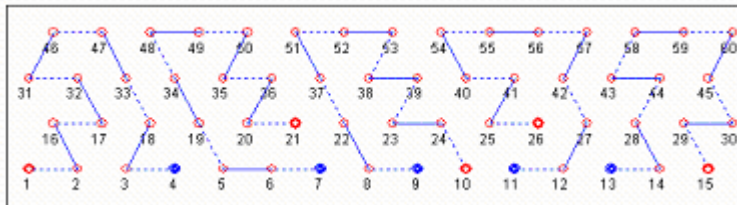

APPENDIX B: UNCERTAINTY ANALYSIS

A. 1 General Remarks

The uncertainty analysis was performed to gain knowledge about the uncertainty of the measured and calculated data. This Appendix presents the major equations used for the uncertainty analysis.

A. 2 Theory

The uncertainty of a quantity R calculated from n independent measurements x_i is a function of the individual uncertainty of each measurement.

$$R = f(x_1, x_2, x_3, \dots, x_n) \quad (\text{A.1})$$

When each measurement, x_i , has a given uncertainty, dx_i , the maximum uncertainty of R is given by:

$$E_R = \left| \frac{\partial f}{\partial x_1} dx_1 \right| + \left| \frac{\partial f}{\partial x_2} dx_2 \right| + \left| \frac{\partial f}{\partial x_3} dx_3 \right| + \dots + \left| \frac{\partial f}{\partial x_n} dx_n \right|. \quad (\text{A.2})$$

However, using the maximum error to judge the uncertainty of a calculated quantity is not common. Usually the standard deviation (root sum square) is regarded to be a much better approach to a quantity's uncertainty.

$$E_R = \sqrt{\left(\frac{\partial f}{\partial x_1} dx_1 \right)^2 + \left(\frac{\partial f}{\partial x_2} dx_2 \right)^2 + \left(\frac{\partial f}{\partial x_3} dx_3 \right)^2 + \dots + \left(\frac{\partial f}{\partial x_n} dx_n \right)^2} \quad (\text{A.3})$$

The absolute error calculated with equation (A.3) is often converted to a relative error having the units of percent.

$$e_R = \frac{E_R}{R} 100 \quad (\text{A.4})$$

A. 3 Temperature Measurements

Most of the temperature measurements performed for these tests were determined by thermocouples. Their voltage signals were measured with the data acquisition system and then converted into a temperature.

The equation used in the test rig's control program to convert the voltage signals into temperatures was a sixth degree polynomial of the form:

$$\mathcal{G} = f(V) = \frac{9}{5}(A + BV + CV^2 + DV^3 + EV^4 + FV^5 + GV^6) + 32 \quad (\text{A.5})$$

where:

$$\begin{aligned} \mathcal{G} &= \text{temperature } (^{\circ}\text{F}) \\ V &= \text{measured voltage } (\mu\text{V}) \end{aligned}$$

If one premises that the uncertainty of the equation itself can be neglected, only one derivation is needed to evaluate the uncertainty in the temperature measurements.

$$\frac{\partial \mathcal{G}}{\partial V} = \frac{9}{5} (B + 2CV + 3DV^2 + 4EV^3 + 5FV^4 + 6GV^5) \quad (\text{A.6})$$

According to the manufacturer of the voltmeter, the 95 % uncertainty of the voltage measurement (VM) was: $E_{VM} = dV(VM) = \pm 0.007 \% \text{ of reading} + 5 \mu\text{V}$.

The measurement of a temperature (\mathcal{G}) actually is the measurement of the difference to a reference temperature. The data acquisition system provided temperature compensation to 0°C (32°F) with a given uncertainty of: $E_{TC} = dTC = \pm 0.2236^{\circ}\text{C} = \pm 0.4025^{\circ}\text{F}$.

Rewriting equation A.3 for the measurement of the absolute temperature gives:

$$\mathcal{G} = f(V) \quad (\text{A.7})$$

$$E_T = \sqrt{\left(\frac{\partial \mathcal{G}}{\partial V} dVM \right)^2 + (dTC)^2} \quad (\text{A.8})$$

In addition to the common thermocouple measurements, the dew-point temperature in the air duct was measured to evaluate the humidity ratio of the moist air in the duct.

The manufacturer of the dew-point hygrometer specified the 95 % uncertainty in this measurement to be: $E_{T_{\text{dew}}} = dT_{\text{dew}} = \pm 0.05 \% \text{ of reading}$.

A. 4 Temperature Difference Measurements

The evaluation of the uncertainty of a temperature difference ($\Delta \mathcal{G}$) measurement using a thermopile is slightly more complicated than that for a normal temperature measurement. The uncertainty evaluation is presented using the air duct temperature difference as an example, because this shows the most complicated case. Again there are two independent uncertainties being part of the measurement uncertainty. The first is the uncertainty caused by the voltage signal measurement, discussed in section A.3. The cause for the second uncertainty influencing the measurement of a temperature difference is the nonlinear character of the temperature/voltage function (see equation A.5). The nonlinearity requires temperature at one end of the thermopile used for the temperature difference measurement to be known.

The temperature difference across the indoor coil was calculated using both the voltage signals of the temperature difference measurement (ΔV) and the average voltage signal

($V_{av.}$) of the entering temperature measurement of the air duct. The equation used to do so was:

$$\Delta g = f(V_{av.} + \Delta V) - f(V_{av.}) \quad (A.9)$$

The entering temperature was measured using 25 thermocouples equally distributed over the air duct's cross section. The average of the 25 temperature signals was considered to be the entering temperature. For the uncertainty in this average entering temperature the average voltage measurement uncertainty $E_{VM,av.}$ of the 25 measurements was calculated.

$$E_{VM,av.} = dV_{av.}(VM) = \sum_{x=1}^{25} \frac{dV_{av.}(VM_x)}{25} \quad (A.10)$$

All 25 thermocouples were connected to the same temperature compensation. This means the overall uncertainty of the air's average entering temperature voltage signal $V_{av.}$ was:

$$dV_{av.} = \sqrt{E_{VM,av.}^2 + E_{TC}^2} = \sqrt{(dV_{av.}(VM))^2 + (dV_{av.}(TC))^2} \quad (A.11)$$

To evaluate equation A.11 the uncertainty in the temperature compensation must be rewritten to have the unit of μV . Using equation A.5 one finds that an uncertainty of $E_{TC} = dTC = \pm 0.2236^\circ C = \pm 0.4025^\circ F$ in the temperature compensation to $0^\circ C$ ($32^\circ F$) is equivalent to a voltage signal uncertainty of $dV_{av.}(TC) = \pm 8.6264 \mu V$. As already mentioned, the uncertainty of the voltage signal measurement was given from manufacturer data.

The nonlinearity of the voltage/temperature function (A.5) causes an uncertainty $dslope$ in the temperature difference that depends on the uncertainty in the entering temperature voltage signal $V_{av.}$

$$E_{slope} = dslope = |g(V_{av.} + dV) - g(V_{av.}) - (g(V_{av.} + dV_{av.} + \Delta V) - g(V_{av.} + dV_{av.}))| \quad (A.12)$$

where:

$$\begin{aligned} V_{av.} &= \text{entering temperature voltage signal } (\mu V) \\ dV_{av.} &= \text{uncertainty of the entering temperature voltage signal } (\mu V) \\ \Delta V &= \text{temperature difference voltage signal } (\mu V) \end{aligned}$$

Remembering that an additional uncertainty in the temperature difference is caused by the voltage measurement of the temperature difference voltage signal (ΔV), the uncertainty of the air duct temperature difference is given to be:

$$E_{\Delta g} = d\Delta g = \left[\left(\frac{\partial g}{\partial V} d\Delta V \right)^2 + dslope^2 \right]^{1/2} \quad (A.13)$$

A. 5 Uncertainty of the Air Side Capacity

The air side capacity of the heat pump was evaluated using the equation:

$$\dot{Q}_C = \dot{Q}_S + \dot{Q}_L \quad (A.14)$$

where:

$$\begin{aligned} \dot{Q}_S &= \text{sensible capacity, kW (Btu/h)} \\ \dot{Q}_L &= \text{latent capacity, kW (Btu/h)} \end{aligned}$$

The sensible capacity is the heat needed to cool or heat the moist air passing the heat pump's indoor coil. The latent capacity is the heat rejected by water vapor condensing on the air coil. Condensation does not occur in the heating mode.

The two different capacities were calculated separately and then added (A.14). Therefore the uncertainty of the air-side capacity can be written as:

$$E_{\dot{Q}_C} = \left[\left(\frac{\partial \dot{Q}_C}{\partial \dot{Q}_S} d\dot{Q}_S \right)^2 + \left(\frac{\partial \dot{Q}_C}{\partial \dot{Q}_L} d\dot{Q}_L \right)^2 \right]^{1/2} = (d\dot{Q}_S^2 + d\dot{Q}_L^2)^{1/2} \quad (A.15)$$

The equations for both the sensible and latent capacities and their uncertainties are presented on the following pages.

A. 5. 1 Uncertainty of the Sensible Capacity

According to ASHRAE Standard 116-1993 the sensible capacity \dot{Q}_S is given by:

$$\dot{Q}_S = 3600 C_D A_n (0.24 + 0.444 W_{av.}) (g_i - g_e) \left[\frac{2g_C \Delta p_n \rho_{nact}}{144(1 - \beta^2)} \right]^{1/2} \quad (A.16)$$

where:

$$\begin{aligned} C_D &= \text{nozzle discharge coefficient (0.986)} \\ A_n &= \text{nozzle throat area, m}^2 \text{ (ft}^2\text{)} \\ W_{av.} &= (W_e + W_i) / 2 \text{ average humidity ratio, kg H}_2\text{O/ kg dry air} \\ &\quad \text{(lb H}_2\text{O/lb dry air)} \\ g_i - g_e &= \text{indoor coil air temperature rise, } ^\circ\text{C (} ^\circ\text{F)} \\ g_C &= \text{gravity constant (32.174 ft} \cdot \text{lb}_m / \text{lb}_f \cdot \text{s}^2\text{)} \\ \Delta p_n &= \text{static pressure drop across nozzle, kPa (psia)} \\ \rho_{nact} &= \text{density of the moist air, kg/m}^3 \text{ (lb / ft}^3\text{)} \end{aligned}$$

$$\begin{aligned} 144 &= \text{unit conversion factor from } in^2 \text{ to } ft^2 \\ \beta &= \text{area relation factor (0.250723)} \end{aligned}$$

The partial derivatives required for the uncertainty analysis of \dot{Q}_s are:

$$\frac{\partial \dot{Q}_s}{\partial A_n} = 3600 C_D (0.24 + 0.444 W_{av.}) (g_l - g_e) \left[\frac{2 g_c \Delta p_n \rho_{nact}}{144 (1 - \beta^2)} \right]^{1/2} \quad (A.17)$$

$$\frac{\partial \dot{Q}_s}{\partial W_e} = 1800 C_D A_n 0.444 (g_l - g_e) \left[\frac{2 g_c \Delta p_n \rho_{nact}}{144 (1 - \beta^2)} \right]^{1/2} \quad (A.18)$$

$$\frac{\partial \dot{Q}_s}{\partial W_l} = 1800 C_D A_n 0.444 (g_l - g_e) \left[\frac{2 g_c \Delta p_n \rho_{nact}}{144 (1 - \beta^2)} \right]^{1/2} \quad (A.19)$$

$$\frac{\partial \dot{Q}_s}{\partial (g_l - g_e)} = 3600 C_D A_n (0.24 + 0.444 W_{av.}) \left[\frac{2 g_c \Delta p_n \rho_{nact}}{144 (1 - \beta^2)} \right]^{1/2} \quad (A.20)$$

$$\frac{\partial \dot{Q}_s}{\partial \Delta p_n} = 1800 C_D A_n (0.24 + 0.444 W_{av.}) (g_l - g_e) \left[\frac{2 g_c \rho_{nact}}{144 (1 - \beta^2) \Delta p_n} \right]^{1/2} \quad (A.21)$$

$$\frac{\partial \dot{Q}_s}{\partial \rho_{nact}} = 1800 C_D A_n (0.24 + 0.444 W_{av.}) (g_l - g_e) \left[\frac{2 g_c \Delta p_n}{144 (1 - \beta^2) \rho_{nact}} \right]^{1/2} \quad (A.22)$$

$$\frac{\partial \dot{Q}_s}{\partial \beta} = 3600 C_D A_n (0.24 + 0.444 W_{av.}) (g_l - g_e) \beta \left[\frac{2 g_c \Delta p_n \rho_{nact}}{144 (1 - \beta^2)^3} \right]^{1/2} \quad (A.23)$$

Using the above partial derivatives for rewriting equation A.3 gives:

$$\begin{aligned} E_{Q_s} = & \left[\left(\frac{\partial \dot{Q}_s}{\partial A_n} dA_n \right)^2 + \left(\frac{\partial \dot{Q}_s}{\partial W_e} dW_e \right)^2 + \left(\frac{\partial \dot{Q}_s}{\partial W_l} dW_l \right)^2 + \left(\frac{\partial \dot{Q}_s}{\partial \Delta p_n} d\Delta p_n \right)^2 + \right. \\ & \left. + \left(\frac{\partial \dot{Q}_s}{\partial (g_l - g_e)} d(g_l - g_e) \right)^2 + \left(\frac{\partial \dot{Q}_s}{\partial \rho_{nact}} d\rho_{nact} \right)^2 + \left(\frac{\partial \dot{Q}_s}{\partial \beta} d\beta \right)^2 \right]^{1/2} \quad (A.24) \end{aligned}$$

Equation A.24 can be evaluated to give the uncertainty of \dot{Q}_s if each of the individual uncertainties is known. However, A , β , W_e , W_l and ρ_{nact} are calculated quantities, so their uncertainties were not known, but had to be calculated using equation A.3.

The flow in the air duct was measured using a venturi tube measurement. The nozzle throat area A_n , which is part of equation A.16, was calculated from the throat diameter. Thus its uncertainty can be evaluated very easily.

$$A_n = \frac{\pi d_n^2}{4} \quad (\text{A.25})$$

$$E_{A_n} = \frac{\partial A_n}{\partial d_n} dd_n = \frac{\pi d_n}{2} dd_n \quad (\text{A.26})$$

The uncertainty of the throat diameter was given to be: $E_{d_n} = dd_n = \pm 0.254 \text{ mm} = \pm 0.01 \text{ in.}$

The area ratio factor β was calculated using the equation:

$$\beta = \frac{A_n}{A_{en}} = \frac{d_n^2}{d_{en}^2} \quad (\text{A.27})$$

Again, both areas were calculated using their diameter given by the manufacturer of the venturi tube. The partial derivatives used to evaluate the uncertainty in β were:

$$\frac{\partial \beta}{\partial d_n} = 2 \frac{d_n}{d_{en}^2} \quad (\text{A.28})$$

$$\frac{\partial \beta}{\partial d_{en}} = -2 \frac{d_n^2}{d_{en}^3} \quad (\text{A.29})$$

Using these derivatives to rewrite A.3 gives:

$$E_\beta = \left[\left(2 \left(\frac{d_n}{d_{en}^2} \right) dd_n \right)^2 + \left(-2 \left(\frac{d_n^2}{d_{en}^3} \right) dd_{en} \right)^2 \right]^{1/2} \quad (\text{A.30})$$

The required uncertainty in the inlet diameter was also $E_{d_{en}} = dd_{en} = \pm 0.254 \text{ mm} = \pm 0.01 \text{ in.}$

The humidity ratios W_e and W_l are a function of the water vapor pressure p_w and the atmospheric pressure p .

$$W = 0.62198 \frac{p_w}{p - p_w} \quad (\text{A.31})$$

The factor 0.62198 comes from the ratio of the mole weights of the two components, water and air.

The required partial derivatives of equation A.31 are:

$$\frac{\partial W}{\partial p} = 0.62198 \frac{p_w}{(p - p_w)^2} \quad (\text{A.32})$$

$$\frac{\partial W}{\partial p_w} = 0.62198 \frac{p}{(p - p_w)^2} \quad (\text{A.33})$$

They lead to the uncertainty in W :

$$E_W = dW = \left[\left(\frac{\partial W}{\partial p} dp \right)^2 + \left(\frac{\partial W}{\partial p_w} dp_w \right)^2 \right]^{1/2} \quad (\text{A.34})$$

Unfortunately the water saturation pressure is a calculated quantity itself, which means its uncertainty had to be calculated.

The equation that was used to calculate the saturation pressure from the dew-point temperature, T_{dew} , ($^{\circ}\text{R}$), is given below. The equation was assumed to cause no additional uncertainties.

$$p_w = \text{EXP} \left[\frac{C_8}{T_{\text{dew}}} + C_9 + C_{10} T_{\text{dew}} + C_{11} T_{\text{dew}}^2 + C_{12} T_{\text{dew}}^3 + C_{13} \ln T_{\text{dew}} \right] \quad (\text{A.35})$$

The partial derivative of equation A.35 with respect to T_{dew} is:

$$\frac{\partial p_w}{\partial T_{\text{dew}}} = \left[\frac{-C_8}{T_{\text{dew}}^2} + C_{10} + 2C_{11} T_{\text{dew}} + 3C_{12} T_{\text{dew}}^2 + \frac{C_{13}}{T_{\text{dew}}} \right] p_w \quad (\text{A.36})$$

The uncertainty in p_w is now given by:

$$E_{p_w} = dp_w = \frac{\partial p_w}{\partial T_{\text{dew}}} dT_{\text{dew}} \quad (\text{A.37})$$

As already mentioned in section A.3, the uncertainty of the dew-point temperature measurement was given to be: $E_{T_{\text{dew}}} = dT_{\text{dew}} = \pm 0.05 \% \text{ of reading}$.

Finally, the uncertainty in the moist air's density ρ_{nact} had to be evaluated. The density was calculated using the ideal gas equation and the humidity ratio.

$$\rho_{\text{nact}} = \frac{p_n 144(1+W)}{R_a T_n (1+1.6078W)} \quad (\text{A.38})$$

The factor 1.6078 is the ratio of the molar weights of air and water.

The partial derivatives of the A.38 are:

$$\frac{\partial p_{\text{nact}}}{\partial p_n} = \frac{144(1+W)}{RT_n(1+1.6078W)} \quad (\text{A.39})$$

$$\frac{\partial p_{\text{nact}}}{\partial T_n} = \frac{-p_n 144(1+W)}{RT_n^2(1+1.6078W)} \quad (\text{A.40})$$

$$\frac{\partial p_{\text{nact}}}{\partial W} = \frac{-0.6078 p_n 144}{RT_n(1+1.6078W)^2} \quad (\text{A.41})$$

Rewriting equation A.3 with the above partial derivatives gives:

$$E_{p_{\text{nact}}} = \left[\left(\frac{\partial p_{\text{nact}}}{\partial p_n} dp_n \right)^2 + \left(\frac{\partial p_{\text{nact}}}{\partial T_n} dT_n \right)^2 + \left(\frac{\partial p_{\text{nact}}}{\partial W} dW \right)^2 \right] \quad (\text{A.42})$$

The pressure p_n in the nozzle throat was calculated as the difference of atmospheric pressure and nozzle pressure drop. The uncertainty of the nozzle pressure can be derived as follows:

$$p_n = p_{\text{atm}} - \Delta p \quad (\text{A.43})$$

$$E_{p_n} = dp_n = \left[(dp_{\text{atm}})^2 + (d\Delta p)^2 \right]^{1/2} \quad (\text{A.44})$$

The uncertainties of the pressure measurements were given from manufacturer data:

$$E_{p_{\text{atm}}} = dp_{\text{atm}} = \pm 0.3429 \text{ mmHg} = \pm 0.0135 \text{ in Hg} \quad \text{and}$$

$$E_{Dp_n} = dDp_n = \pm 2.489 \text{ mmH}_2\text{O} = \pm 0.098 \text{ in H}_2\text{O} .$$

A. 5. 2 Uncertainty of the Latent Capacity

The latent cooling capacity (ASHRAE Standard 116-1983) is given by:

$$\dot{Q}_L = 6360060 C_D A_n (W_e - W_l) \left[\frac{2g_C \Delta p_n \rho_{\text{nact}}}{144(1-\beta^2)} \right]^{1/2} \quad (\text{A.44})$$

where:

C_D	=	nozzle discharge coefficient (0.986)
A_n	=	nozzle throat area (ft^2)
W_e	=	entering humidity ratio (lb H_2O /lb dry air)
W_l	=	leaving humidity ratio (lb H_2O /lb dry air)
g_C	=	gravity constant ($32.174 \text{ ft} \cdot \text{lb}_m / \text{lb}_f \cdot \text{s}^2$)
Δp_n	=	static pressure drop across nozzle (psia)

ρ_{nact}	=	density of the moist air (lb / ft ³)
144	=	unit conversion factor from in ² to ft ²
β	=	area relation factor (0.250723)

The partial derivatives of this equation are:

$$\frac{\partial \dot{Q}_L}{\partial A_n} = 6360060 C_D (W_e - W_l) \left[\frac{2g_C \Delta p_n \rho_{\text{nact}}}{144(1 - \beta^2)} \right]^{1/2} \quad (\text{A.45})$$

$$\frac{\partial \dot{Q}_L}{\partial W_e} = 6360060 C_D A_n \left[\frac{2g_C \Delta p_n \rho_{\text{nact}}}{144(1 - \beta^2)} \right]^{1/2} \quad (\text{A.46})$$

$$\frac{\partial \dot{Q}_L}{\partial W_l} = -6360060 C_D A_n \left[\frac{2g_C \Delta p_n \rho_{\text{nact}}}{144(1 - \beta^2)} \right]^{1/2} \quad (\text{A.47})$$

$$\frac{\partial \dot{Q}_L}{\partial \Delta p_n} = 3180060 C_D A_n (W_e - W_l) \left[\frac{2g_C \rho_{\text{nact}}}{144(1 - \beta^2) \Delta p_n} \right]^{1/2} \quad (\text{A.48})$$

$$\frac{\partial \dot{Q}_L}{\partial \rho_{\text{nact}}} = 3180060 C_D A_n (W_e - W_l) \left[\frac{2g_C \Delta p_n}{144(1 - \beta^2) \rho_{\text{nact}}} \right]^{1/2} \quad (\text{A.49})$$

$$\frac{\partial \dot{Q}_L}{\partial \beta} = 6360060 C_D A_n (W_e - W_l) \beta \left[\frac{2g_C \Delta p_n \rho_{\text{nact}}}{144(1 - \beta^2)^3} \right]^{1/2} \quad (\text{A.50})$$

If the above derivatives are used to rewrite equation A.3, one obtains the uncertainty of the latent capacity:

$$E_{Q_L} = \left[\left(\frac{\partial \dot{Q}_L}{\partial A_n} dA_n \right)^2 + \left(\frac{\partial \dot{Q}_L}{\partial W_e} dW_e \right)^2 + \left(\frac{\partial \dot{Q}_L}{\partial W_l} dW_l \right)^2 + \right. \\ \left. + \left(\frac{\partial \dot{Q}_L}{\partial \Delta p_n} d\Delta p_n \right)^2 + \left(\frac{\partial \dot{Q}_L}{\partial \rho_{\text{nact}}} d\rho_{\text{nact}} \right)^2 + \left(\frac{\partial \dot{Q}_L}{\partial \beta} d\beta \right)^2 \right]^{1/2} \quad (\text{A.51})$$

In this equation, all the needed uncertainties are known. Either because the quantities are directly measured or their uncertainties have already been calculated in Appendix A.4.1.

The final step was calculating the uncertainty of the air side capacity by using the now known uncertainties of sensible and latent capacity in equation A.15.

APPENDIX C: COOLING MEASUREMENT SUMMARY SHEETS

Coil 1

R22, A01102, No Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET						
DATA FILENAME: a031216a.dat			SUMMARY FILENAME: a031216a.sum			
Air-Side Conditions		Range	Total Air-Side Capacity:		35172.37	1870.22
Indoor Dry-Bulb :	79.847	0.35	Sensible Cap (Btu/h):		27501.92	541.05
Indoor Inlet Dew (F):	60.414	0.55	Latent Cap (Btu/h):		7670.45	1669.75
Indoor Exit Dry-Bulb:	57.177	0.59	EvapAir Delta T (F):		24.64	0.44
Indoor Exit Dew (F):	56.227	0.95	Air/Ref Cap Prcnt Diff:		3.16	7.82
			Sensible Heat Ratio:		0.782	0.0357
Indoor Airflow (CFM):	995.24	7.59	SCFM per Ton:		345.94	
Indoor Airflow (SCFM):	1013.97	7.68	(0.075 lb/ft3 standard air)			
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011194			
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009608			
Barometric Pressure (in HG):	29.96		Nozzle Temp (F):		56.87	0.55
Air Chamber Nozzle Pressure Drop (in Water):	1.332	0.020				
Evaporator Coil Air Pressure Drop (in Water):	0.200	0.007				

Refrigerant Side Conditions						
Expansion Valve						
Upstream Pressure (psia):	258.17	3.898	Ref-side Cap (Btu/h) :		36280.23	2439.34
Upstream Temp (F):	106.25	0.476	Ref-side Cap (tons):		3.02	0.20
			Refrigerant Mdot (lbm/h):		575.01	39.17
			Coriolis Density (lbm/ft3):		82.26	0.77
Upstream R22 Tsat (F):	115.23	1.159				
Average Subcooling (F):	8.98	1.231				
Evap Exit Pressure (psia):	94.11	1.213				
Evap Exit Avg Temp :	57.64	4.189				
Exit Superheat (F):	10.52	3.862				
Evap Exit Tsat (F):	47.13	0.761				

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a031218a.dat SUMMARY FILENAME: a031218a.sum

	Range	Total Air-Side Capacity:	Range
Air-Side Conditions		38226.98	1139.85
Indoor Dry-Bulb : 80.193	0.40	Sensible Cap (Btu/h): 29108.93	735.90
Indoor Inlet Dew (F): 60.613	0.63	Latent Cap (Btu/h): 9118.05	921.08
Indoor Exit Dry-Bulb: 55.959	1.09	EvapAir Delta T (F): 26.11	0.66
Indoor Exit Dew (F): 55.653	0.55	Air/Ref Cap Prcnt Diff: 4.70	2.57
		Sensible Heat Ratio: 0.761	0.0210
Indoor Airflow (CFM): 1001.86	17.80	SCFM per Ton: 317.85	
Indoor Airflow (SCFM): 1012.53	17.34	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011395		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009507		
Barometric Pressure (in HG): 29.65		Nozzle Temp (F): 55.66	0.92
Air Chamber Nozzle Pressure Drop (in Water):	1.339	0.046	
Evaporator Coil Air Pressure Drop (in Water):	0.211	0.006	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 269.72	2.680	Ref-side Cap (Btu/h) :	40021.38 1132.54
Upstream Temp (F): 104.33	0.781	Ref-side Cap (tons):	3.34 0.09
		Refrigerant Mdot (lbm/h):	628.23 17.22
		Coriolis Density (lbm/ft3):	81.73 0.52
Upstream R22 Tsat (F): 118.61	0.771		
Average Subcooling (F): 14.27	0.991		
Evap Exit Pressure (psia): 91.05	1.456		
Evap Exit Avg Temp : 56.59	2.244		
Exit Superheat (F): 11.41	1.933		
Evap Exit Tsat (F): 45.18	0.937		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a031218b.dat SUMMARY FILENAME: a031218b.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	28751.99	1236.15
Indoor Dry-Bulb :	80.040	0.64	Sensible Cap (Btu/h):	23904.52	675.89
Indoor Inlet Dew (F):	60.201	0.85	Latent Cap (Btu/h):	4847.46	1439.20
Indoor Exit Dry-Bulb:	60.446	0.55	EvapAir Delta T (F):	21.55	0.65
Indoor Exit Dew (F):	57.614	0.40	Air/Ref Cap Prcnt Diff:	1.70	10.06
			Sensible Heat Ratio:	0.831	0.0432
Indoor Airflow (CFM):	1004.88	19.23	SCFM per Ton:	420.26	
Indoor Airflow (SCFM):	1006.94	18.75	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011227		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010217		
Barometric Pressure (in HG):	29.65		Nozzle Temp (F):	59.90	0.78
Air Chamber Nozzle Pressure Drop (in Water):			1.336	0.050	
Evaporator Coil Air Pressure Drop (in Water):			0.186	0.006	

Refrigerant Side Conditions					
Expansion Valve					
Upstream Pressure (psia):	263.16	3.898	Ref-side Cap (Btu/h) :	29238.19	2647.34
Upstream Temp (F):	106.15	0.476	Ref-side Cap (tons):	2.44	0.22
			Refrigerant Mdot (lbm/h):	463.18	41.95
			Coriolis Density (lbm/ft3):	82.34	0.44
Upstream R22 Tsat (F):	116.70	1.142			
Average Subcooling (F):	10.55	1.129			
Evap Exit Pressure (psia):	97.30	1.092			
Evap Exit Avg Temp :	60.43	4.243			
Exit Superheat (F):	11.32	4.689			
Evap Exit Tsat (F):	49.11	0.668			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040105a.dat SUMMARY FILENAME: a040105a.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	42951.53	Range	1660.25
Indoor Dry-Bulb :	80.221 0.58	Sensible Cap (Btu/h):	31907.84		1084.17
Indoor Inlet Dew (F):	60.321 0.90	Latent Cap (Btu/h):	11043.69		1769.65
Indoor Exit Dry-Bulb:	53.609 0.78	EvapAir Delta T (F):	28.59		0.88
Indoor Exit Dew (F):	54.113 0.58	Air/Ref Cap Prcnt Diff:	4.12		6.78
		Sensible Heat Ratio:	0.743		0.0319
Indoor Airflow (CFM):	994.75 11.31	SCFM per Ton:	283.38		
Indoor Airflow (SCFM):	1014.32 11.62	(0.075 lb/ft3 standard air)			
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011218				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008935				
Barometric Pressure (in HG):	29.80	Nozzle Temp (F):	53.84	1.11	
Air Chamber Nozzle Pressure Drop (in Water):	1.332		0.030		
Evaporator Coil Air Pressure Drop (in Water):	0.233		0.010		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	247.77	3.289	Ref-side Cap (Btu/h) :	44718.18	2028.31
Upstream Temp (F):	103.08	0.651	Ref-side Cap (tons):	3.73	0.17
			Refrigerant Mdot (lbm/h):	697.60	32.61
			Coriolis Density (lbm/ft3):	81.39	0.58
Upstream R22 Tsat (F):	112.09	1.010			
Average Subcooling (F):	9.01	1.335			
Evap Exit Pressure (psia):	82.17	1.334			
Evap Exit Avg Temp :	55.72	4.586			
Exit Superheat (F):	16.47	4.310			
Evap Exit Tsat (F):	39.25	0.928			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040106a.dat SUMMARY FILENAME: a040106a.sum

		Range		
Air-Side Conditions	Range	Total Air-Side Capacity:	29066.22	1028.82
Indoor Dry-Bulb :	80.127 0.53	Sensible Cap (Btu/h):	23807.89	1479.10
Indoor Inlet Dew (F):	60.391 1.19	Latent Cap (Btu/h):	5258.33	1463.71
Indoor Exit Dry-Bulb:	60.618 0.78	EvapAir Delta T (F):	21.40	1.30
Indoor Exit Dew (F):	57.586 0.55	Air/Ref Cap Prcnt Diff:	-0.33	7.26
		Sensible Heat Ratio:	0.819	0.0450
Indoor Airflow (CFM):	1003.02 11.71	SCFM per Ton:	417.11	
Indoor Airflow (SCFM):	1010.32 11.26	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011239			
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010148			
Barometric Pressure (in HG):	29.82	Nozzle Temp (F):	60.17	0.69
Air Chamber Nozzle Pressure Drop (in Water):	1.337		0.030	
Evaporator Coil Air Pressure Drop (in Water):	0.205		0.006	

Refrigerant Side Conditions				
Expansion Valve				
Upstream Pressure (psia):	277.93	2.680	Ref-side Cap (Btu/h) :	28969.38 2550.83
Upstream Temp (F):	106.41	1.016	Ref-side Cap (tons):	2.41 0.21
			Refrigerant Mdot (lbm/h):	459.52 39.02
			Coriolis Density (lbm/ft3):	82.58 0.25
Upstream R22 Tsat (F):	120.95	0.754		
Average Subcooling (F):	14.53	1.221		
Evap Exit Pressure (psia):	97.68	1.092		
Evap Exit Avg Temp :	60.34	6.253		
Exit Superheat (F):	11.01	5.661		
Evap Exit Tsat (F):	49.33	0.666		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040106b.dat SUMMARY FILENAME: a040106b.sum

		Range	
Air-Side Conditions		Total Air-Side Capacity:	43160.68 1322.97
Indoor Dry-Bulb :	80.200 0.56	Sensible Cap (Btu/h):	31693.62 1212.47
Indoor Inlet Dew (F):	60.615 0.79	Latent Cap (Btu/h):	11467.06 1103.23
Indoor Exit Dry-Bulb:	53.835 0.82	EvapAir Delta T (F):	28.28 0.88
Indoor Exit Dew (F):	54.234 0.88	Air/Ref Cap Prcnt Diff:	3.83 7.30
		Sensible Heat Ratio:	0.734 0.0240
Indoor Airflow (CFM):	998.32 8.90	SCFM per Ton:	283.18
Indoor Airflow (SCFM):	1018.50 9.47	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011330		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008969		
Barometric Pressure (in HG):	29.82	Nozzle Temp (F):	53.90 0.79
Air Chamber Nozzle Pressure Drop (in Water):	1.342	0.024	
Evaporator Coil Air Pressure Drop (in Water):	0.227	0.006	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia):	256.74 6.334	Ref-side Cap (Btu/h) :	44811.32 2412.50
Upstream Temp (F):	105.66 1.212	Ref-side Cap (tons):	3.73 0.20
		Refrigerant Mdot (lbm/h):	708.12 37.74
		Coriolis Density (lbm/ft3):	82.23 0.65
Upstream R22 Tsat (F):	114.80 1.885		
Average Subcooling (F):	9.14 1.941		
Evap Exit Pressure (psia):	83.48 1.698		
Evap Exit Avg Temp :	55.55 6.429		
Exit Superheat (F):	15.39 6.523		
Evap Exit Tsat (F):	40.16 1.166		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040106c.dat SUMMARY FILENAME: a040106c.sum

			Range
Air-Side Conditions	Range	Total Air-Side Capacity:	37684.76 2294.76
Indoor Dry-Bulb :	80.306 0.53	Sensible Cap (Btu/h):	29012.99 1198.92
Indoor Inlet Dew (F):	60.153 1.06	Latent Cap (Btu/h):	8671.77 1663.84
Indoor Exit Dry-Bulb:	56.339 0.90	EvapAir Delta T (F):	25.92 0.88
Indoor Exit Dew (F):	55.373 0.66	Air/Ref Cap Prcnt Diff:	1.68 6.76
		Sensible Heat Ratio:	0.770 0.0305
Indoor Airflow (CFM):	1001.35 10.45	SCFM per Ton:	323.93
Indoor Airflow (SCFM):	1017.26 9.57	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011142		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009355		
Barometric Pressure (in HG):	29.82	Nozzle Temp (F):	55.99 0.88
Air Chamber Nozzle Pressure Drop (in Water):	1.344 0.027		
Evaporator Coil Air Pressure Drop (in Water):	0.217 0.005		

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia):	261.11 2.680	Ref-side Cap (Btu/h) :	38311.76 1857.38
Upstream Temp (F):	105.03 1.061	Ref-side Cap (tons):	3.19 0.15
		Refrigerant Mdot (lbm/h):	603.49 30.41
		Coriolis Density (lbm/ft3):	82.11 0.52
Upstream R22 Tsat (F):	116.10 0.790		
Average Subcooling (F):	11.07 0.938		
Evap Exit Pressure (psia):	89.86 1.456		
Evap Exit Avg Temp :	57.73 3.112		
Exit Superheat (F):	13.31 2.874		
Evap Exit Tsat (F):	44.42 0.945		

Coil 2

R22, A01070, No Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040116a.dat SUMMARY FILENAME: a040116a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	20154.12	Range
Indoor Dry-Bulb :	79.789	0.60	Sensible Cap (Btu/h):	17010.06	488.46
Indoor Inlet Dew (F):	60.417	0.50	Latent Cap (Btu/h):	3144.06	761.03
Indoor Exit Dry-Bulb:	62.508	0.74	EvapAir Delta T (F):	19.09	0.44
Indoor Exit Dew (F):	58.360	0.40	Air/Ref Cap Prcnt Diff:	1.37	3.74
			Sensible Heat Ratio:	0.844	0.0335
Indoor Airflow (CFM):	809.55	6.98	SCFM per Ton:	481.49	
Indoor Airflow (SCFM):	808.66	7.38	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011315		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010499		
Barometric Pressure (in HG):	29.65		Nozzle Temp (F):	61.60	0.91
Air Chamber Nozzle Pressure Drop (in Water):	0.866		0.015		
Evaporator Coil Air Pressure Drop (in Water):	0.075		0.005		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	262.38	1.340	Ref-side Cap (Btu/h) :	20429.82	535.58
Upstream Temp (F):	103.41	0.677	Ref-side Cap (tons):	1.70	0.04
			Refrigerant Mdot (lbm/h):	319.23	9.16
			Coriolis Density (lbm/ft3):	81.95	0.16
Upstream R22 Tsat (F):	116.47	0.394			
Average Subcooling (F):	13.06	0.505			
Evap Exit Pressure (psia):	90.62	0.485			
Evap Exit Avg Temp :	59.63	1.905			
Exit Superheat (F):	14.72	2.148			
Evap Exit Tsat (F):	44.91	0.313			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040116a.dat SUMMARY FILENAME: a040116a.sum

	Range		Range
Air-Side Conditions		Total Air-Side Capacity: 20154.12	719.94
Indoor Dry-Bulb : 79.789	0.60	Sensible Cap (Btu/h): 17010.06	488.46
Indoor Inlet Dew (F): 60.417	0.50	Latent Cap (Btu/h): 3144.06	761.03
Indoor Exit Dry-Bulb: 62.508	0.74	EvapAir Delta T (F): 19.09	0.44
Indoor Exit Dew (F): 58.360	0.40	Air/Ref Cap Prcnt Diff: 1.37	3.74
		Sensible Heat Ratio: 0.844	0.0335
Indoor Airflow (CFM): 809.55	6.98	SCFM per Ton: 481.49	
Indoor Airflow (SCFM): 808.66	7.38	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011315		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010499		
Barometric Pressure (in HG): 29.65		Nozzle Temp (F): 61.60	0.91
Air Chamber Nozzle Pressure Drop (in Water):	0.866	0.015	
Evaporator Coil Air Pressure Drop (in Water):	0.075	0.005	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 262.38	1.340	Ref-side Cap (Btu/h) :	20429.82 535.58
Upstream Temp (F): 103.41	0.677	Ref-side Cap (tons):	1.70 0.04
		Refrigerant Mdot (lbm/h):	319.23 9.16
		Coriolis Density (lbm/ft3):	81.95 0.16
Upstream R22 Tsat (F): 116.47	0.394		
Average Subcooling (F): 13.06	0.505		
Evap Exit Pressure (psia): 90.62	0.485		
Evap Exit Avg Temp : 59.63	1.905		
Exit Superheat (F): 14.72	2.148		
Evap Exit Tsat (F): 44.91	0.313		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040116b.dat SUMMARY FILENAME: a040116b.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	12918.77	Range
Indoor Dry-Bulb :	79.796	0.56	Sensible Cap (Btu/h):	12648.04	554.30
Indoor Inlet Dew (F):	60.435	0.84	Latent Cap (Btu/h):	270.73	1125.53
Indoor Exit Dry-Bulb:	67.321	0.86	EvapAir Delta T (F):	14.26	0.65
Indoor Exit Dew (F):	60.263	0.66	Air/Ref Cap Prcnt Diff:	1.07	6.01
			Sensible Heat Ratio:	0.979	0.0856
Indoor Airflow (CFM):	813.14	9.68	SCFM per Ton:	747.34	
Indoor Airflow (SCFM):	804.56	9.01	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011322		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.011251		
Barometric Pressure (in HG):	29.65		Nozzle Temp (F):	66.36	1.64
Air Chamber Nozzle Pressure Drop (in Water):			0.866	0.020	
Evaporator Coil Air Pressure Drop (in Water):			0.066	0.005	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	264.15	0.731	Ref-side Cap (Btu/h) :	13054.22	511.78
Upstream Temp (F):	104.96	0.542	Ref-side Cap (tons):	1.09	0.04
			Refrigerant Mdot (lbm/h):	205.56	8.43
			Coriolis Density (lbm/ft3):	82.60	0.32
Upstream R22 Tsat (F):	116.99	0.214			
Average Subcooling (F):	12.03	0.614			
Evap Exit Pressure (psia):	97.48	1.092			
Evap Exit Avg Temp :	65.53	1.224			
Exit Superheat (F):	16.32	1.741			
Evap Exit Tsat (F):	49.21	0.666			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040119a.dat SUMMARY FILENAME: a040119a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 24917.81	Range
Indoor Dry-Bulb :	79.836	0.39	Sensible Cap (Btu/h): 19597.48	514.71
Indoor Inlet Dew (F):	60.327	0.80	Latent Cap (Btu/h): 5320.33	650.76
Indoor Exit Dry-Bulb:	59.747	0.72	EvapAir Delta T (F): 21.91	0.44
Indoor Exit Dew (F):	56.767	0.50	Air/Ref Cap Prcnt Diff: 2.24	3.20
			Sensible Heat Ratio: 0.787	0.0238
Indoor Airflow (CFM):	808.89	8.66	SCFM per Ton: 391.26	
Indoor Airflow (SCFM):	812.44	8.25	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011277	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009905	
Barometric Pressure (in HG):	29.65		Nozzle Temp (F): 58.93	0.65
Air Chamber Nozzle Pressure Drop (in Water):			0.869	0.018
Evaporator Coil Air Pressure Drop (in Water):			0.078	0.006

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	267.30	0.974	Ref-side Cap (Btu/h) :	25473.46	406.33
Upstream Temp (F):	105.31	0.610	Ref-side Cap (tons):	2.12	0.03
			Refrigerant Mdot (lbm/h):	401.83	6.23
			Coriolis Density (lbm/ft3):	82.41	0.36
Upstream R22 Tsat (F):	117.91	0.282			
Average Subcooling (F):	12.60	0.661			
Evap Exit Pressure (psia):	83.58	0.485			
Evap Exit Avg Temp :	54.97	2.180			
Exit Superheat (F):	14.74	2.108			
Evap Exit Tsat (F):	40.22	0.333			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040119b.dat SUMMARY FILENAME: a040119b.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	20189.62	1211.57
Indoor Dry-Bulb :	79.724	0.56	Sensible Cap (Btu/h):	16949.08	903.59
Indoor Inlet Dew (F):	60.387	1.22	Latent Cap (Btu/h):	3240.53	1052.94
Indoor Exit Dry-Bulb:	62.620	0.61	EvapAir Delta T (F):	19.01	0.87
Indoor Exit Dew (F):	58.265	0.66	Air/Ref Cap Prcnt Diff:	0.36	7.19
			Sensible Heat Ratio:	0.840	0.0486
Indoor Airflow (CFM):	810.32	9.82	SCFM per Ton:	481.09	
Indoor Airflow (SCFM):	809.42	9.70	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011302				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010463				
Barometric Pressure (in HG):	29.65		Nozzle Temp (F):	61.61	0.55
Air Chamber Nozzle Pressure Drop (in Water):	0.868	0.021			
Evaporator Coil Air Pressure Drop (in Water):	0.075	0.004			

Refrigerant Side Conditions					
Expansion Valve					
Upstream Pressure (psia):	265.97	1.462	Ref-side Cap (Btu/h) :	20258.54	775.30
Upstream Temp (F):	105.55	0.519	Ref-side Cap (tons):	1.69	0.06
			Refrigerant Mdot (lbm/h):	319.95	11.72
			Coriolis Density (lbm/ft3):	82.53	0.56
Upstream R22 Tsat (F):	117.52	0.425			
Average Subcooling (F):	11.97	0.670			
Evap Exit Pressure (psia):	90.71	0.607			
Evap Exit Avg Temp :	59.55	1.869			
Exit Superheat (F):	14.58	1.791			
Evap Exit Tsat (F):	44.97	0.391			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040121a.dat SUMMARY FILENAME: a040121a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	13113.32	Range
Indoor Dry-Bulb :	80.145	0.30	Sensible Cap (Btu/h):	12617.08	431.95
Indoor Inlet Dew (F):	60.711	0.69	Latent Cap (Btu/h):	496.25	974.54
Indoor Exit Dry-Bulb:	67.736	0.55	EvapAir Delta T (F):	14.16	0.44
Indoor Exit Dew (F):	60.395	0.53	Air/Ref Cap Prcnt Diff:	-3.01	8.47
			Sensible Heat Ratio:	0.963	0.0714
Indoor Airflow (CFM):	809.05	8.27	SCFM per Ton:	739.70	
Indoor Airflow (SCFM):	808.33	8.12	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011319		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.011190		
Barometric Pressure (in HG):	29.95		Nozzle Temp (F):	66.56	0.72
Air Chamber Nozzle Pressure Drop (in Water):			0.865	0.017	
Evaporator Coil Air Pressure Drop (in Water):			0.066	0.006	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	259.38	1.218	Ref-side Cap (Btu/h) :	12712.62	464.37
Upstream Temp (F):	104.33	0.435	Ref-side Cap (tons):	1.06	0.04
			Refrigerant Mdot (lbm/h):	199.55	7.33
			Coriolis Density (lbm/ft3):	82.36	0.16
Upstream R22 Tsat (F):	115.59	0.361			
Average Subcooling (F):	11.26	0.607			
Evap Exit Pressure (psia):	99.70	0.607			
Evap Exit Avg Temp :	65.65	0.892			
Exit Superheat (F):	15.10	1.143			
Evap Exit Tsat (F):	50.56	0.365			

Coil 3

R22, A01148, No Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040205a.dat SUMMARY FILENAME: a040205a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 41040.73	Range
Indoor Dry-Bulb :	79.463	0.23	Sensible Cap (Btu/h): 27659.16	1364.36
Indoor Inlet Dew (F):	60.632	0.44	Latent Cap (Btu/h): 13381.57	873.81
Indoor Exit Dry-Bulb:	55.072	0.38	EvapAir Delta T (F): 26.26	655.21
Indoor Exit Dew (F):	52.370	0.41	Air/Ref Cap Prcnt Diff: 2.87	0.44
			Sensible Heat Ratio: 0.674	4.66
				0.0119
Indoor Airflow (CFM):	929.07	19.21	SCFM per Ton: 280.16	
Indoor Airflow (SCFM):	958.17	19.81	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011184		
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.008256		
Barometric Pressure (in HG):	30.22		Nozzle Temp (F): 55.25	0.88
Air Chamber Nozzle Pressure Drop (in Water):	1.175	0.048		
Evaporator Coil Air Pressure Drop (in Water):	0.358	0.016		

Refrigerant Side Conditions

Expansion Valve				
Upstream Pressure (psia):	273.51	2.193	Ref-side Cap (Btu/h) :	42213.99 650.68
Upstream Temp (F):	105.26	0.520	Ref-side Cap (tons):	3.52 0.05
			Refrigerant Mdot (lbm/h):	665.74 10.62
			Coriolis Density (lbm/ft3):	82.17 0.33
Upstream R22 Tsat (F):	119.69	0.625		
Average Subcooling (F):	14.43	0.947		
Evap Exit Pressure (psia):	83.57	0.728		
Evap Exit Avg Temp :	57.45	2.513		
Exit Superheat (F):	17.24	2.347		
Evap Exit Tsat (F):	40.22	0.498		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040209a.dat SUMMARY FILENAME: a040209a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	30896.46	Range
Indoor Dry-Bulb :	79.728	0.51	Sensible Cap (Btu/h):	22952.69	764.15
Indoor Inlet Dew (F):	60.549	0.38	Latent Cap (Btu/h):	7943.77	517.21
Indoor Exit Dry-Bulb:	59.655	0.39	EvapAir Delta T (F):	22.04	0.86
Indoor Exit Dew (F):	55.835	0.32	Air/Ref Cap Prcnt Diff:	-1.06	2.84
			Sensible Heat Ratio:	0.743	0.0153
Indoor Airflow (CFM):	925.27	13.65	SCFM per Ton:	367.48	
Indoor Airflow (SCFM):	946.16	13.96	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011135		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009375		
Barometric Pressure (in HG):	30.26		Nozzle Temp (F):	60.01	0.28
Air Chamber Nozzle Pressure Drop (in Water):	1.156		0.034		
Evaporator Coil Air Pressure Drop (in Water):	0.348		0.012		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	267.52	0.731	Ref-side Cap (Btu/h) :	30568.21	436.20
Upstream Temp (F):	104.48	0.480	Ref-side Cap (tons):	2.55	0.04
			Refrigerant Mdot (lbm/h):	480.19	7.69
			Coriolis Density (lbm/ft3):	81.94	0.38
Upstream R22 Tsat (F):	117.97	0.212			
Average Subcooling (F):	13.49	0.586			
Evap Exit Pressure (psia):	97.44	0.485			
Evap Exit Avg Temp :	60.39	2.736			
Exit Superheat (F):	11.20	2.884			
Evap Exit Tsat (F):	49.19	0.297			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040209b.dat SUMMARY FILENAME: a040209b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 41393.85	Range
Indoor Dry-Bulb :	80.019	0.52	Sensible Cap (Btu/h): 27938.72	683.02
Indoor Inlet Dew (F):	60.502	0.30	Latent Cap (Btu/h): 13455.14	489.03
Indoor Exit Dry-Bulb:	55.085	0.39	EvapAir Delta T (F): 26.72	0.44
Indoor Exit Dew (F):	52.064	0.34	Air/Ref Cap Prcnt Diff: -0.24	2.76
			Sensible Heat Ratio: 0.675	0.0102
Indoor Airflow (CFM):	920.26	12.52	SCFM per Ton: 275.80	
Indoor Airflow (SCFM):	951.37	12.85	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011116	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008151	
Barometric Pressure (in HG):	30.26		Nozzle Temp (F): 54.73	0.65
Air Chamber Nozzle Pressure Drop (in Water):	1.156		0.031	
Evaporator Coil Air Pressure Drop (in Water):	0.349		0.014	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	274.99	1.340	Ref-side Cap (Btu/h) :	41292.35	720.00
Upstream Temp (F):	105.87	0.909	Ref-side Cap (tons):	3.44	0.06
			Refrigerant Mdot (lbm/h):	653.21	10.26
			Coriolis Density (lbm/ft3):	82.34	0.60
Upstream R22 Tsat (F):	120.11	0.380			
Average Subcooling (F):	14.24	1.163			
Evap Exit Pressure (psia):	83.38	0.971			
Evap Exit Avg Temp :	53.47	4.966			
Exit Superheat (F):	13.38	4.716			
Evap Exit Tsat (F):	40.09	0.667			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040210a.dat SUMMARY FILENAME: a040210a.sum

				Range
Air-Side Conditions	Range	Total Air-Side Capacity:	35323.45	1001.75
Indoor Dry-Bulb :	79.862 0.41	Sensible Cap (Btu/h):	24841.59	604.71
Indoor Inlet Dew (F):	60.568 0.68	Latent Cap (Btu/h):	10481.86	1001.13
Indoor Exit Dry-Bulb:	57.472 0.54	EvapAir Delta T (F):	24.22	0.65
Indoor Exit Dew (F):	54.086 0.29	Air/Ref Cap Prcnt Diff:	3.52	4.05
		Sensible Heat Ratio:	0.703	0.0216
Indoor Airflow (CFM):	906.77 6.99	SCFM per Ton:	316.85	
Indoor Airflow (SCFM):	932.67 7.17	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011150			
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008794			
Barometric Pressure (in HG):	30.24	Nozzle Temp (F):	56.84	0.75
Air Chamber Nozzle Pressure Drop (in Water):	1.117 0.017			
Evaporator Coil Air Pressure Drop (in Water):	0.334 0.007			

Refrigerant Side Conditions				
Expansion Valve				
Upstream Pressure (psia):	268.66 0.974	Ref-side Cap (Btu/h) :	36563.86	598.74
Upstream Temp (F):	104.33 0.498	Ref-side Cap (tons):	3.05	0.05
		Refrigerant Mdot (lbm/h):	573.95	9.71
		Coriolis Density (lbm/ft3):	81.89	0.36
Upstream R22 Tsat (F):	118.30 0.281			
Average Subcooling (F):	13.97 0.508			
Evap Exit Pressure (psia):	90.59 0.485			
Evap Exit Avg Temp :	59.09 2.837			
Exit Superheat (F):	14.20 2.837			
Evap Exit Tsat (F):	44.89 0.313			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040211a.dat SUMMARY FILENAME: a040211a.sum

	Range	Total Air-Side Capacity:	Range
Air-Side Conditions		28797.52	635.22
Indoor Dry-Bulb : 79.830	0.53	Sensible Cap (Btu/h): 22212.84	940.77
Indoor Inlet Dew (F): 60.172	0.50	Latent Cap (Btu/h): 6584.67	551.13
Indoor Exit Dry-Bulb: 60.467	0.32	EvapAir Delta T (F): 21.15	0.86
Indoor Exit Dew (F): 56.318	0.29	Air/Ref Cap Prcnt Diff: 0.04	2.65
		Sensible Heat Ratio: 0.771	0.0215
Indoor Airflow (CFM): 936.15	14.99	SCFM per Ton: 397.62	
Indoor Airflow (SCFM): 954.21	15.48	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011025		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009579		
Barometric Pressure (in HG): 30.15		Nozzle Temp (F): 59.73	0.65
Air Chamber Nozzle Pressure Drop (in Water):	1.180	0.038	
Evaporator Coil Air Pressure Drop (in Water):	0.340	0.010	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 266.91	0.853	Ref-side Cap (Btu/h) : 28808.32	546.01
Upstream Temp (F): 104.74	0.367	Ref-side Cap (tons): 2.40	0.05
		Refrigerant Mdot (lbm/h): 453.13	8.79
		Coriolis Density (lbm/ft3): 82.05	0.40
Upstream R22 Tsat (F): 117.80	0.247		
Average Subcooling (F): 13.06	0.367		
Evap Exit Pressure (psia): 98.26	0.607		
Evap Exit Avg Temp : 62.18	2.732		
Exit Superheat (F): 12.49	2.732		
Evap Exit Tsat (F): 49.69	0.369		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040211b.dat SUMMARY FILENAME: a040211b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 36747.94	Range
Indoor Dry-Bulb :	80.029	0.45	Sensible Cap (Btu/h): 25913.75	789.39
Indoor Inlet Dew (F):	60.367	0.36	Latent Cap (Btu/h): 10834.19	926.16
Indoor Exit Dry-Bulb:	57.210	0.23	EvapAir Delta T (F): 24.69	457.19
Indoor Exit Dew (F):	53.785	0.32	Air/Ref Cap Prcnt Diff: -0.41	0.65
			Sensible Heat Ratio: 0.705	3.06
				0.0118
Indoor Airflow (CFM):	930.35	10.67	SCFM per Ton: 311.64	
Indoor Airflow (SCFM):	954.35	12.08	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011103	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008723	
Barometric Pressure (in HG):	30.15		Nozzle Temp (F): 56.70	0.60
Air Chamber Nozzle Pressure Drop (in Water):	1.172		0.028	
Evaporator Coil Air Pressure Drop (in Water):	0.343		0.012	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.10	0.974	Ref-side Cap (Btu/h) :	36596.26	594.50
Upstream Temp (F):	104.40	0.520	Ref-side Cap (tons):	3.05	0.05
			Refrigerant Mdot (lbm/h):	574.65	9.71
			Coriolis Density (lbm/ft3):	81.89	0.19
Upstream R22 Tsat (F):	118.43	0.281			
Average Subcooling (F):	14.03	0.731			
Evap Exit Pressure (psia):	90.35	0.728			
Evap Exit Avg Temp :	56.66	3.573			
Exit Superheat (F):	11.93	3.494			
Evap Exit Tsat (F):	44.73	0.471			

Coil 4 **R22, A01138, No Fan**

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040219x.dat SUMMARY FILENAME: a040219x.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	26783.74	Range	1883.79
Indoor Dry-Bulb :	79.733	0.75	Sensible Cap (Btu/h):	18268.01		480.03
Indoor Inlet Dew (F):	60.591	0.85	Latent Cap (Btu/h):	8515.73		1438.99
Indoor Exit Dry-Bulb:	60.736	0.27	EvapAir Delta T (F):	20.89		0.44
Indoor Exit Dew (F):	54.512	0.22	Air/Ref Cap Prcnt Diff:	-3.06		7.01
			Sensible Heat Ratio:	0.682		0.0356
Indoor Airflow (CFM):	784.16	9.68	SCFM per Ton:	356.16		
Indoor Airflow (SCFM):	794.93	10.13	(0.075 lb/ft3 standard air)			
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011259				
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.009013				
Barometric Pressure (in HG):	29.98		Nozzle Temp (F):	60.11	0.55	
Air Chamber Nozzle Pressure Drop (in Water):	0.825	0.020				
Evaporator Coil Air Pressure Drop (in Water):	0.103	0.005				

Refrigerant Side Conditions						
Expansion Valve						
Upstream Pressure (psia):	272.62	0.974	Ref-side Cap (Btu/h) :	25954.80		364.19
Upstream Temp (F):	106.07	0.198	Ref-side Cap (tons):	2.16		0.03
			Refrigerant Mdot (lbm/h):	410.99		5.50
			Coriolis Density (lbm/ft3):	82.36		0.16
Upstream R22 Tsat (F):	119.44	0.278				
Average Subcooling (F):	13.37	0.301				
Evap Exit Pressure (psia):	82.89	0.485				
Evap Exit Avg Temp :	53.49	3.724				
Exit Superheat (F):	13.74	3.640				
Evap Exit Tsat (F):	39.75	0.335				

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040223a.dat SUMMARY FILENAME: a040223a.sum

Air-Side Conditions	Range	Total Air-Side Capacity: 22035.41	Range
Indoor Dry-Bulb : 79.831	0.38	Sensible Cap (Btu/h): 16037.57	564.10
Indoor Inlet Dew (F): 60.757	0.25	Latent Cap (Btu/h): 5997.85	366.03
Indoor Exit Dry-Bulb: 63.300	0.29	EvapAir Delta T (F): 18.31	0.43
Indoor Exit Dew (F): 56.680	0.24	Air/Ref Cap Prcnt Diff: -1.11	3.19
		Sensible Heat Ratio: 0.728	0.0115
Indoor Airflow (CFM): 797.03	14.29	SCFM per Ton: 433.12	
Indoor Airflow (SCFM): 795.33	14.25	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011454		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009873		
Barometric Pressure (in HG): 29.65		Nozzle Temp (F): 62.30	0.82
Air Chamber Nozzle Pressure Drop (in Water):	0.839	0.030	
Evaporator Coil Air Pressure Drop (in Water):	0.102	0.008	

 Refrigerant Side Conditions

Expansion Valve			
Upstream Pressure (psia):	271.21	0.731	Ref-side Cap (Btu/h) : 21790.52 420.49
Upstream Temp (F):	104.30	0.520	Ref-side Cap (tons): 1.82 0.04
			Refrigerant Mdot (lbm/h): 342.00 6.96
			Coriolis Density (lbm/ft3): 82.11 0.16
Upstream R22 Tsat (F):	119.04	0.209	
Average Subcooling (F):	14.73	0.614	
Evap Exit Pressure (psia):	90.96	0.243	
Evap Exit Avg Temp :	56.93	4.399	
Exit Superheat (F):	11.80	4.399	
Evap Exit Tsat (F):	45.12	0.156	

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040225a.dat SUMMARY FILENAME: a040225a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	18269.45	1171.80
Indoor Dry-Bulb :	80.022	0.51	Sensible Cap (Btu/h):	14746.16	529.64
Indoor Inlet Dew (F):	60.413	0.20	Latent Cap (Btu/h):	3523.29	695.37
Indoor Exit Dry-Bulb:	64.826	0.28	EvapAir Delta T (F):	16.93	0.43
Indoor Exit Dew (F):	58.000	0.61	Air/Ref Cap Prcnt Diff:	-3.42	5.96
			Sensible Heat Ratio:	0.807	0.0264
Indoor Airflow (CFM):	782.66	8.87	SCFM per Ton:	519.44	
Indoor Airflow (SCFM):	790.82	9.75	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011122				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010188				
Barometric Pressure (in HG):	30.15		Nozzle Temp (F):	64.41	0.64
Air Chamber Nozzle Pressure Drop (in Water):	0.819	0.019			
Evaporator Coil Air Pressure Drop (in Water):	0.101	0.006			

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	267.89	0.487	Ref-side Cap (Btu/h) :	17640.72	256.55
Upstream Temp (F):	104.71	0.520	Ref-side Cap (tons):	1.47	0.02
			Refrigerant Mdot (lbm/h):	277.43	4.21
			Coriolis Density (lbm/ft3):	82.22	0.16
Upstream R22 Tsat (F):	118.08	0.141			
Average Subcooling (F):	13.37	0.590			
Evap Exit Pressure (psia):	97.83	0.243			
Evap Exit Avg Temp :	62.27	0.682			
Exit Superheat (F):	12.84	0.694			
Evap Exit Tsat (F):	49.43	0.148			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040226x.dat SUMMARY FILENAME: a040226x.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 22162.66	Range
Indoor Dry-Bulb :	79.824	0.48	Sensible Cap (Btu/h): 16293.07	746.55
Indoor Inlet Dew (F):	60.511	0.30	Latent Cap (Btu/h): 5869.59	683.39
Indoor Exit Dry-Bulb:	62.849	0.23	EvapAir Delta T (F): 18.75	264.85
Indoor Exit Dew (F):	56.419	0.24	Air/Ref Cap Prcnt Diff: -2.32	0.65
			Sensible Heat Ratio: 0.735	4.07
				0.0134
Indoor Airflow (CFM):	783.74	11.71	SCFM per Ton: 427.28	
Indoor Airflow (SCFM):	789.14	11.92	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011249	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009689	
Barometric Pressure (in HG):	29.92		Nozzle Temp (F): 62.38	0.74
Air Chamber Nozzle Pressure Drop (in Water):			0.819	0.024
Evaporator Coil Air Pressure Drop (in Water):			0.102	0.006

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.24	0.731	Ref-side Cap (Btu/h) :	21646.36	359.14
Upstream Temp (F):	105.78	0.649	Ref-side Cap (tons):	1.80	0.03
			Refrigerant Mdot (lbm/h):	342.26	5.68
			Coriolis Density (lbm/ft3):	82.45	0.22
Upstream R22 Tsat (F):	118.47	0.211			
Average Subcooling (F):	12.69	0.511			
Evap Exit Pressure (psia):	90.58	0.243			
Evap Exit Avg Temp :	59.46	0.975			
Exit Superheat (F):	14.58	1.131			
Evap Exit Tsat (F):	44.88	0.157			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040225b.dat SUMMARY FILENAME: b040225b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 26781.23	Range
Indoor Dry-Bulb :	80.166	0.54	Sensible Cap (Btu/h): 18704.64	613.34
Indoor Inlet Dew (F):	60.286	0.36	Latent Cap (Btu/h): 8076.59	295.67
Indoor Exit Dry-Bulb:	60.610	0.30	EvapAir Delta T (F): 21.40	0.44
Indoor Exit Dew (F):	54.447	0.26	Air/Ref Cap Prcnt Diff: -2.53	4.62
			Sensible Heat Ratio: 0.698	0.0098
Indoor Airflow (CFM):	779.61	15.74	SCFM per Ton: 356.06	
Indoor Airflow (SCFM):	794.65	16.13	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011071	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008940	
Barometric Pressure (in HG):	30.15		Nozzle Temp (F): 60.23	0.76
Air Chamber Nozzle Pressure Drop (in Water):			0.820	0.033
Evaporator Coil Air Pressure Drop (in Water):			0.105	0.009

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	270.17	0.974	Ref-side Cap (Btu/h) :	26102.18	1283.93
Upstream Temp (F):	106.27	0.609	Ref-side Cap (tons):	2.18	0.11
			Refrigerant Mdot (lbm/h):	413.75	20.15
			Coriolis Density (lbm/ft3):	82.51	0.32
Upstream R22 Tsat (F):	118.74	0.280			
Average Subcooling (F):	12.47	0.542			
Evap Exit Pressure (psia):	83.86	0.485			
Evap Exit Avg Temp :	54.70	3.049			
Exit Superheat (F):	14.28	3.049			
Evap Exit Tsat (F):	40.41	0.332			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040226b.dat SUMMARY FILENAME: b040226b.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	16953.69	Range
Indoor Dry-Bulb : 80.011	0.45	Sensible Cap (Btu/h):	14077.80	482.68
Indoor Inlet Dew (F): 60.711	0.16	Latent Cap (Btu/h):	2875.89	368.36
Indoor Exit Dry-Bulb: 65.498	0.29	EvapAir Delta T (F):	16.19	0.43
Indoor Exit Dew (F): 58.787	0.25	Air/Ref Cap Prcnt Diff:	-2.57	4.27
		Sensible Heat Ratio:	0.830	0.0187
Indoor Airflow (CFM): 788.03	16.16	SCFM per Ton:	558.45	
Indoor Airflow (SCFM): 788.99	15.66	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011330			
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010566			
Barometric Pressure (in HG): 29.92		Nozzle Temp (F):	65.08	0.69
Air Chamber Nozzle Pressure Drop (in Water):	0.823		0.033	
Evaporator Coil Air Pressure Drop (in Water):	0.099		0.005	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	271.82	0.487	Ref-side Cap (Btu/h) :	16516.48	372.06
Upstream Temp (F):	104.56	0.366	Ref-side Cap (tons):	1.38	0.03
			Refrigerant Mdot (lbm/h):	259.56	5.68
			Coriolis Density (lbm/ft3):	82.29	0.10
Upstream R22 Tsat (F):	119.21	0.139			
Average Subcooling (F):	14.65	0.463			
Evap Exit Pressure (psia):	99.80	0.485			
Evap Exit Avg Temp :	63.23	0.685			
Exit Superheat (F):	12.61	0.938			
Evap Exit Tsat (F):	50.62	0.291			

Coil 5
R22, A01060, Fan: 273 Watts

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040302a.dat SUMMARY FILENAME: a040302a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 27580.34	Range
Indoor Dry-Bulb :	80.145	0.29	Sensible Cap (Btu/h): 18827.50	513.83
Indoor Inlet Dew (F):	60.357	0.36	Latent Cap (Btu/h): 8752.84	468.87
Indoor Exit Dry-Bulb:	59.345	0.23	EvapAir Delta T (F): 22.72	0.44
Indoor Exit Dew (F):	53.644	0.22	Air/Ref Cap Prcnt Diff: -1.58	4.17
			Sensible Heat Ratio: 0.683	0.0121
Indoor Airflow (CFM):	740.22	7.76	SCFM per Ton: 327.76	
Indoor Airflow (SCFM):	753.31	7.78	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011164		
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.008728		
Barometric Pressure (in HG):	29.98		Nozzle Temp (F): 58.15	0.32
Air Chamber Nozzle Pressure Drop (in Water):	0.739	0.015		
Evaporator Coil Air Pressure Drop (in Water):	0.124	0.028		

Refrigerant Side Conditions

Expansion Valve				
Upstream Pressure (psia):	268.54	0.731	Ref-side Cap (Btu/h) :	27142.87 616.61
Upstream Temp (F):	105.08	0.584	Ref-side Cap (tons):	2.26 0.05
			Refrigerant Mdot (lbm/h):	427.67 9.16
			Coriolis Density (lbm/ft3):	82.27 0.29
Upstream R22 Tsat (F):	118.27	0.211		
Average Subcooling (F):	13.19	0.661		
Evap Exit Pressure (psia):	90.74	0.485		
Evap Exit Avg Temp :	59.50	2.420		
Exit Superheat (F):	14.52	2.420		
Evap Exit Tsat (F):	44.99	0.313		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040303a.dat SUMMARY FILENAME: a040303a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 32329.27	Range
Indoor Dry-Bulb :	80.024	0.52	Sensible Cap (Btu/h): 20840.09	612.93
Indoor Inlet Dew (F):	60.435	0.21	Latent Cap (Btu/h): 11489.18	334.36
Indoor Exit Dry-Bulb:	56.983	0.27	EvapAir Delta T (F): 24.98	0.44
Indoor Exit Dew (F):	51.431	0.18	Air/Ref Cap Prcnt Diff: -0.37	2.91
			Sensible Heat Ratio: 0.645	0.0055
Indoor Airflow (CFM):	745.45	9.82	SCFM per Ton: 281.75	
Indoor Airflow (SCFM):	759.07	9.93	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011245	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008071	
Barometric Pressure (in HG):	29.85		Nozzle Temp (F): 55.80	0.42
Air Chamber Nozzle Pressure Drop (in Water):			0.749	0.020
Evaporator Coil Air Pressure Drop (in Water):			0.136	0.041

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.50	1.218	Ref-side Cap (Btu/h) :	32208.02	435.83
Upstream Temp (F):	104.63	0.910	Ref-side Cap (tons):	2.68	0.04
			Refrigerant Mdot (lbm/h):	506.34	6.41
			Coriolis Density (lbm/ft3):	81.99	0.30
Upstream R22 Tsat (F):	118.55	0.351			
Average Subcooling (F):	13.91	1.170			
Evap Exit Pressure (psia):	83.54	0.607			
Evap Exit Avg Temp :	52.65	6.498			
Exit Superheat (F):	12.45	6.498			
Evap Exit Tsat (F):	40.20	0.416			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040304a.dat SUMMARY FILENAME: a040304a.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	27488.36	Range
Indoor Dry-Bulb : 79.846	0.71	Sensible Cap (Btu/h):	18592.08	788.83
Indoor Inlet Dew (F): 60.399	0.31	Latent Cap (Btu/h):	8896.27	337.31
Indoor Exit Dry-Bulb: 59.306	0.39	EvapAir Delta T (F):	22.46	0.87
Indoor Exit Dew (F): 53.625	0.36	Air/Ref Cap Prcnt Diff:	-1.74	3.39
		Sensible Heat Ratio:	0.676	0.0109
Indoor Airflow (CFM): 746.16	7.72	SCFM per Ton:	328.46	
Indoor Airflow (SCFM): 752.41	7.79	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011269			
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008790			
Barometric Pressure (in HG): 29.75		Nozzle Temp (F):	58.88	0.37
Air Chamber Nozzle Pressure Drop (in Water):	0.744		0.015	
Evaporator Coil Air Pressure Drop (in Water):	0.140		0.024	

Refrigerant Side Conditions				
Expansion Valve				
Upstream Pressure (psia):	269.51	1.096	Ref-side Cap (Btu/h) :	27008.54 440.01
Upstream Temp (F):	104.56	0.520	Ref-side Cap (tons):	2.25 0.04
			Refrigerant Mdot (lbm/h):	424.44 6.59
			Coriolis Density (lbm/ft3):	82.02 0.38
Upstream R22 Tsat (F):	118.55	0.316		
Average Subcooling (F):	13.99	0.598		
Evap Exit Pressure (psia):	90.05	0.243		
Evap Exit Avg Temp :	59.41	5.210		
Exit Superheat (F):	14.87	5.052		
Evap Exit Tsat (F):	44.54	0.157		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040303b.dat SUMMARY FILENAME: b040303b.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	23217.01	Range
Indoor Dry-Bulb :	79.842	0.67	Sensible Cap (Btu/h):	16981.94	465.27
Indoor Inlet Dew (F):	60.418	0.12	Latent Cap (Btu/h):	6235.07	176.50
Indoor Exit Dry-Bulb:	61.269	0.35	EvapAir Delta T (F):	20.49	0.43
Indoor Exit Dew (F):	55.823	0.20	Air/Ref Cap Prcnt Diff:	-1.71	2.83
			Sensible Heat Ratio:	0.731	0.0106
Indoor Airflow (CFM):	747.39	4.97	SCFM per Ton:	389.23	
Indoor Airflow (SCFM):	753.05	5.01	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011238				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009502				
Barometric Pressure (in HG):	29.85		Nozzle Temp (F):	60.81	0.64
Air Chamber Nozzle Pressure Drop (in Water):	0.745	0.010			
Evaporator Coil Air Pressure Drop (in Water):	0.146	0.014			

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	272.97	0.853	Ref-side Cap (Btu/h) :	22818.98	413.37
Upstream Temp (F):	104.56	0.416	Ref-side Cap (tons):	1.90	0.03
			Refrigerant Mdot (lbm/h):	358.60	6.78
			Coriolis Density (lbm/ft3):	82.08	0.37
Upstream R22 Tsat (F):	119.54	0.243			
Average Subcooling (F):	14.98	0.448			
Evap Exit Pressure (psia):	98.39	0.485			
Evap Exit Avg Temp :	64.17	1.260			
Exit Superheat (F):	14.40	1.260			
Evap Exit Tsat (F):	49.77	0.294			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040305a.dat SUMMARY FILENAME: a040305a.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	32479.54	Range	1003.87
Indoor Dry-Bulb :	79.740 0.52	Sensible Cap (Btu/h):	20659.92		970.81
Indoor Inlet Dew (F):	60.443 0.46	Latent Cap (Btu/h):	11819.62		344.26
Indoor Exit Dry-Bulb:	56.551 0.39	EvapAir Delta T (F):	24.94		1.08
Indoor Exit Dew (F):	51.099 0.32	Air/Ref Cap Prcnt Diff:	-0.93		3.45
		Sensible Heat Ratio:	0.636		0.0130
Indoor Airflow (CFM):	743.16 7.82	SCFM per Ton:	278.47		
Indoor Airflow (SCFM):	753.71 7.68	(0.075 lb/ft3 standard air)			
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011286				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.007999				
Barometric Pressure (in HG):	29.75	Nozzle Temp (F):	56.13	0.55	
Air Chamber Nozzle Pressure Drop (in Water):	0.742		0.015		
Evaporator Coil Air Pressure Drop (in Water):	0.151		0.028		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.37	0.853	Ref-side Cap (Btu/h) :	32175.10	333.48
Upstream Temp (F):	104.35	0.967	Ref-side Cap (tons):	2.68	0.03
			Refrigerant Mdot (lbm/h):	505.11	5.68
			Coriolis Density (lbm/ft3):	81.88	0.33
Upstream R22 Tsat (F):	118.51	0.246			
Average Subcooling (F):	14.16	1.177			
Evap Exit Pressure (psia):	83.93	0.364			
Evap Exit Avg Temp :	54.32	3.954			
Exit Superheat (F):	13.86	3.954			
Evap Exit Tsat (F):	40.46	0.249			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040308a.dat SUMMARY FILENAME: a040308a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 22605.73	Range
Indoor Dry-Bulb :	79.710	0.39	Sensible Cap (Btu/h): 16356.36	521.66
Indoor Inlet Dew (F):	60.687	0.30	Latent Cap (Btu/h): 6249.36	502.56
Indoor Exit Dry-Bulb:	61.590	0.11	EvapAir Delta T (F): 19.86	290.00
Indoor Exit Dew (F):	56.086	0.16	Air/Ref Cap Prcnt Diff: -1.31	0.43
			Sensible Heat Ratio: 0.724	2.36
				0.0103
Indoor Airflow (CFM):	742.04	6.90	SCFM per Ton: 397.08	
Indoor Airflow (SCFM):	748.02	6.88	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011336	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009585	
Barometric Pressure (in HG):	29.88		Nozzle Temp (F): 61.04	0.10
Air Chamber Nozzle Pressure Drop (in Water):			0.735	0.013
Evaporator Coil Air Pressure Drop (in Water):			0.161	0.015

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	270.28	0.731	Ref-side Cap (Btu/h) :	22309.53	298.84
Upstream Temp (F):	105.69	0.237	Ref-side Cap (tons):	1.86	0.02
			Refrigerant Mdot (lbm/h):	352.58	4.76
			Coriolis Density (lbm/ft3):	82.32	0.18
Upstream R22 Tsat (F):	118.77	0.210			
Average Subcooling (F):	13.08	0.386			
Evap Exit Pressure (psia):	98.45	0.364			
Evap Exit Avg Temp :	63.73	0.793			
Exit Superheat (F):	13.92	0.657			
Evap Exit Tsat (F):	49.81	0.221			

Coil 6
R22, A01125, Fan: 768 Watts

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: c040406c.dat SUMMARY FILENAME: c040406c.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 37805.35	Range
Indoor Dry-Bulb :	79.347	3.97	Sensible Cap (Btu/h): 26735.16	4315.08
Indoor Inlet Dew (F):	60.944	0.45	Latent Cap (Btu/h): 11070.19	1947.82
Indoor Exit Dry-Bulb:	60.804	1.28	EvapAir Delta T (F): 20.91	3.44
Indoor Exit Dew (F):	55.682	1.19	Air/Ref Cap Prcnt Diff: -0.44	13.23
			Sensible Heat Ratio: 0.707	0.0418
Indoor Airflow (CFM):	1149.21	25.49	SCFM per Ton: 368.71	
Indoor Airflow (SCFM):	1161.61	28.57	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011438		
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.009440		
Barometric Pressure (in HG):	29.89		Nozzle Temp (F): 60.06	1.13
Air Chamber Nozzle Pressure Drop (in Water):	0.918	0.043		
Evaporator Coil Air Pressure Drop (in Water):	1.700	0.000		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	266.79	3.350	Ref-side Cap (Btu/h) :	37608.27	993.66
Upstream Temp (F):	104.78	1.051	Ref-side Cap (tons):	3.13	0.08
			Refrigerant Mdot (lbm/h):	591.66	13.92
			Coriolis Density (lbm/ft3):	81.51	0.28
Upstream R22 Tsat (F):	117.76	0.973			
Average Subcooling (F):	12.98	1.617			
Evap Exit Pressure (psia):	101.49	1.638			
Evap Exit Avg Temp :	65.58	5.368			
Exit Superheat (F):	13.95	4.545			
Evap Exit Tsat (F):	51.63	0.974			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040407a.dat SUMMARY FILENAME: a040407a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	43850.60	5098.57
Indoor Dry-Bulb :	79.491	3.63	Sensible Cap (Btu/h):	29605.56	5146.04
Indoor Inlet Dew (F):	60.528	0.70	Latent Cap (Btu/h):	14245.04	1882.32
Indoor Exit Dry-Bulb:	58.585	1.12	EvapAir Delta T (F):	23.15	3.89
Indoor Exit Dew (F):	53.483	1.08	Air/Ref Cap Prcnt Diff:	0.37	13.50
			Sensible Heat Ratio:	0.675	0.0485
Indoor Airflow (CFM):	1144.88	18.17	SCFM per Ton:	318.18	
Indoor Airflow (SCFM):	1162.70	18.00	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011283		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008714		
Barometric Pressure (in HG):	29.85		Nozzle Temp (F):	57.15	1.38
Air Chamber Nozzle Pressure Drop (in Water):			0.915	0.029	
Evaporator Coil Air Pressure Drop (in Water):			1.700	0.000	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	268.66	2.741	Ref-side Cap (Btu/h) :	43985.34	1308.50
Upstream Temp (F):	105.44	1.872	Ref-side Cap (tons):	3.67	0.11
			Refrigerant Mdot (lbm/h):	694.28	21.62
			Coriolis Density (lbm/ft3):	81.89	0.33
Upstream R22 Tsat (F):	118.30	0.791			
Average Subcooling (F):	12.87	1.662			
Evap Exit Pressure (psia):	95.81	1.395			
Evap Exit Avg Temp :	62.16	4.507			
Exit Superheat (F):	13.98	3.719			
Evap Exit Tsat (F):	48.19	0.864			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: d040406d.dat SUMMARY FILENAME: d040406d.sum

	Range	Total Air-Side Capacity:	Range
Air-Side Conditions		37704.09	1035.50
Indoor Dry-Bulb : 79.017	0.79	Sensible Cap (Btu/h): 26399.92	873.21
Indoor Inlet Dew (F): 61.007	0.41	Latent Cap (Btu/h): 11304.17	631.67
Indoor Exit Dry-Bulb: 60.679	0.43	EvapAir Delta T (F): 20.73	0.76
Indoor Exit Dew (F): 55.613	0.34	Air/Ref Cap Prcnt Diff: -0.30	3.53
		Sensible Heat Ratio: 0.700	0.0088
Indoor Airflow (CFM): 1143.97	24.09	SCFM per Ton: 368.25	
Indoor Airflow (SCFM): 1157.04	24.16	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011464		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009416		
Barometric Pressure (in HG): 29.89		Nozzle Temp (F): 59.74	0.64
Air Chamber Nozzle Pressure Drop (in Water):	0.910	0.038	
Evaporator Coil Air Pressure Drop (in Water):	1.700	0.000	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 266.07	0.670	Ref-side Cap (Btu/h) :	37587.47 526.25
Upstream Temp (F): 104.36	0.401	Ref-side Cap (tons):	3.13 0.04
		Refrigerant Mdot (lbm/h):	590.11 7.69
		Coriolis Density (lbm/ft3):	81.47 0.27
Upstream R22 Tsat (F): 117.55	0.195		
Average Subcooling (F): 13.19	0.542		
Evap Exit Pressure (psia): 101.34	0.485		
Evap Exit Avg Temp : 65.33	1.689		
Exit Superheat (F): 13.80	1.545		
Evap Exit Tsat (F): 51.54	0.288		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040402.dat SUMMARY FILENAME: a040402.sum

			Range
Air-Side Conditions	Range	Total Air-Side Capacity: 40037.46	1134.23
Indoor Dry-Bulb : 79.643	0.37	Sensible Cap (Btu/h): 28653.79	899.47
Indoor Inlet Dew (F): 60.353	0.49	Latent Cap (Btu/h): 11383.68	598.35
Indoor Exit Dry-Bulb: 59.392	0.35	EvapAir Delta T (F): 22.52	0.55
Indoor Exit Dew (F): 54.835	0.37	Air/Ref Cap Prcnt Diff: 0.26	3.31
		Sensible Heat Ratio: 0.716	0.0107
Indoor Airflow (CFM): 1150.15	21.70	SCFM per Ton: 346.57	
Indoor Airflow (SCFM): 1156.30	21.69	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011288		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009225		
Barometric Pressure (in HG): 29.65		Nozzle Temp (F): 58.74	0.46
Air Chamber Nozzle Pressure Drop (in Water):	0.915	0.034	
Evaporator Coil Air Pressure Drop (in Water):	1.715	0.000	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 269.74	1.157	Ref-side Cap (Btu/h) : 40140.11	525.17
Upstream Temp (F): 104.20	0.668	Ref-side Cap (tons): 3.35	0.04
		Refrigerant Mdot (lbm/h): 629.67	7.24
		Coriolis Density (lbm/ft3): 81.40	0.19
Upstream R22 Tsat (F): 118.61	0.333		
Average Subcooling (F): 14.41	0.720		
Evap Exit Pressure (psia): 97.93	0.667		
Evap Exit Avg Temp : 63.23	0.965		
Exit Superheat (F): 13.74	0.708		
Evap Exit Tsat (F): 49.49	0.406		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040406a.dat SUMMARY FILENAME: a040406a.sum

	Range	Total Air-Side Capacity:	Range
Air-Side Conditions		28898.20	1928.90
Indoor Dry-Bulb : 79.742	0.41	Sensible Cap (Btu/h): 23756.23	986.39
Indoor Inlet Dew (F): 60.351	0.22	Latent Cap (Btu/h): 5141.97	2225.49
Indoor Exit Dry-Bulb: 63.430	0.22	EvapAir Delta T (F): 18.63	0.75
Indoor Exit Dew (F): 57.963	1.02	Air/Ref Cap Prcnt Diff: -0.64	7.75
		Sensible Heat Ratio: 0.822	0.0644
Indoor Airflow (CFM): 1149.71	20.13	SCFM per Ton: 480.72	
Indoor Airflow (SCFM): 1157.67	19.85	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011195		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010264		
Barometric Pressure (in HG): 29.89		Nozzle Temp (F): 61.80	0.46
Air Chamber Nozzle Pressure Drop (in Water):	0.915	0.031	
Evaporator Coil Air Pressure Drop (in Water):	1.700	0.000	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 274.96	1.279	Ref-side Cap (Btu/h) :	28706.78 937.54
Upstream Temp (F): 105.07	0.511	Ref-side Cap (tons):	2.39 0.08
		Refrigerant Mdot (lbm/h):	452.28 14.65
		Coriolis Density (lbm/ft3):	81.89 0.38
Upstream R22 Tsat (F): 120.10	0.363		
Average Subcooling (F): 15.04	0.649		
Evap Exit Pressure (psia): 107.81	0.303		
Evap Exit Avg Temp : 70.32	0.946		
Exit Superheat (F): 15.03	0.948		
Evap Exit Tsat (F): 55.29	0.172		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040402b.dat SUMMARY FILENAME: b040402b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 39504.41	Range
Indoor Dry-Bulb :	79.763	0.63	Sensible Cap (Btu/h): 28482.79	688.71
Indoor Inlet Dew (F):	60.350	0.36	Latent Cap (Btu/h): 11021.62	799.76
Indoor Exit Dry-Bulb:	59.632	0.26	EvapAir Delta T (F): 22.39	0.43
Indoor Exit Dew (F):	55.021	0.24	Air/Ref Cap Prcnt Diff: 0.42	1.91
			Sensible Heat Ratio: 0.721	0.0173
Indoor Airflow (CFM):	1150.36	15.38	SCFM per Ton: 351.11	
Indoor Airflow (SCFM):	1155.87	15.45	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011287	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009288	
Barometric Pressure (in HG):	29.65		Nozzle Temp (F): 59.01	0.32
Air Chamber Nozzle Pressure Drop (in Water):			0.915	0.024
Evaporator Coil Air Pressure Drop (in Water):			1.715	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.24	0.974	Ref-side Cap (Btu/h) :	39670.12	616.85
Upstream Temp (F):	104.51	0.652	Ref-side Cap (tons):	3.31	0.05
			Refrigerant Mdot (lbm/h):	623.27	9.62
			Coriolis Density (lbm/ft3):	81.43	0.27
Upstream R22 Tsat (F):	118.47	0.281			
Average Subcooling (F):	13.96	0.793			
Evap Exit Pressure (psia):	98.41	0.485			
Evap Exit Avg Temp :	63.64	0.929			
Exit Superheat (F):	13.86	0.709			
Evap Exit Tsat (F):	49.78	0.294			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040407b.dat SUMMARY FILENAME: b040407b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 29255.90	Range
Indoor Dry-Bulb :	79.329	0.59	Sensible Cap (Btu/h): 22885.70	580.88
Indoor Inlet Dew (F):	60.954	0.52	Latent Cap (Btu/h): 6370.21	425.88
Indoor Exit Dry-Bulb:	63.454	0.37	EvapAir Delta T (F): 18.12	0.22
Indoor Exit Dew (F):	58.003	0.42	Air/Ref Cap Prcnt Diff: 1.42	2.38
			Sensible Heat Ratio: 0.782	0.0113
Indoor Airflow (CFM):	1140.82	24.11	SCFM per Ton: 470.27	
Indoor Airflow (SCFM):	1146.51	24.02	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011457	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010293	
Barometric Pressure (in HG):	29.85		Nozzle Temp (F): 62.10	0.62
Air Chamber Nozzle Pressure Drop (in Water):			0.900	0.038
Evaporator Coil Air Pressure Drop (in Water):			1.700	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	273.21	1.340	Ref-side Cap (Btu/h) :	29670.07	566.32
Upstream Temp (F):	104.45	0.510	Ref-side Cap (tons):	2.47	0.05
			Refrigerant Mdot (lbm/h):	466.02	8.15
			Coriolis Density (lbm/ft3):	81.61	0.36
Upstream R22 Tsat (F):	119.61	0.382			
Average Subcooling (F):	15.15	0.739			
Evap Exit Pressure (psia):	108.49	0.607			
Evap Exit Avg Temp :	67.60	1.244			
Exit Superheat (F):	11.92	1.107			
Evap Exit Tsat (F):	55.68	0.342			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040410a.dat SUMMARY FILENAME: a040410a.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	41868.75	Range	1269.75
Indoor Dry-Bulb :	80.137 0.67	Sensible Cap (Btu/h):	29034.75		990.29
Indoor Inlet Dew (F):	60.569 0.12	Latent Cap (Btu/h):	12834.01		529.88
Indoor Exit Dry-Bulb:	59.695 0.19	EvapAir Delta T (F):	22.68		0.54
Indoor Exit Dew (F):	54.315 0.11	Air/Ref Cap Prcnt Diff:	0.57		5.66
		Sensible Heat Ratio:	0.693		0.0079
Indoor Airflow (CFM):	1148.39 30.81	SCFM per Ton:	333.47		
Indoor Airflow (SCFM):	1163.50 31.34	(0.075 lb/ft3 standard air)			
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011299				
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008987				
Barometric Pressure (in HG):	29.85	Nozzle Temp (F):	58.29	0.44	
Air Chamber Nozzle Pressure Drop (in Water):	0.919		0.049		
Evaporator Coil Air Pressure Drop (in Water):	1.635		0.000		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	271.76	1.218	Ref-side Cap (Btu/h) :	42104.06	1447.15
Upstream Temp (F):	105.80	0.768	Ref-side Cap (tons):	3.51	0.12
			Refrigerant Mdot (lbm/h):	665.81	23.54
			Coriolis Density (lbm/ft3):	82.00	0.58
Upstream R22 Tsat (F):	119.19	0.349			
Average Subcooling (F):	13.39	0.856			
Evap Exit Pressure (psia):	98.72	0.303			
Evap Exit Avg Temp :	62.09	1.047			
Exit Superheat (F):	12.13	1.002			
Evap Exit Tsat (F):	49.97	0.184			

Coil 7

R22, H5326, No Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040506a.dat SUMMARY FILENAME: a040506a.sum

Air-Side Conditions	Range	Total Air-Side Capacity: 29842.95	Range
Indoor Dry-Bulb : 80.478	0.22	Sensible Cap (Btu/h): 24549.15	280.91
Indoor Inlet Dew (F): 60.104	0.10	Latent Cap (Btu/h): 5293.80	294.40
Indoor Exit Dry-Bulb: 64.374	0.12	EvapAir Delta T (F): 18.49	140.99
Indoor Exit Dew (F): 57.725	0.07	Air/Ref Cap Prcnt Diff: -1.65	0.11
		Sensible Heat Ratio: 0.823	2.38
			0.0044
Indoor Airflow (CFM): 1203.06	9.21	SCFM per Ton: 484.88	
Indoor Airflow (SCFM): 1205.86	9.40	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011097		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010177		
Barometric Pressure (in HG): 29.88		Nozzle Temp (F): 63.84	0.46
Air Chamber Nozzle Pressure Drop (in Water):	0.997	0.015	
Evaporator Coil Air Pressure Drop (in Water):	0.224	0.010	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia): 269.40	0.487	Ref-side Cap (Btu/h) : 29350.36	597.02
Upstream Temp (F): 104.63	0.304	Ref-side Cap (tons): 2.45	0.05
		Refrigerant Mdot (lbm/h): 461.40	8.79
		Coriolis Density (lbm/ft3): 81.70	0.33
Upstream R22 Tsat (F): 118.51	0.140		
Average Subcooling (F): 13.89	0.363		
Evap Exit Pressure (psia): 84.38	0.303		
Evap Exit Avg Temp : 52.33	1.624		
Exit Superheat (F): 11.56	1.537		
Evap Exit Tsat (F): 40.77	0.206		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040507a.dat SUMMARY FILENAME: a040507a.sum

			Range
Air-Side Conditions	Range	Total Air-Side Capacity: 25857.20	551.41
Indoor Dry-Bulb : 79.848	0.35	Sensible Cap (Btu/h): 22239.56	436.75
Indoor Inlet Dew (F): 60.543	0.10	Latent Cap (Btu/h): 3617.64	217.35
Indoor Exit Dry-Bulb: 65.465	0.23	EvapAir Delta T (F): 16.75	0.00
Indoor Exit Dew (F): 58.962	0.11	Air/Ref Cap Prcnt Diff: -1.85	2.08
		Sensible Heat Ratio: 0.860	0.0073
Indoor Airflow (CFM): 1206.00	22.60	SCFM per Ton: 559.05	
Indoor Airflow (SCFM): 1204.62	23.63	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011289		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010659		
Barometric Pressure (in HG): 29.85		Nozzle Temp (F): 64.90	0.46
Air Chamber Nozzle Pressure Drop (in Water):	0.999	0.038	
Evaporator Coil Air Pressure Drop (in Water):	0.221	0.010	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 272.58	0.731	Ref-side Cap (Btu/h) : 25378.56	556.29
Upstream Temp (F): 105.77	0.300	Ref-side Cap (tons): 2.11	0.05
		Refrigerant Mdot (lbm/h): 401.25	8.61
		Coriolis Density (lbm/ft3): 82.11	0.16
Upstream R22 Tsat (F): 119.43	0.209		
Average Subcooling (F): 13.66	0.282		
Evap Exit Pressure (psia): 90.38	0.364		
Evap Exit Avg Temp : 56.10	0.960		
Exit Superheat (F): 11.35	0.862		
Evap Exit Tsat (F): 44.75	0.235		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040510a.dat SUMMARY FILENAME: a040510a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 22002.44	Range
Indoor Dry-Bulb :	79.966	0.46	Sensible Cap (Btu/h): 20601.59	599.35
Indoor Inlet Dew (F):	60.200	0.06	Latent Cap (Btu/h): 1400.84	220.96
Indoor Exit Dry-Bulb:	66.622	0.23	EvapAir Delta T (F): 15.54	0.43
Indoor Exit Dew (F):	59.592	0.06	Air/Ref Cap Prcnt Diff: -4.94	3.95
			Sensible Heat Ratio: 0.936	0.0094
Indoor Airflow (CFM):	1210.01	17.49	SCFM per Ton: 656.15	
Indoor Airflow (SCFM):	1203.07	17.29	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011188	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010943	
Barometric Pressure (in HG):	29.75		Nozzle Temp (F): 65.48	0.59
Air Chamber Nozzle Pressure Drop (in Water):	1.001		0.029	
Evaporator Coil Air Pressure Drop (in Water):	0.215		0.008	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	266.78	2.071	Ref-side Cap (Btu/h) :	20914.67	485.59
Upstream Temp (F):	104.31	0.680	Ref-side Cap (tons):	1.74	0.04
			Refrigerant Mdot (lbm/h):	328.26	7.24
			Coriolis Density (lbm/ft3):	81.79	0.31
Upstream R22 Tsat (F):	117.76	0.601			
Average Subcooling (F):	13.45	0.686			
Evap Exit Pressure (psia):	98.08	0.546			
Evap Exit Avg Temp :	63.42	1.807			
Exit Superheat (F):	13.85	1.659			
Evap Exit Tsat (F):	49.58	0.332			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040513a.dat SUMMARY FILENAME: a040513a.sum

Air-Side Conditions	Range	Total Air-Side Capacity: 29846.20	Range
Indoor Dry-Bulb : 79.918	0.24	Sensible Cap (Btu/h): 24101.01	316.28
Indoor Inlet Dew (F): 60.550	0.10	Latent Cap (Btu/h): 5745.19	232.49
Indoor Exit Dry-Bulb: 64.014	0.17	EvapAir Delta T (F): 18.08	0.11
Indoor Exit Dew (F): 58.012	0.08	Air/Ref Cap Prcnt Diff: -0.50	3.91
		Sensible Heat Ratio: 0.808	0.0063
Indoor Airflow (CFM): 1207.72	16.23	SCFM per Ton: 486.62	
Indoor Airflow (SCFM): 1210.32	15.90	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011291		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010296		
Barometric Pressure (in HG): 29.85		Nozzle Temp (F): 63.29	0.62
Air Chamber Nozzle Pressure Drop (in Water):	1.005	0.027	
Evaporator Coil Air Pressure Drop (in Water):	0.219	0.010	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia): 272.31	0.487	Ref-side Cap (Btu/h) : 29695.17	974.02
Upstream Temp (F): 104.46	0.455	Ref-side Cap (tons): 2.47	0.08
		Refrigerant Mdot (lbm/h): 466.43	15.02
		Coriolis Density (lbm/ft3): 81.86	1.27
Upstream R22 Tsat (F): 119.35	0.139		
Average Subcooling (F): 14.89	0.525		
Evap Exit Pressure (psia): 83.66	0.485		
Evap Exit Avg Temp : 55.15	1.583		
Exit Superheat (F): 14.88	1.532		
Evap Exit Tsat (F): 40.28	0.333		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040507b.dat SUMMARY FILENAME: b040507b.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	21930.45	Range
Indoor Dry-Bulb : 79.714	0.18	Sensible Cap (Btu/h):	20248.31	583.25
Indoor Inlet Dew (F): 60.607	0.15	Latent Cap (Btu/h):	1682.14	604.31
Indoor Exit Dry-Bulb: 66.684	0.24	EvapAir Delta T (F):	15.32	243.13
Indoor Exit Dew (F): 59.882	0.08	Air/Ref Cap Prcnt Diff:	-5.72	0.33
		Sensible Heat Ratio:	0.923	3.59
				0.0096
Indoor Airflow (CFM): 1206.24	18.32	SCFM per Ton:	656.24	
Indoor Airflow (SCFM): 1199.31	18.21	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011350			
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.011055			
Barometric Pressure (in HG): 29.76		Nozzle Temp (F):	65.62	0.14
Air Chamber Nozzle Pressure Drop (in Water):	0.995		0.030	
Evaporator Coil Air Pressure Drop (in Water):	0.214		0.009	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	268.75	0.731	Ref-side Cap (Btu/h) :	20674.47	475.79
Upstream Temp (F):	105.77	0.454	Ref-side Cap (tons):	1.72	0.04
			Refrigerant Mdot (lbm/h):	326.88	6.78
			Coriolis Density (lbm/ft3):	82.22	0.16
Upstream R22 Tsat (F):	118.33	0.211			
Average Subcooling (F):	12.56	0.584			
Evap Exit Pressure (psia):	98.92	0.182			
Evap Exit Avg Temp :	63.26	0.613			
Exit Superheat (F):	13.17	0.613			
Evap Exit Tsat (F):	50.09	0.110			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040511b.dat SUMMARY FILENAME: b040511b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 25476.71	Range
Indoor Dry-Bulb :	80.144	0.24	Sensible Cap (Btu/h): 21755.04	534.33
Indoor Inlet Dew (F):	60.483	0.06	Latent Cap (Btu/h): 3721.67	200.30
Indoor Exit Dry-Bulb:	65.840	0.17	EvapAir Delta T (F): 16.35	0.22
Indoor Exit Dew (F):	58.853	0.03	Air/Ref Cap Prcnt Diff: -3.61	2.99
			Sensible Heat Ratio: 0.854	0.0060
Indoor Airflow (CFM):	1207.11	13.97	SCFM per Ton: 568.77	
Indoor Airflow (SCFM):	1207.54	13.81	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011245	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010599	
Barometric Pressure (in HG):	29.90		Nozzle Temp (F): 65.02	0.19
Air Chamber Nozzle Pressure Drop (in Water):			1.002	0.023
Evaporator Coil Air Pressure Drop (in Water):			0.213	0.009

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	271.40	0.731	Ref-side Cap (Btu/h) :	24555.06	415.26
Upstream Temp (F):	106.02	0.354	Ref-side Cap (tons):	2.05	0.03
			Refrigerant Mdot (lbm/h):	388.73	6.59
			Coriolis Density (lbm/ft3):	82.22	0.41
Upstream R22 Tsat (F):	119.09	0.209			
Average Subcooling (F):	13.07	0.224			
Evap Exit Pressure (psia):	90.93	0.303			
Evap Exit Avg Temp :	58.19	1.001			
Exit Superheat (F):	13.08	1.080			
Evap Exit Tsat (F):	45.11	0.195			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040513b.dat SUMMARY FILENAME: b040513b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 29800.83	Range
Indoor Dry-Bulb :	79.832	0.30	Sensible Cap (Btu/h): 24060.94	455.45
Indoor Inlet Dew (F):	60.562	0.05	Latent Cap (Btu/h): 5739.89	441.52
Indoor Exit Dry-Bulb:	63.937	0.19	EvapAir Delta T (F): 18.06	112.39
Indoor Exit Dew (F):	58.025	0.05	Air/Ref Cap Prcnt Diff: -1.08	0.21
			Sensible Heat Ratio: 0.807	3.85
				0.0048
Indoor Airflow (CFM):	1206.87	15.11	SCFM per Ton: 486.99	
Indoor Airflow (SCFM):	1209.38	15.22	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011296	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010301	
Barometric Pressure (in HG):	29.85		Nozzle Temp (F): 63.32	0.46
Air Chamber Nozzle Pressure Drop (in Water):			1.003	0.025
Evaporator Coil Air Pressure Drop (in Water):			0.219	0.008

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	272.41	0.731	Ref-side Cap (Btu/h) :	29478.53	993.29
Upstream Temp (F):	104.49	0.828	Ref-side Cap (tons):	2.46	0.08
			Refrigerant Mdot (lbm/h):	463.10	14.01
			Coriolis Density (lbm/ft3):	81.72	1.00
Upstream R22 Tsat (F):	119.38	0.209			
Average Subcooling (F):	14.89	0.849			
Evap Exit Pressure (psia):	83.74	0.303			
Evap Exit Avg Temp :	54.77	1.352			
Exit Superheat (F):	14.43	1.352			
Evap Exit Tsat (F):	40.33	0.208			

Coil 8

R22, H5321, No Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040521a.dat SUMMARY FILENAME: a040521a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 34023.81	Range
Indoor Dry-Bulb :	80.133	0.15	Sensible Cap (Btu/h): 29126.82	981.82
Indoor Inlet Dew (F):	60.562	0.02	Latent Cap (Btu/h): 4896.99	115.91
Indoor Exit Dry-Bulb:	63.116	0.15	EvapAir Delta T (F): 19.15	0.43
Indoor Exit Dew (F):	58.688	0.03	Air/Ref Cap Prcnt Diff: 9.58	3.56
			Sensible Heat Ratio: 0.856	0.0036
Indoor Airflow (CFM):	1375.64	17.99	SCFM per Ton: 486.97	
Indoor Airflow (SCFM):	1380.73	17.33	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011300		
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.010557		
Barometric Pressure (in HG):	29.84		Nozzle Temp (F): 62.11	0.60
Air Chamber Nozzle Pressure Drop (in Water):	1.304	0.033		
Evaporator Coil Air Pressure Drop (in Water):	0.312	0.015		

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	265.11	0.670	Ref-side Cap (Btu/h) :	37280.82	519.41
Upstream Temp (F):	106.24	0.313	Ref-side Cap (tons):	3.11	0.04
			Refrigerant Mdot (lbm/h):	590.85	8.43
			Coriolis Density (lbm/ft3):	72.75	0.43
Upstream R22 Tsat (F):	117.27	0.195			
Average Subcooling (F):	11.03	0.384			
Evap Exit Pressure (psia):	90.52	0.243			
Evap Exit Avg Temp :	56.58	1.512			
Exit Superheat (F):	11.74	1.521			
Evap Exit Tsat (F):	44.84	0.157			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040525a.dat SUMMARY FILENAME: a040525a.sum

	Range		Range
Air-Side Conditions		Total Air-Side Capacity: 41587.87	912.40
Indoor Dry-Bulb : 80.121	0.31	Sensible Cap (Btu/h): 32532.92	869.32
Indoor Inlet Dew (F): 60.483	0.06	Latent Cap (Btu/h): 9054.96	215.10
Indoor Exit Dry-Bulb: 60.967	0.15	EvapAir Delta T (F): 21.33	0.43
Indoor Exit Dew (F): 56.923	0.05	Air/Ref Cap Prcnt Diff: 2.90	2.82
		Sensible Heat Ratio: 0.782	0.0054
Indoor Airflow (CFM): 1373.54	11.26	SCFM per Ton: 399.68	
Indoor Airflow (SCFM): 1385.14	11.42	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011265		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009894		
Barometric Pressure (in HG): 29.85		Nozzle Temp (F): 60.03	0.16
Air Chamber Nozzle Pressure Drop (in Water):	1.306	0.021	
Evaporator Coil Air Pressure Drop (in Water):	0.316	0.008	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 269.25	0.853	Ref-side Cap (Btu/h) :	42791.57 751.47
Upstream Temp (F): 106.11	0.273	Ref-side Cap (tons):	3.57 0.06
		Refrigerant Mdot (lbm/h):	677.74 12.09
		Coriolis Density (lbm/ft3):	82.42 0.75
Upstream R22 Tsat (F): 118.47	0.246		
Average Subcooling (F): 12.36	0.273		
Evap Exit Pressure (psia): 84.72	0.243		
Evap Exit Avg Temp : 53.52	2.057		
Exit Superheat (F): 12.52	2.016		
Evap Exit Tsat (F): 41.00	0.165		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040526a.dat SUMMARY FILENAME: a040526a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 29513.51	Range
Indoor Dry-Bulb :	79.841	0.15	Sensible Cap (Btu/h): 25443.70	480.65
Indoor Inlet Dew (F):	60.427	0.06	Latent Cap (Btu/h): 4069.81	460.28
Indoor Exit Dry-Bulb:	65.396	0.18	EvapAir Delta T (F): 16.71	275.45
Indoor Exit Dew (F):	58.878	0.08	Air/Ref Cap Prcnt Diff: -3.10	0.22
			Sensible Heat Ratio: 0.862	2.06
				0.0083
Indoor Airflow (CFM):	1388.51	16.29	SCFM per Ton: 561.88	
Indoor Airflow (SCFM):	1381.91	16.94	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011291	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.010674	
Barometric Pressure (in HG):	29.72		Nozzle Temp (F): 64.39	0.34
Air Chamber Nozzle Pressure Drop (in Water):			1.317	0.031
Evaporator Coil Air Pressure Drop (in Water):			0.312	0.016

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	269.95	0.731	Ref-side Cap (Btu/h) :	28597.29	566.54
Upstream Temp (F):	105.86	0.390	Ref-side Cap (tons):	2.38	0.05
			Refrigerant Mdot (lbm/h):	452.35	8.52
			Coriolis Density (lbm/ft3):	82.50	0.25
Upstream R22 Tsat (F):	118.67	0.210			
Average Subcooling (F):	12.82	0.390			
Evap Exit Pressure (psia):	97.57	0.364			
Evap Exit Avg Temp :	64.00	1.240			
Exit Superheat (F):	14.73	1.388			
Evap Exit Tsat (F):	49.27	0.222			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040527a.dat SUMMARY FILENAME: a040527a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	1434.02
Indoor Dry-Bulb :	80.055	0.17	Sensible Cap (Btu/h):	33072.64
Indoor Inlet Dew (F):	60.304	0.60	Latent Cap (Btu/h):	8648.66
Indoor Exit Dry-Bulb:	60.780	0.20	EvapAir Delta T (F):	21.55
Indoor Exit Dew (F):	56.914	0.09	Air/Ref Cap Prcnt Diff:	3.26
			Sensible Heat Ratio:	0.793
				0.0305
Indoor Airflow (CFM):	1381.48	15.68	SCFM per Ton:	400.82
Indoor Airflow (SCFM):	1393.57	15.10	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011192	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009890	
Barometric Pressure (in HG):	29.85		Nozzle Temp (F):	59.86
				0.53
Air Chamber Nozzle Pressure Drop (in Water):	1.321		0.029	
Evaporator Coil Air Pressure Drop (in Water):	0.318		0.014	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	267.87	0.731	Ref-side Cap (Btu/h) :	43077.28	1092.28
Upstream Temp (F):	105.13	0.543	Ref-side Cap (tons):	3.59	0.09
			Refrigerant Mdot (lbm/h):	678.91	17.22
			Coriolis Density (lbm/ft3):	82.18	0.34
Upstream R22 Tsat (F):	118.07	0.211			
Average Subcooling (F):	12.94	0.684			
Evap Exit Pressure (psia):	84.34	0.485			
Evap Exit Avg Temp :	55.85	1.507			
Exit Superheat (F):	15.11	1.507			
Evap Exit Tsat (F):	40.74	0.330			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040527b.dat SUMMARY FILENAME: b040527b.sum

	Range	Total Air-Side Capacity:	Range
Air-Side Conditions		41707.19	1020.24
Indoor Dry-Bulb : 79.862	0.19	Sensible Cap (Btu/h): 32752.75	819.05
Indoor Inlet Dew (F): 60.391	0.07	Latent Cap (Btu/h): 8954.44	263.78
Indoor Exit Dry-Bulb: 60.734	0.09	EvapAir Delta T (F): 21.32	0.32
Indoor Exit Dew (F): 56.888	0.03	Air/Ref Cap Prcnt Diff: 3.12	3.21
		Sensible Heat Ratio: 0.785	0.0048
Indoor Airflow (CFM): 1382.69	15.13	SCFM per Ton: 401.39	
Indoor Airflow (SCFM): 1395.06	15.46	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011227		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.009881		
Barometric Pressure (in HG): 29.85		Nozzle Temp (F): 59.77	0.14
Air Chamber Nozzle Pressure Drop (in Water):	1.324	0.029	
Evaporator Coil Air Pressure Drop (in Water):	0.317	0.012	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 268.09	0.731	Ref-side Cap (Btu/h) : 43005.16	831.09
Upstream Temp (F): 105.41	0.294	Ref-side Cap (tons): 3.58	0.07
		Refrigerant Mdot (lbm/h): 678.73	12.46
		Coriolis Density (lbm/ft3): 82.29	0.47
Upstream R22 Tsat (F): 118.14	0.211		
Average Subcooling (F): 12.72	0.343		
Evap Exit Pressure (psia): 84.17	0.243		
Evap Exit Avg Temp : 54.43	1.860		
Exit Superheat (F): 13.81	1.943		
Evap Exit Tsat (F): 40.63	0.165		

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040603a.dat SUMMARY FILENAME: a040603a.sum

	Range		Range
Air-Side Conditions		Total Air-Side Capacity:	34980.44
Indoor Dry-Bulb : 80.150	0.25	Sensible Cap (Btu/h):	29184.59
Indoor Inlet Dew (F): 60.541	0.06	Latent Cap (Btu/h):	5795.86
Indoor Exit Dry-Bulb: 63.310	0.17	EvapAir Delta T (F):	18.99
Indoor Exit Dew (F): 58.331	0.24	Air/Ref Cap Prcnt Diff:	2.84
		Sensible Heat Ratio:	0.834
			0.0126
Indoor Airflow (CFM): 1390.38	10.12	SCFM per Ton:	478.63
Indoor Airflow (SCFM): 1395.23	10.23		(0.075 lb/ft3 standard air)
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011288		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010417		
Barometric Pressure (in HG): 29.85		Nozzle Temp (F):	62.44
			0.46
Air Chamber Nozzle Pressure Drop (in Water):	1.331		0.019
Evaporator Coil Air Pressure Drop (in Water):	0.312		0.009

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia):	273.51	0.792	Ref-side Cap (Btu/h) : 35974.64
Upstream Temp (F):	105.60	0.455	Ref-side Cap (tons): 3.00
			0.05
			Refrigerant Mdot (lbm/h): 568.32
			9.62
			Coriolis Density (lbm/ft3): 82.41
			0.16
Upstream R22 Tsat (F):	119.69	0.225	
Average Subcooling (F):	14.09	0.620	
Evap Exit Pressure (psia):	91.83	0.425	
Evap Exit Avg Temp :	57.65	1.747	
Exit Superheat (F):	11.96	1.747	
Evap Exit Tsat (F):	45.69	0.271	

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040607a.dat SUMMARY FILENAME: a040607a.sum

			Range
Air-Side Conditions	Range	Total Air-Side Capacity: 27090.45	778.33
Indoor Dry-Bulb : 80.205	0.17	Sensible Cap (Btu/h): 24679.42	794.58
Indoor Inlet Dew (F): 60.519	0.06	Latent Cap (Btu/h): 2411.02	212.56
Indoor Exit Dry-Bulb: 66.346	0.11	EvapAir Delta T (F): 16.11	0.43
Indoor Exit Dew (F): 59.617	0.05	Air/Ref Cap Prcnt Diff: -1.12	3.30
		Sensible Heat Ratio: 0.911	0.0085
Indoor Airflow (CFM): 1395.31	13.71	SCFM per Ton: 615.80	
Indoor Airflow (SCFM): 1390.19	13.33	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011294		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010931		
Barometric Pressure (in HG): 29.81		Nozzle Temp (F): 65.33	0.57
Air Chamber Nozzle Pressure Drop (in Water):	1.331	0.026	
Evaporator Coil Air Pressure Drop (in Water):	0.307	0.013	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 273.06	0.487	Ref-side Cap (Btu/h) : 26784.91	450.70
Upstream Temp (F): 105.68	0.315	Ref-side Cap (tons): 2.23	0.04
		Refrigerant Mdot (lbm/h): 423.29	6.96
		Coriolis Density (lbm/ft3): 82.46	0.14
Upstream R22 Tsat (F): 119.56	0.139		
Average Subcooling (F): 13.89	0.315		
Evap Exit Pressure (psia): 99.96	0.243		
Evap Exit Avg Temp : 64.36	1.181		
Exit Superheat (F): 13.65	1.181		
Evap Exit Tsat (F): 50.71	0.146		

Coil 9

R410A, A01154, Fan

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040716a.dat SUMMARY FILENAME: a040716a.sum

Air-Side Conditions	Range	Total Air-Side Capacity: 19952.67	Range
Indoor Dry-Bulb : 79.986	0.14	Sensible Cap (Btu/h): 12845.02	354.03
Indoor Inlet Dew (F): 60.436	0.06	Latent Cap (Btu/h): 7107.65	284.44
Indoor Exit Dry-Bulb: 58.954	0.16	EvapAir Delta T (F): 23.24	136.91
Indoor Exit Dew (F): 52.186	0.10	Air/Ref Cap Prcnt Diff: 0.48	0.32
		Sensible Heat Ratio: 0.644	2.14
			0.0049
Indoor Airflow (CFM): 501.58	5.80	SCFM per Ton: 302.28	
Indoor Airflow (SCFM): 502.60	6.20	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011330		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.008365		
Barometric Pressure (in HG): 29.63		Nozzle Temp (F): 60.37	0.82
Air Chamber Nozzle Pressure Drop (in Water):	0.905	0.021	
Evaporator Coil Air Pressure Drop (in Water):	1.940	0.000	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia): 425.06	2.071	Ref-side Cap (Btu/h) :	20047.22	377.05
Upstream Temp (F): 104.08	0.289	Ref-side Cap (tons):	1.67	0.03
		Refrigerant Mdot (lbm/h):	313.67	5.95
		Coriolis Density (lbm/ft3):	72.80	0.16
Upstream R22 Tsat (F): 118.59	0.377			
Average Subcooling (F): 14.52	0.458			
Evap Exit Pressure (psia): 148.69	0.728			
Evap Exit Avg Temp : 61.26	0.676			
Exit Superheat (F): 14.55	0.697			
Evap Exit Tsat (F): 46.71	0.295			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040728a.dat SUMMARY FILENAME: a040728a.sum

Air-Side Conditions		Range	Total Air-Side Capacity:	13018.25	Range
Indoor Dry-Bulb :	80.075	0.20	Sensible Cap (Btu/h):	9855.61	293.12
Indoor Inlet Dew (F):	60.371	0.05	Latent Cap (Btu/h):	3162.64	233.87
Indoor Exit Dry-Bulb:	64.382	0.22	EvapAir Delta T (F):	17.85	0.43
Indoor Exit Dew (F):	56.937	0.26	Air/Ref Cap Prcnt Diff:	3.39	6.66
			Sensible Heat Ratio:	0.757	0.0126
Indoor Airflow (CFM):	502.39	5.71	SCFM per Ton:	462.20	
Indoor Airflow (SCFM):	501.42	5.74	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011241		
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009919		
Barometric Pressure (in HG):	29.79		Nozzle Temp (F):	64.77	0.64
Air Chamber Nozzle Pressure Drop (in Water):			0.904	0.020	
Evaporator Coil Air Pressure Drop (in Water):			2.000	0.000	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	425.00	1.279	Ref-side Cap (Btu/h) :	13458.06	676.75
Upstream Temp (F):	104.53	0.350	Ref-side Cap (tons):	1.12	0.06
			Refrigerant Mdot (lbm/h):	211.23	10.62
			Coriolis Density (lbm/ft3):	72.85	0.36
Upstream R22 Tsat (F):	118.58	0.233			
Average Subcooling (F):	14.05	0.483			
Evap Exit Pressure (psia):	160.83	0.485			
Evap Exit Avg Temp :	64.99	1.716			
Exit Superheat (F):	13.50	1.902			
Evap Exit Tsat (F):	51.49	0.186			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040729a.dat SUMMARY FILENAME: a040729a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 20056.82	Range
Indoor Dry-Bulb :	79.633	0.40	Sensible Cap (Btu/h): 12753.21	491.41
Indoor Inlet Dew (F):	60.733	0.10	Latent Cap (Btu/h): 7303.61	283.59
Indoor Exit Dry-Bulb:	58.829	0.13	EvapAir Delta T (F): 22.94	246.33
Indoor Exit Dew (F):	52.283	0.34	Air/Ref Cap Prcnt Diff: 2.06	0.32
			Sensible Heat Ratio: 0.636	7.48
				0.0039
Indoor Airflow (CFM):	499.63	5.05	SCFM per Ton: 302.43	
Indoor Airflow (SCFM):	505.48	4.62	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011351	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.008322	
Barometric Pressure (in HG):	29.89		Nozzle Temp (F): 59.92	0.55
Air Chamber Nozzle Pressure Drop (in Water):			0.906	0.017
Evaporator Coil Air Pressure Drop (in Water):			2.000	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	420.74	5.177	Ref-side Cap (Btu/h) :	20469.27	1264.18
Upstream Temp (F):	105.86	2.763	Ref-side Cap (tons):	1.71	0.11
			Refrigerant Mdot (lbm/h):	324.24	14.01
			Coriolis Density (lbm/ft3):	73.10	0.81
Upstream R22 Tsat (F):	117.80	0.947			
Average Subcooling (F):	11.95	3.591			
Evap Exit Pressure (psia):	145.54	2.669			
Evap Exit Avg Temp :	59.76	10.064			
Exit Superheat (F):	14.34	11.159			
Evap Exit Tsat (F):	45.42	1.095			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040729b.dat SUMMARY FILENAME: b040729b.sum

Air-Side Conditions	Range	Total Air-Side Capacity:	20078.83	Range
Indoor Dry-Bulb : 80.044	0.28	Sensible Cap (Btu/h):	12900.77	277.15
Indoor Inlet Dew (F): 60.663	0.10	Latent Cap (Btu/h):	7178.06	142.28
Indoor Exit Dry-Bulb: 59.059	0.12	EvapAir Delta T (F):	23.24	0.32
Indoor Exit Dew (F): 52.348	0.08	Air/Ref Cap Prcnt Diff:	2.43	3.30
		Sensible Heat Ratio:	0.643	0.0043
Indoor Airflow (CFM): 499.25	5.00	SCFM per Ton:	301.73	
Indoor Airflow (SCFM): 504.86	4.90	(0.075 lb/ft3 standard air)		
Evap Inlet Humidity Ratio (lbH2O/lbAir):		0.011322		
Evap Exit Humidity Ratio (lbH2O/lbAir):		0.008341		
Barometric Pressure (in HG): 29.89		Nozzle Temp (F): 60.17	0.83	
Air Chamber Nozzle Pressure Drop (in Water):		0.904	0.018	
Evaporator Coil Air Pressure Drop (in Water):		2.000	0.000	

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia): 422.34	0.853	Ref-side Cap (Btu/h) :	20565.08	359.86
Upstream Temp (F): 105.76	0.454	Ref-side Cap (tons):	1.71	0.03
		Refrigerant Mdot (lbm/h):	325.54	6.05
		Coriolis Density (lbm/ft3):	73.13	0.23
Upstream R22 Tsat (F): 118.10	0.156			
Average Subcooling (F): 12.34	0.365			
Evap Exit Pressure (psia): 146.06	0.303			
Evap Exit Avg Temp : 58.79	1.633			
Exit Superheat (F): 13.15	1.633			
Evap Exit Tsat (F): 45.64	0.125			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040730a.dat SUMMARY FILENAME: a040730a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 23873.45	Range
Indoor Dry-Bulb :	79.875	0.22	Sensible Cap (Btu/h): 14650.46	408.94
Indoor Inlet Dew (F):	60.410	0.10	Latent Cap (Btu/h): 9222.99	136.03
Indoor Exit Dry-Bulb:	55.759	0.09	EvapAir Delta T (F): 26.22	0.43
Indoor Exit Dew (F):	49.191	0.05	Air/Ref Cap Prcnt Diff: 2.59	2.58
			Sensible Heat Ratio: 0.614	0.0054
Indoor Airflow (CFM):	498.81	5.64	SCFM per Ton: 255.62	
Indoor Airflow (SCFM):	508.54	5.84	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011196	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.007394	
Barometric Pressure (in HG):	29.95		Nozzle Temp (F): 57.28	0.79
Air Chamber Nozzle Pressure Drop (in Water):			0.910	0.021
Evaporator Coil Air Pressure Drop (in Water):			2.000	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	420.09	0.975	Ref-side Cap (Btu/h) :	24489.87	230.39
Upstream Temp (F):	104.60	0.341	Ref-side Cap (tons):	2.04	0.02
			Refrigerant Mdot (lbm/h):	384.57	3.21
			Coriolis Density (lbm/ft3):	72.80	0.27
Upstream R22 Tsat (F):	117.68	0.179			
Average Subcooling (F):	13.08	0.374			
Evap Exit Pressure (psia):	138.64	0.425			
Evap Exit Avg Temp :	56.11	0.591			
Exit Superheat (F):	13.59	0.581			
Evap Exit Tsat (F):	42.53	0.181			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040803a.dat SUMMARY FILENAME: a040803a.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 15230.41	Range
Indoor Dry-Bulb :	80.216	0.47	Sensible Cap (Btu/h): 11003.77	360.44
Indoor Inlet Dew (F):	60.383	0.44	Latent Cap (Btu/h): 4226.64	435.63
Indoor Exit Dry-Bulb:	62.392	0.27	EvapAir Delta T (F): 19.91	0.43
Indoor Exit Dew (F):	55.700	0.25	Air/Ref Cap Prcnt Diff: 3.44	7.17
			Sensible Heat Ratio: 0.722	0.0211
Indoor Airflow (CFM):	500.37	5.94	SCFM per Ton: 395.56	
Indoor Airflow (SCFM):	502.05	5.68	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011227	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009462	
Barometric Pressure (in HG):	29.84		Nozzle Temp (F): 63.02	0.70
Air Chamber Nozzle Pressure Drop (in Water):			0.901	0.021
Evaporator Coil Air Pressure Drop (in Water):			2.000	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	426.42	4.507	Ref-side Cap (Btu/h) :	15753.76	782.81
Upstream Temp (F):	105.37	1.638	Ref-side Cap (tons):	1.31	0.07
			Refrigerant Mdot (lbm/h):	248.70	14.29
			Coriolis Density (lbm/ft3):	73.10	0.60
Upstream R22 Tsat (F):	118.84	0.819			
Average Subcooling (F):	13.48	1.173			
Evap Exit Pressure (psia):	159.78	1.213			
Evap Exit Avg Temp :	65.49	3.001			
Exit Superheat (F):	14.40	3.292			
Evap Exit Tsat (F):	51.09	0.466			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: b040803b.dat SUMMARY FILENAME: b040803b.sum

Air-Side Conditions		Range	Total Air-Side Capacity: 15328.62	Range
Indoor Dry-Bulb :	80.106	0.21	Sensible Cap (Btu/h): 10983.96	177.88
Indoor Inlet Dew (F):	60.463	0.05	Latent Cap (Btu/h): 4344.66	159.46
Indoor Exit Dry-Bulb:	62.313	0.11	EvapAir Delta T (F): 19.86	70.27
Indoor Exit Dew (F):	55.656	0.03	Air/Ref Cap Prcnt Diff: 2.61	0.22
			Sensible Heat Ratio: 0.717	3.99
				0.0044
Indoor Airflow (CFM):	500.68	5.04	SCFM per Ton: 393.29	
Indoor Airflow (SCFM):	502.38	4.71	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):			0.011259	
Evap Exit Humidity Ratio (lbH2O/lbAir):			0.009447	
Barometric Pressure (in HG):	29.84		Nozzle Temp (F): 63.00	0.62
Air Chamber Nozzle Pressure Drop (in Water):			0.903	0.017
Evaporator Coil Air Pressure Drop (in Water):			2.000	0.000

Refrigerant Side Conditions

Expansion Valve

Upstream Pressure (psia):	427.81	1.766	Ref-side Cap (Btu/h) :	15728.51	604.89
Upstream Temp (F):	105.94	0.429	Ref-side Cap (tons):	1.31	0.05
			Refrigerant Mdot (lbm/h):	249.30	9.07
			Coriolis Density (lbm/ft3):	73.21	0.21
Upstream R22 Tsat (F):	119.09	0.320			
Average Subcooling (F):	13.15	0.518			
Evap Exit Pressure (psia):	159.82	0.243			
Evap Exit Avg Temp :	65.51	1.029			
Exit Superheat (F):	14.41	1.122			
Evap Exit Tsat (F):	51.10	0.093			

DOE/ARI MIX-MATCH EVAPORATOR TEST SUMMARY SHEET
 DATA FILENAME: a040817a.dat SUMMARY FILENAME: a040817a.sum

			Range
Air-Side Conditions	Range	Total Air-Side Capacity: 11007.81	265.30
Indoor Dry-Bulb : 79.944	0.34	Sensible Cap (Btu/h): 9076.99	221.25
Indoor Inlet Dew (F): 60.380	0.15	Latent Cap (Btu/h): 1930.83	110.83
Indoor Exit Dry-Bulb: 65.709	0.17	EvapAir Delta T (F): 16.35	0.22
Indoor Exit Dew (F): 58.334	0.18	Air/Ref Cap Prcnt Diff: 5.15	3.35
		Sensible Heat Ratio: 0.825	0.0077
Indoor Airflow (CFM): 504.95	6.74	SCFM per Ton: 549.33	
Indoor Airflow (SCFM): 503.91	7.26	(0.075 lb/ft3 standard air)	
Evap Inlet Humidity Ratio (lbH2O/lbAir):	0.011211		
Evap Exit Humidity Ratio (lbH2O/lbAir):	0.010407		
Barometric Pressure (in HG): 29.88		Nozzle Temp (F): 66.27	0.55
Air Chamber Nozzle Pressure Drop (in Water):	0.913	0.025	
Evaporator Coil Air Pressure Drop (in Water):	2.000	0.000	

Refrigerant Side Conditions			
Expansion Valve			
Upstream Pressure (psia): 432.75	1.157	Ref-side Cap (Btu/h) : 11574.22	244.37
Upstream Temp (F): 104.11	0.487	Ref-side Cap (tons): 0.96	0.02
		Refrigerant Mdot (lbm/h): 181.14	3.66
		Coriolis Density (lbm/ft3): 72.91	0.21
Upstream R22 Tsat (F): 119.98	0.208		
Average Subcooling (F): 15.87	0.596		
Evap Exit Pressure (psia): 167.22	0.728		
Evap Exit Avg Temp : 67.73	0.893		
Exit Superheat (F): 13.83	0.983		
Evap Exit Tsat (F): 53.90	0.270		