
Online Airtightness Savings Calculator for Commercial Buildings in the United States, Canada, and China

Som Shrestha, PhD, BEMP

Member ASHRAE

Andre Desjarlais

Diana Hun, PhD

Steven Emmerich

Fellow ASHRAE

Lisa Ng, PhD

Member ASHRAE

Laverne Dalgleish

Associate Member ASHRAE

ABSTRACT

The relative contribution of air leakage to heating and cooling loads has been increasing as the thermal resistance of commercial building envelopes continues to improve. Easy-to-access data are needed to convince building owners and contractors that enhancing the airtightness of new and existing buildings is the next logical step to achieve a high-performance building envelope. To this end, Oak Ridge National Laboratory, the National Institute of Standards and Technology, the Air Barrier Association of America, and the U.S.-China Clean Energy Research Center for Building Energy Efficiency partnered to develop an online calculator that estimates the potential energy and cost savings in major U.S., Canadian, and Chinese cities from improvements in airtightness. This tool will have a user-friendly graphical interface that accesses a database of CONTAM and EnergyPlus pre-run simulation results and will be available to the public at no cost. Baseline leakage rates are either user specified or selected by the user from a list of supplied leakage rates. Users will then enter the expected airtightness after the installation of an air barrier system. Energy costs are estimated based on the building location and other user inputs. This paper provides an overview of the methodology implemented in this calculator as well as example results. The deployment of this calculator could influence construction practices, contributing to significant reductions in energy use and greenhouse gas emissions from the United States, Canada, and China.

INTRODUCTION

The U.S. Department of Energy's (DOE) *Windows and Building Envelope Research and Development: Roadmap for Emerging Technologies* (DOE 2014) indicates that improving airtightness is among the most cost-effective strategies to decrease energy loads due to the building envelope. This conclusion is based on the fact that air leakage (i.e., infiltration and exfiltration) is responsible for about 6% of total energy used by commercial buildings in the United States, or about 15% of primary energy consumption in commercial buildings that is attributable to fenestration and building envelope components in 2010 was due to air leakage (DOE 2014). Nevertheless, improving airtightness is not always recognized by owners of commercial buildings, as they have been slow in acknowledging and diminishing the detrimental effects of air leakage on energy use and other aspects of building perfor-

mance. The construction industry needs a credible, easy-to-use tool that estimates potential energy and financial savings in a standardized manner so designers and contractors can give building owners compelling reasons to invest in reducing air leakage.

Although air leakage has long been recognized as a key contributor to heating and cooling loads, methods that estimate its effects on energy consumption vary due to the complexity of this task (Crawley et al. 2008; Goel et al. 2014; Gowri et al. 2009; Ng et al. 2012). Comprehensive building design and energy simulations should take into account the fact that air leakage rates vary due to the operation of heating, ventilation, and air-conditioning (HVAC) systems, occupancy, and weather (i.e., indoor-to-outdoor temperature and wind). However, typical energy simulations tend to take shortcuts to expedite the analysis, such as assuming constant leak-

Som Shrestha and **Diana Hun** are research and development staff members and **Andre Desjarlais** is the program manager of the Building Envelope Systems Research Group at Oak Ridge National Laboratory, Oak Ridge, TN. **Lisa Ng** is a mechanical engineer and **Steven Emmerich** is the group leader of the Indoor Air Quality and Ventilation Group at the National Institute of Standards and Technology, Gaithersburg, MD. **Laverne Dalgleish** is the executive director of the Air Barrier Association of America, Walpole, MA.

age rates and/or using simplified algorithms, which can lead to under- or over-estimated energy usage. Also, use of macro climate data versus micro climate data may impact the pressure distribution on buildings, and hence the infiltration rate. However, quantifying the impact of using macro climate data is beyond the scope of this paper.

Oak Ridge National Laboratory (ORNL), the National Institute of Standards and Technology (NIST), the Air Barrier Association of America (ABAA), and the U.S.-China Clean Energy Research Center for Building Energy Efficiency (CERC BEE) are collaborating to develop an online calculator that will be free to the public, user friendly, and powerful enough to address the previously mentioned variables when estimating energy savings due to improvements in airtightness. Figure 1 describes the general steps to achieve this goal. The tool will use a database of EnergyPlus pre-run simulation results for DOE commercial prototype buildings. The main difference between the online calculator and the procedure followed in the DOE prototypes is that the calculator utilizes CONTAM-calculated air changes per hour (ACH) or air leakage rates as inputs, whereas the prototypes make simplified assumptions that are described in the following sections of this paper. CONTAM (Dols and Polidoro 2015) is a multizone airflow and contaminant transport analysis software developed at NIST and validated by multiple studies, such as

Haghigat and Megri (1996), Chung (1996), Emmerich (2001), and Emmerich et al. (2004). This software takes into account multiple variables, such as weather conditions, envelope airtightness, and HVAC system operation, to calculate air leakage rates through the building enclosure. The CONTAM-calculated hourly air leakage rates are imported into DOE's whole-building energy simulation software EnergyPlus (DOE 2016a) with the CONTAM Results Export Tool (Polidoro et al. 2016). EnergyPlus is then used to calculate the effect of air leakage on energy consumption.

In addition to CONTAM, the Airflow Network module in EnergyPlus could have been used to calculate the air leakage rates through the building envelope. However, comparing results from CONTAM and the Airflow Network were beyond the scope of this project. Future efforts may cover this assessment.

The ultimate objective of the tool is for users to be able to estimate expected energy and financial savings for different airtightness levels in commercial buildings that are located in the United States, Canada, and China. This paper presents an overview of this calculator and results for a stand-alone retail building prototype in Chicago, Winnipeg, and Shanghai.

BUILDING MODELS

In order to cover a large percentage of the common building types in the United States, the calculator uses DOE

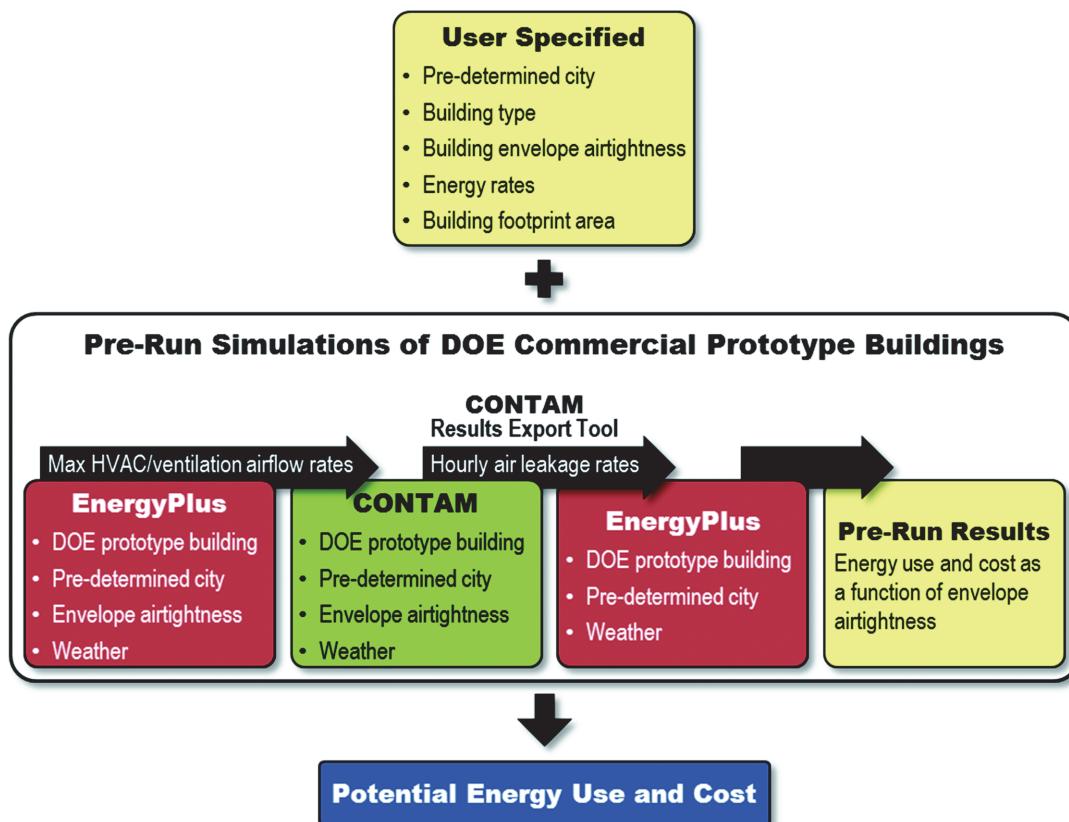


Figure 1 General procedure to estimate potential energy costs for different levels of envelope airtightness in DOE commercial prototype buildings.

commercial prototype building models (DOE 2016b). These prototypes were derived from DOE commercial reference building models (DOE 2016c) and represent about 80% of new construction. Moreover, these prototypes cover 16 commercial building types, including mid- to high-rise residential buildings in 17 climate locations defined in ASHRAE/IES Standard 90.1-2013 (ASHRAE 2013b). The variables that are prescribed in these models include building envelope components, HVAC equipment types and efficiency, and occupancy schedules. As Standard 90.1 evolves, Pacific Northwest National Laboratory (PNNL) modifies these models with input from ASHRAE Standing Standard Project Committee 90.1 members and building industry experts. Features of the building models and a detailed description of their development are provided by Goel et al. (2014) and the Building Energy Codes Program website (DOE 2016b).

The first phase in the development of the calculator will cover three prototype building models (stand-alone retail, medium office, and mid-rise apartment) in 45 cities in the United States, 5 cities in Canada, and 5 cities in China. Models that represent typical commercial buildings in Canada and China are not available in the public domain; therefore, the DOE prototypes will also be used in these two countries.

EXAMPLE CALCULATIONS


The example in this paper uses the DOE prototype building model for a stand-alone retail building (Figure 2). The main characteristics of this prototype are based on ASHRAE/IES Standard 90.1-2013 and listed in Table 1. Note that Table 1 describes the simplified method used with prototype buildings to take into account the effects of HVAC operation on air leakage rates. This method assumes that the air leakage rate is $1 \text{ L/s} \cdot \text{m}^2$ at 75 Pa when the HVAC is off and that the leakage rate decreases by 75% when the HVAC is on (Gowri et al. 2009). This approach is followed because EnergyPlus does not consider the effects of HVAC operation and wind direction on air leakage unless the Airflow Network module is used, which is not typically done because it is not a trivial task.

In contrast, the online calculator utilizes CONTAM to estimate air leakage rates. A complete description of the prototype building is provided by DOE (DOE 2016d).


Ng et al. (2012) developed CONTAM models using EnergyPlus models of the ASHRAE/IESNA Standard 90.1-2004 prototype buildings as a baseline, and they were updated for this effort based on the ASHRAE/IES Standard 90.1-2013 models. The EnergyPlus and CONTAM models shared the same building geometry, occupancy, heating and cooling set points, and outdoor air ventilation requirements. However, the building zoning was modified in the CONTAM models in instances where additional zones were needed to support realistic airflow analyses (e.g., elevator shafts and restrooms). Modeling these additional zones is important to properly capture pressure relationships and airflow patterns in buildings. The present work utilizes the CONTAM model generated for the stand-alone retail building that includes a restroom that is not present in the prototype building model.

In order to determine the HVAC supply flow rates that would be used in CONTAM, a preliminary comparison was made of the maximum values that are calculated by EnergyPlus for the prototype stand-alone retail building in different cities by Ng et al. (2012). EnergyPlus results varied by less than 10% on average among the evaluated cities. Since the HVAC system modeled in CONTAM would retain approximately 10% more supply air than return air, the differences found in the maximum supply rates did not warrant changing their values in the CONTAM models for each city. Thus, the supply flow rates that were obtained for Chicago were applied to Winnipeg and Shanghai.

The stand-alone retail building has five thermal zones as shown in Figure 2. All zones, except the front entry, are conditioned in the summer and winter according to the set points listed in Table 1. These temperatures were scheduled in CONTAM because CONTAM does not perform thermal calculations. In the prototype building models, the front entry had a cooling set point of 38°C in the summer. However, it was assumed in the CONTAM model that the temperature in this

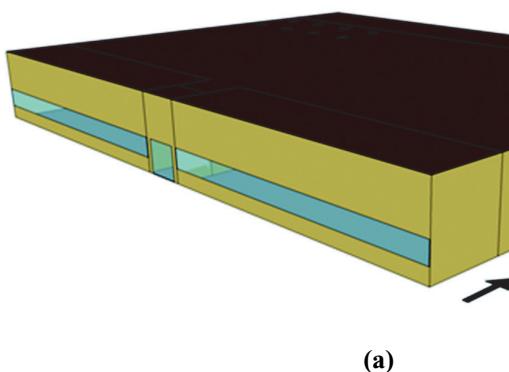

(a)

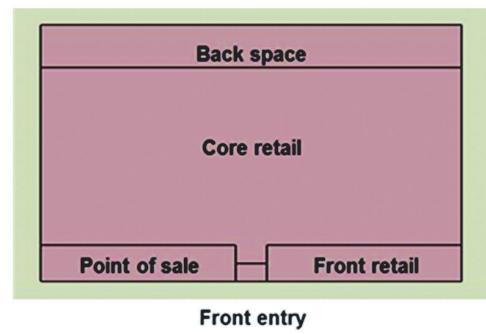

(b)

Figure 2 Stand-alone retail building prototype: (a) building shape and orientation and (b) layout of five thermal zones (DOE 2016d).

Table 1. Modeling Specifications of Stand-Alone Retail Building Prototype (DOE 2016d)

Characteristic	Description
Floor area, m ²	2300 (length 54.3 m × width 42.4 m)
Number of floors	1
Floor to ceiling height, m	6.1
Window-to-wall ratio, %	25.4
Windows on south-facing façade	
Building Envelope	
Walls	20.3 cm concrete masonry block + insulation per ASHRAE/IES Standard 90.1-2013 + 1.3 cm drywall
Roof	Roof membrane + insulation per ASHRAE/IES Standard 90.1-2013 + metal decking
Window U-factor and solar heat gain coefficient (SHGC)	Per ASHRAE/IES Standard 90.1-2013
Foundation	15.2 cm concrete slab-on-grade + insulation per ASHRAE/IES Standard 90.1-2013
Air leakage rates for prototype buildings (not used in the present study)	HVAC off = 1 L/s·m ² at 75 Pa HVAC on = 25% of HVAC off rate = 0.25 L/s·m ² at 75 Pa
HVAC	
Heating type	Gas furnace inside the packaged air-conditioning unit
Cooling type	Packaged air-conditioning unit
Size	Autosized to design day
Efficiency	Based on climate location and design cooling/heating capacity and ASHRAE/IES Standard 90.1-2013 requirements
Thermostat set point, °C	23.9 cooling/21.1 heating
Thermostat setback, °C	29.4 cooling/15.6 heating
Ventilation	Per ASHRAE Standard 62.1-2013 (ASHRAE 2013a)

zone was equal to the outdoor temperature in the cooling months. Also, in the EnergyPlus model the front entry had scheduled air leakage with a maximum flow rate of 0.94 m³/s that varied between 0% and 100%, corresponding to unoccupied and occupied periods, respectively. This large air leakage was not modeled in CONTAM because its high flow rates would artificially increase the leakage of the entire building envelope in the whole-building air leakage rate data that would be exported to EnergyPlus. The outdoor air economizers and night cooling options in the EnergyPlus models were not implemented in the CONTAM models because CONTAM does not perform thermal calculations and would not be able to predict when economizers or night cooling options would be activated. Indoor temperatures in the CONTAM model were scheduled according to the set points in the EnergyPlus model.

Table 2 lists the four levels of airtightness that were assumed in the simulations. These include the slab and below-grade envelope area in the normalization of the air leakage

rate, which is why they are referred to as *six-sided envelopes*, as well as the assumption that the air leakage is equally distributed over all exterior surfaces. The six-sided value is used in many building codes and standards; however, the CONTAM and EnergyPlus models assume no air leakage through the exterior envelope that is not exposed to ambient air. The baseline value in Table 2 was calculated using the average leakage rate for commercial buildings reported by Emmerich et al. (2005) of 9 L/s·m² at 75 Pa for a five-sided envelope. The baseline of 5.4 L/s·m² at 75 Pa was obtained by multiplying the average leakage rate by the five-sided to six-sided envelope area ratio of the stand-alone retail building prototype. Table 2 also lists three target levels for improved airtightness at 75 Pa: 2 L/s·m² is the most stringent of three options in the 2015 *International Energy Conservation Code* (ICC 2015) because it involves a blower door test, whereas the other two options are based on laboratory tests per ASTM E2357 (ASTM 2011) and ASTM E2178 (ASTM 2013); 1.25 L/s·m² is the airtightness required by the U.S. Army Corps of Engineers (USACE

2012); and $0.25 \text{ L/s}\cdot\text{m}^2$ is the leakage rate targeted by the DOE buildings envelope roadmap (DOE 2014). Emmerich and Persily (2014) analyzed the NIST U.S. commercial building air leakage database and found that the 79 buildings categorized as having an air barrier had an average six-sided leakage of $1.39 \text{ L/s}\cdot\text{m}^2$ at 75 Pa, which was 70% below the average leakage of the 290 buildings without an air barrier (i.e., $4.33 \text{ L/s}\cdot\text{m}^2$ at 75 Pa) and is similar to the second target level above. Zhivov et al. (2014) reported the average six-sided leakage for a set of 285 new and retrofitted military buildings constructed to the USACE specifications to be $0.9 \text{ L/s}\cdot\text{m}^2$.

The three cities that were evaluated are Chicago, IL, USA; Winnipeg, Canada; and Shanghai, China. Table 3 shows their

Table 2. Assumed Building Envelope Airtightness Levels for a Six-Sided Envelope

Case	Air Leakage Rate at 75 Pa, $\text{L/s}\cdot\text{m}^2$	Source
Baseline	5.4	Emmerich et al. (2005)
1	2.0	ICC (2015)
2	1.25	USACE (2012)
3	0.25	DOE (2014)

DOE climate zones and the locations of the corresponding prototype building models that were used in the simulations. CONTAM was used to calculate the hourly air leakage rates for the prototype building for each of these cities. Table 4 lists the ACH results for when the HVAC system is on ($\text{ACH}_{\text{HVAC on}}$), when the HVAC system is off ($\text{ACH}_{\text{HVAC off}}$), and the annual average (ACH_{avg}). Results indicate that ACH_{avg} for Winnipeg is the highest, followed by Chicago and Shanghai. This is mainly due to differences in weather among the cities; for example, the annual average wind speed for these cities is 4.78, 4.56, and 3.25 m/s, respectively. Results suggest that reducing the air leakage rate from 5.4 to $2 \text{ L/s}\cdot\text{m}^2$ at 75 Pa led to a decrease in ACH_{avg} of about 75% across the three locations. By further lowering the leakage rate to 1.25 and $0.25 \text{ L/s}\cdot\text{m}^2$ at 75 Pa, ACH_{avg} was reduced by about 86% and 98%, respectively, compared to the baseline.

Table 3. Evaluated Cities

City	Climate Zone	Prototype Building Model Used in Calculator
Shanghai, China	3A (warm, humid)	Memphis, TN, USA
Chicago, IL, USA	5A (cold, humid)	Chicago, IL, USA
Winnipeg, Canada	7 (very cold)	Duluth, MN, USA

Table 4. Predicted Air Changes per Hour

Leakage Rate at 75 Pa, $\text{L/s}\cdot\text{m}^2$	Air Changes per Hour, 1/h			$\frac{\text{ACH}_{\text{HVAC on}}}{\text{ACH}_{\text{HVAC off}}}$, %	Decrease in ACH_{avg} from Baseline ACH, %
	HVAC On	HVAC Off	Annual Average		
Chicago					
5.4	0.2077	0.2861	0.2389	73	
2.0	0.0366	0.1061	0.0642	35	73
1.25	0.0117	0.0664	0.0334	18	86
0.25	0.0009	0.0134	0.0059	7	98
Winnipeg					
5.4	0.2804	0.3684	0.3154	76	
2.0	0.0571	0.1366	0.0887	42	72
1.25	0.0201	0.0855	0.0461	23	85
0.25	0.0012	0.0172	0.0076	7	98
Shanghai					
5.4	0.1021	0.1823	0.1340	56	
2.0	0.0118	0.0675	0.0340	18	78
1.25	0.0037	0.0422	0.0190	9	88
0.25	0.0006	0.0085	0.0037	7	98

As previously stated, in order to estimate the hourly $ACH_{HVAC\ on}$, the DOE commercial prototype building models assume that this number is 25% of $ACH_{HVAC\ off}$. However, Table 4 shows that using multizone airflow simulations, this percentage is closely linked to the airtightness of the envelope. For example, when the building enclosure leakage rate was $5.4 \text{ L/s}\cdot\text{m}^2$ at 75 Pa, $ACH_{HVAC\ on}$ was 56% to 76% of $ACH_{HVAC\ off}$. In contrast, this ratio decreased to 7% when the envelope airtightness was $0.25 \text{ L/s}\cdot\text{m}^2$ at 75 Pa. This implies that the approach followed by users of prototype building models significantly underestimates the contribution of air leakage to energy consumption when the HVAC system is on in buildings with leaky enclosures, while the opposite occurs in buildings with very tight envelopes.

Figure 3 illustrates the HVAC energy use as a function of the building envelope airtightness level in Winnipeg. Results indicate that improving airtightness from 5.4 to $2 \text{ L/s}\cdot\text{m}^2$ at 75 Pa led to an 18% and 55% decrease in electricity and natural gas use, respectively.

Energy costs were calculated using the annual energy outputs from EnergyPlus and the annual average prices of

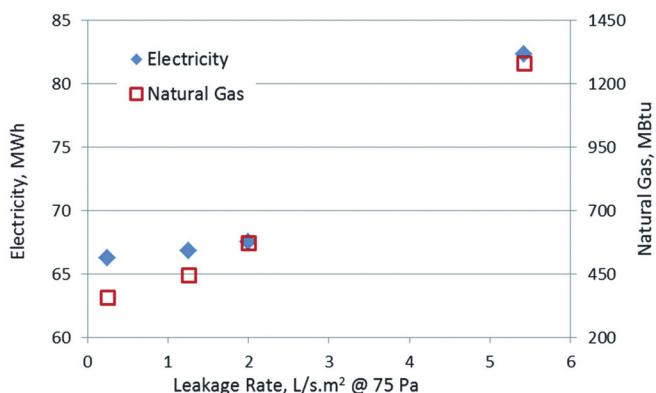


Figure 3 Annual HVAC energy use for a prototype stand-alone retail building in Winnipeg based on the CONTAM+EnergyPlus approach.

Table 5. Energy Prices

Location	Electricity Price	Natural Gas Price
Chicago	\$0.0933/kWh ^a	\$8.86/1000 ft ³ ^b
Winnipeg	C\$0.14/kWh ^c (≈\$0.10/kWh)	C\$0.1605 m ³ ^d (≈\$3.4/1000 ft ³)
Shanghai	¥0.781/kWh ^e (≈\$0.12/kWh)	¥3.65/m ³ ^f (≈\$15.9/1000 ft ³)

^a http://www.eia.gov/electricity/sales_revenue_price/

^b http://www.eia.gov/dnav/ng_ng_sum_lsum_a_EPG0_PCS_DMcf_a.htm

^c <https://www.ovoenergy.com/guides/energy-guides/average-electricity-prices-kwh.html>

^d http://www.economicdevelopmentwinnipeg.com/uploads/document_file/natural_gas_rates.pdf?i=1433529826

^e <http://news.asean168.com/a/20150413/5318.html>

^f <http://gas.gold600.com/>

electricity and natural gas listed in Table 5. Figures 4, 5, and 6 show the annual HVAC energy cost in Chicago, Winnipeg, and Shanghai, respectively, as a function of building envelope leakage rate. The figures also present quadratic regression equations. The high coefficients of determination (i.e., $R^2 >$

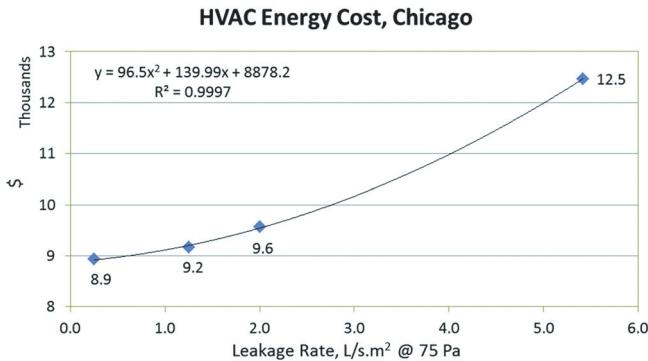


Figure 4 Annual HVAC energy cost for a prototype stand-alone retail building in Chicago based on the CONTAM+EnergyPlus approach.

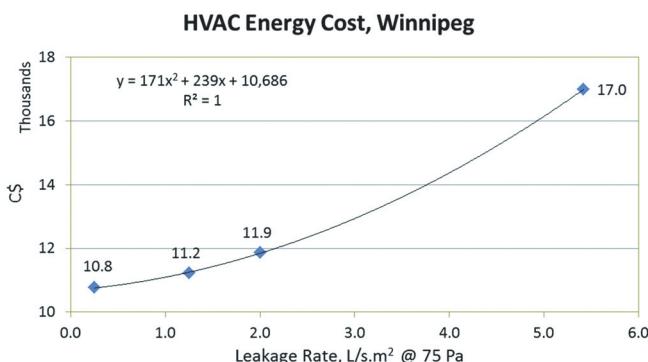


Figure 5 Annual HVAC energy cost for a prototype stand-alone retail building in Winnipeg based on the CONTAM+EnergyPlus approach.

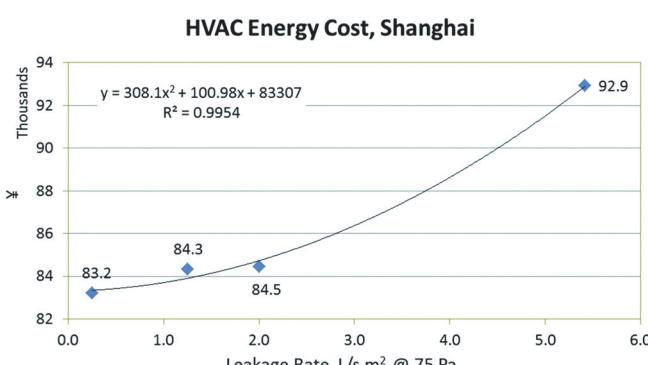


Figure 6 Annual HVAC energy cost for a prototype stand-alone retail building in Shanghai based on the CONTAM+EnergyPlus approach.

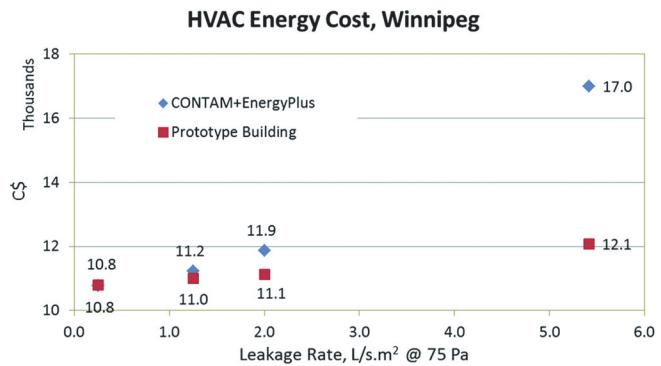


Figure 7 Annual HVAC energy costs in Winnipeg from the CONTAM+EnergyPlus and the prototype building models.

0.995) suggest that the calculator may be able to use quadratic equations to estimate energy costs for any given airtightness level. Similar equations could be derived for the heating and cooling costs, as well as for energy usage.

Further evaluations were performed to get a better understanding of the improvements that the CONTAM+EnergyPlus approach offers. To serve as a reference, simulations were conducted for Winnipeg using only EnergyPlus; that is, hourly air leakage rates from CONTAM were not imported into EnergyPlus and the prototype building assumption that $ACH_{HVAC\ on}$ equals 25% of $ACH_{HVAC\ off}$ was made. Table 6 shows the results from these simulations, and Table 7 compares the ACH values that were obtained through these two approaches. These data illustrate how the simplified method used in the prototype building models underestimates the ACH and its corresponding impact on energy use. The effects are more noteworthy in leaky buildings, where the two approaches had ACH differences of 70% when the HVAC system is on and an annual average discrepancy in ACH of 49%. These differences decrease as the envelope becomes tighter, although they remained significant even when the leakage rate of the enclosure was 2 L/s·m² at 75 Pa.

Figure 7 compares the annual HVAC energy costs in Winnipeg that were calculated with the CONTAM+EnergyPlus and the prototype building methods. As previously stated, differences are greater in buildings with leakier envelopes: the discrepancy in buildings with a leakage rate of 5.4 L/s·m² at 75 Pa amounted to nearly \$5000 per year. Ongoing projects at ORNL will help validate these estimated energy savings.

CONCLUSION

ORNL and NIST combined their expertise to develop a procedure that will be used in an online airtightness calculator. This procedure is different from other common methods used in energy analysis in that it uses hourly air leakage rates that are estimated by taking into account key variables such as building leakage rate, weather conditions, and HVAC operation. The calculator will provide energy cost estimates as a

Table 6. Predicted Air Changes per Hour in Winnipeg Using the Prototype Building Leakage Rate Reduction Method

Leakage Rate at 75 Pa, L/s·m ²	Air Changes per Hour, 1/h			$\frac{ACH_{HVAC\ on}}{ACH_{HVAC\ off}}$, %	Decrease from Baseline Annual Average ACH, %
	HVAC On	HVAC Off	Annual Average		
5.4	0.0841	0.2765	0.1605	30	
2.0	0.0310	0.1024	0.0594	30	63%
1.25	0.0194	0.0641	0.0372	30	77%
0.25	0.0039	0.0128	0.0074	30	95%

Table 7. Comparison of Air Changes per Hour from CONTAM+EnergyPlus and the Prototype Building Simulation Approaches

Leakage Rate at 75 Pa, L/s·m ²	Difference Between CONTAM+EnergyPlus and the Prototype Building Simulation ACH values, %		
	HVAC On	HVAC Off	Annual Average
5.4	70	25	49
2.0	46	25	33
1.25	3	25	19
0.25	-225	26	3

function of building envelope airtightness for DOE commercial prototype buildings in cities in the United States, Canada, and China. To demonstrate the CONTAM+EnergyPlus procedure, the paper presents an example where a prototype stand-alone retail building is simulated in Chicago, Winnipeg, and Shanghai. Results demonstrate that methods using simplified assumptions, such as $ACH_{HVAC\ on}$ equals 25% of $ACH_{HVAC\ off}$ underestimate the air leakage rates and the effects of building envelope airtightness on energy use. In the stand-alone retail building prototype example in Winnipeg, this discrepancy amounted to nearly \$5000 per year for a building with a leakage rate of 5.4 L/s·m² at 75 Pa; ongoing projects at ORNL will help validate these estimated energy savings. The calculator that is under development will be a powerful, credible, and easy-to-use tool that designers and contractors can utilize to estimate the energy and financial savings that building owners could achieve by reducing the air leakage.

ACKNOWLEDGMENTS

The authors would like to thank the U.S. Department of Energy, the Air Barrier Association of America, and the U.S.-China Clean Energy Research Center for Building Energy Efficiency for funding this research.

This manuscript has been authored by UT-Battelle, LLC, under Contract No. DE-AC05-00OR22725 with the U.S. Department of Energy. The United States Government retains and the publisher, by accepting the article for publication, acknowledges that the United States Government retains a non-exclusive, paid-up, irrevocable, world-wide license to publish or reproduce the published form of this manuscript, or allow others to do so, for United States Government purposes.

REFERENCES

- ASHRAE. 2013a. ANSI/ASHRAE Standard 62.1-2013, *Ventilation for acceptable indoor air quality*. Atlanta: ASHRAE.
- ASHRAE. 2013b. ANSI/ASHRAE/IES Standard 90.1-2013, *Energy standard for buildings except low-rise residential buildings*. Atlanta: ASHRAE.
- ASTM. 2011. ASTM E2357-11, *Standard test method for determining air leakage of air barrier assemblies*. West Conshohocken, PA: ASTM International.
- ASTM. 2013. ASTM E2178-13, *Standard test method for air permeance of building materials*. West Conshohocken, PA: ASTM International.
- Chung, K.C. 1996. Development and validation of a multi-zone model for overall indoor air environment prediction. *HVAC&R Research* 2:376–85.
- Crawley, D.B., J.W. Hand, M. Kummert, and B.T. Griffith. 2008. Contrasting the capabilities of building energy performance simulation programs. *Building and Environment* 43(4):661–73.
- DOE. 2014. Windows and building envelope research and development: Roadmap for emerging technologies. Washington, DC: U.S. Department of Energy. http://energy.gov/sites/prod/files/2014/02/f8/BTO_windows_and_envelope_report_3.pdf
- DOE. 2016a. *EnergyPlus*. Retrieved February 2016 from <https://energyplus.net>. Washington, DC: U.S. Department of Energy.
- DOE. 2016b. Commercial prototype building models. Retrieved February 2016 from <https://www.energycodes.gov/commercial-prototype-building-models>. Washington, DC: U.S. Department of Energy.

- DOE. 2016c. Commercial reference buildings. Retrieved February 2016 from <http://energy.gov/eere/buildings/commercial-reference-buildings>. Washington, DC: U.S. Department of Energy.
- DOE. 2016d. 90.1 prototype building models sand alone retail. Retrieved February 2016 from <https://www.energycodes.gov/901-prototype-building-models-stand-alone-retail>. Washington, DC: U.S. Department of Energy.
- Dols, W.S., and B. Polidoro. 2015. *CONTAM user guide and program documentation*. Technical Note 1887. Gaithersburg, MD: National Institute of Standards and Technology.
- Emmerich, S.J. 2001. Validation of multizone IAQ modeling of residential-scale buildings: A review. *ASHRAE Transactions*, vol. 107(2).
- Emmerich, S.J., S.J. Nabinger, A. Gupte, and C. Howard-Reed. 2004. Validation of multizone IAQ model predictions for tracer gas in a townhouse. *Building Services Engineering Research and Technology* 25:305–16.
- Emmerich, S.J., T.P. McDowell, and W. Anis. 2005. Investigation of the impact of commercial building envelope airtightness on HVAC energy use. NISTIR 7238. Gaithersburg, MD: National Institute of Standards and Technology.
- Emmerich, S.J., and A.K. Persily. 2014. Analysis of U.S commercial building envelope air leakage database to support sustainable building design. *The International Journal of Ventilation*, vol. 12.
- Goel, S., R. Athalye, W. Wang, J. Zhang, M. Rosenberg, Y. Xie, R. Hart, and V. Mendon. 2014. *Enhancements to ASHRAE Standard 90.1 prototype building models*. PNNL-23269. Richland, WA: Pacific Northwest National Laboratory.
- Gowri, K., D. Winiarski, and R. Jarnagin. 2009. *Infiltration modeling guidelines for commercial building energy analysis*. PNNL-18898. Richland, WA: Pacific Northwest National Laboratory.
- Haghigat, F., and A.C. Megri. 1996. A comprehensive validation of two airflow models—COMIS and CONTAM. *Indoor Air* 6:278–88.
- ICC. 2015. *2015 International Energy Conservation Code*. Washington, DC: International Code Council.
- Ng, L.C., A. Musser, S.J. Emmerich, and A.K. Persily. 2012. *Airflow and indoor air quality models of DOE reference commercial buildings*. Technical Note 1734. Gaithersburg, MD: National Institute of Standards and Technology.
- Polidoro, B., L.C. Ng, and W.S. Dols. 2016. *CONTAM results export tool*. Technical Note 1912. Gaithersburg, MD: National Institute of Standards and Technology.
- USACE. 2012. *Air leakage test protocol for building envelopes*. Washington, DC: U.S. Army Corps of Engineers.
- Zhivov, A., D. Herron, J.L. Durston, M. Heron, and G. Lea. 2014. Airtightness in new and retrofitted US army buildings. *International Journal of Ventilation*, vol. 12.